



**Baker Lake Elsinore
NOISE AND VIBRATION ANALYSIS
CITY OF LAKE ELSINORE**

PREPARED BY:

Bill Lawson, PE, INCE
blawson@urbanxroads.com
(949) 584-3148

MARCH 24, 2025

15852-06 NA

TABLE OF CONTENTS

TABLE OF CONTENTS.....	III
APPENDICES	IV
LIST OF EXHIBITS	IV
LIST OF TABLES	V
LIST OF ABBREVIATED TERMS.....	VI
EXECUTIVE SUMMARY	1
1 INTRODUCTION.....	3
1.1 Site Location.....	3
1.2 Project Description.....	3
2 FUNDAMENTALS	7
2.1 Range of Noise	7
2.2 Noise Descriptors	8
2.3 Sound Propagation.....	8
2.4 Noise Control	9
2.5 Noise Barrier Attenuation	9
2.6 Land Use Compatibility With Noise	10
2.7 Community Response to Noise.....	10
2.8 Vibration	11
3 REGULATORY SETTING.....	13
3.1 State of California Noise Requirements.....	13
3.2 City of Lake Elsinore General Plan Noise Element	13
3.3 Operational Noise Standards	15
3.4 Construction Noise Standards	16
3.5 Construction Vibration Standards.....	18
3.6 City of Lake Elsinore Good Neighbor Policy	18
4 SIGNIFICANCE CRITERIA.....	19
4.1 Noise Level Increases (Threshold A)	19
4.2 Vibration (Threshold B)	21
4.3 CEQA Guidelines Not Further Analyzed (Threshold C)	21
4.4 Significance Criteria Summary	21
5 EXISTING NOISE LEVEL MEASUREMENTS	23
5.1 Measurement Procedure and Criteria	23
5.2 Noise Measurement Locations	23
5.3 Noise Measurement Results	24
6 TRAFFIC NOISE METHODS AND PROCEDURES.....	27
6.1 FHWA Traffic Noise Prediction Model	27
6.2 Off-Site Traffic Noise Prediction Model Inputs	27
7 OFF-SITE TRAFFIC NOISE ANALYSIS.....	31
7.1 Traffic Noise Contours	31
7.2 Off-Site Truck Traffic	31
7.2 Existing Project Noise Level Increases	33
7.3 OYC (2027) Project Traffic Noise Level Increases	33

8	RECEIVER LOCATIONS.....	35
9	OPERATIONAL NOISE IMPACTS	37
9.1	Operational Noise Sources.....	37
9.2	Reference Noise Levels	37
9.3	CadnaA Noise Prediction Model	41
9.4	Project Operational Noise Levels	41
9.5	Project Operational Noise Level Compliance.....	42
9.6	Project Operational Noise Level Increases	43
10	CONSTRUCTION IMPACTS.....	45
10.1	Construction Noise Levels.....	45
10.2	Construction Reference Noise Levels	45
10.3	Construction Noise Analysis.....	47
10.4	Off-Site Roadway and Lift Station Construction Noise Analysis	51
10.5	Nighttime Concrete Pour Noise Analysis	52
10.6	Construction Vibration Analysis.....	53
11	REFERENCES.....	55
12	CERTIFICATION.....	57

APPENDICES

APPENDIX 3.1: CITY OF LAKE ELSINORE MUNICIPAL CODE
APPENDIX 5.1: STUDY AREA PHOTOS
APPENDIX 5.2: NOISE LEVEL MEASUREMENT WORKSHEETS
APPENDIX 7.1: OFF-SITE TRAFFIC NOISE CALCULATIONS
APPENDIX 9.1: OPERATIONAL NOISE MODEL CALCULATIONS
APPENDIX 10.1: MOBILE CONSTRUCTION NOISE MODEL CALCULATIONS
APPENDIX 10.2: STATIONARY CONSTRUCTION NOISE MODEL CALCULATIONS
APPENDIX 10.3: OFF-SITE CONSTRUCTION NOISE MODEL CALCULATIONS
APPENDIX 10.4: NIGHTTIME CONCRETE POUR NOISE MODEL CALCULATIONS

LIST OF EXHIBITS

EXHIBIT 1-A: LOCATION MAP.....	5
EXHIBIT 1-B: PRELIMINARY SITE PLAN.....	6
EXHIBIT 2-A: TYPICAL NOISE LEVELS	7
EXHIBIT 2-B: NOISE LEVEL INCREASE PERCEPTION	10
EXHIBIT 2-C: TYPICAL LEVELS OF GROUND-BORNE VIBRATION.....	12
EXHIBIT 3-A: NOISE AND LAND USE COMPATIBILITY MATRIX.....	14
EXHIBIT 5-A: NOISE MEASUREMENT LOCATIONS.....	25
EXHIBIT 8-A: RECEIVER LOCATIONS	36
EXHIBIT 9-A: OPERATIONAL NOISE SOURCE LOCATIONS	38
EXHIBIT 10-A: CONSTRUCTION NOISE SOURCE LOCATIONS.....	46

LIST OF TABLES

TABLE ES-1: SUMMARY OF CEQA SIGNIFICANCE FINDINGS	1
TABLE 3-1: OPERATIONAL EXTERIOR NOISE LEVEL STANDARDS	16
TABLE 3-2: MOBILE EQUIPMENT NOISE LEVEL LIMITS	17
TABLE 3-3: STATIONARY EQUIPMENT NOISE LEVEL LIMITS	17
TABLE 4-1: SIGNIFICANCE CRITERIA SUMMARY	22
TABLE 5-1: AMBIENT NOISE LEVEL MEASUREMENTS	24
TABLE 6-1: OFF-SITE ROADWAY PARAMETERS	28
TABLE 6-2: AVERAGE DAILY TRAFFIC VOLUMES	28
TABLE 6-3: TIME OF DAY VEHICLE SPLITS	29
TABLE 6-4: EXISTING WITH PROJECT VEHICLE MIX	29
TABLE 6-5: OYCP (2027) WITH PROJECT VEHICLE MIX	29
TABLE 7-1: EXISTING WITHOUT PROJECT CONTOURS	32
TABLE 7-2: EXISTING WITH PROJECT NOISE CONTOURS	32
TABLE 7-3: OYC (2027) WITHOUT PROJECT NOISE CONTOURS	32
TABLE 7-4: OYCP (2027) WITH PROJECT CONTOURS	33
TABLE 7-5: EXISTING WITH PROJECT TRAFFIC NOISE LEVEL INCREASES	34
TABLE 7-6: OYCP (2027) WITH PROJECT TRAFFIC NOISE LEVEL INCREASES	34
TABLE 9-1: REFERENCE NOISE LEVEL MEASUREMENTS	39
TABLE 9-2: DAYTIME PROJECT OPERATIONAL NOISE LEVELS	42
TABLE 9-3: NIGHTTIME PROJECT OPERATIONAL NOISE LEVELS	42
TABLE 9-4: OPERATIONAL NOISE LEVEL COMPLIANCE	43
TABLE 9-5: DAYTIME PROJECT OPERATIONAL NOISE LEVEL INCREASES	44
TABLE 9-6: NIGHTTIME OPERATIONAL NOISE LEVEL INCREASES	44
TABLE 10-1: CONSTRUCTION REFERENCE NOISE LEVELS	47
TABLE 10-2: MOBILE CONSTRUCTION EQUIPMENT SUMMARY	48
TABLE 10-3: MOBILE CONSTRUCTION NOISE LEVEL COMPLIANCE	48
TABLE 10-4: MOBILE CONSTRUCTION NOISE LEVEL INCREASES	49
TABLE 10-5: STATIONARY CONSTRUCTION EQUIPMENT SUMMARY	50
TABLE 10-6: STATIONARY CONSTRUCTION NOISE LEVEL COMPLIANCE	50
TABLE 10-7: STATIONARY CONSTRUCTION NOISE LEVEL INCREASES	51
TABLE 10-8: OFF-SITE CONSTRUCTION NOISE ANALYSIS	52
TABLE 10-9: NIGHTTIME CONCRETE POUR NOISE LEVEL COMPLIANCE	53
TABLE 10-10: VIBRATION SOURCE LEVELS FOR CONSTRUCTION EQUIPMENT	54
TABLE 10-11: PROJECT CONSTRUCTION VIBRATION LEVELS	54

LIST OF ABBREVIATED TERMS

(1)	Reference
ADT	Average Daily Traffic
ANSI	American National Standards Institute
Calveno	California Vehicle Noise
CEQA	California Environmental Quality Act
CNEL	Community Noise Equivalent Level
dBA	A-weighted decibels
EIR	Environmental Impact Report
EPA	Environmental Protection Agency
FHWA	Federal Highway Administration
FTA	Federal Transit Administration
INCE	Institute of Noise Control Engineering
LEMC	City of Lake Elsinore Municipal Code
L_{eq}	Equivalent continuous (average) sound level
L_{max}	Maximum level measured over the time interval
mph	Miles per hour
OPR	Office of Planning and Research
PPV	Peak Particle Velocity
Project	Baker Lake Elsinore
REMEL	Reference Energy Mean Emission Level
RMS	Root-mean-square
VdB	Vibration Decibels

EXECUTIVE SUMMARY

Urban Crossroads, Inc. has prepared this Noise and Vibration Analysis to determine the potential noise and vibration impacts and the necessary mitigation measures, if any, for the Baker Lake Elsinore (“Project”). The Project will consist of constructing two new warehouse buildings and related onsite improvements on the 65.81-acres site within the City of Lake Elsinore. This noise and vibration analysis has been prepared to satisfy applicable City of Lake Elsinore standards and thresholds of significance based on guidance provided by Appendix G of the Guidelines for Implementation of the California Environmental Quality Act (State CEQA Guidelines). (1)

The results of this Noise and Vibration Analysis are summarized below based on the significance criteria in Section 4 of this report consistent with Appendix G of the California Environmental Quality Act (CEQA) Guidelines. (1) Table ES-1 shows the findings of significance for each potential noise and/or vibration impact under CEQA before and after any required mitigation measures.

TABLE ES-1: SUMMARY OF CEQA SIGNIFICANCE FINDINGS

Analysis	Report Section	Significance Findings	
		Unmitigated	Mitigated
Off-Site Traffic Noise	7	<i>Less Than Significant</i>	-
Operational Noise	9	<i>Less Than Significant</i>	-
Construction Noise	10	<i>Less Than Significant</i>	-
Construction Vibration		<i>Less Than Significant</i>	-

This page intentionally left blank

1 INTRODUCTION

This Noise and Vibration Analysis has been completed to determine the noise impacts associated with the development of the Baker Lake Elsinore (“Project”). This noise and vibration analysis briefly describes the Project, provides information regarding noise fundamentals, sets out the local regulatory setting, presents the study methods and procedures for noise analysis, evaluates the future exterior noise environment, potential off-site traffic impacts, the Project-related long-term stationary-source operational noise, and Project-related short-term construction noise and vibration impacts.

1.1 SITE LOCATION

The Project is located southeast of Pierce and Baker Street in the City of Lake Elsinore as shown on Exhibit 1-A.

1.2 PROJECT DESCRIPTION

The Project will consist of constructing two new warehouse buildings and related onsite improvements on the 65.81-acres site. The 33.65 acres of land opposite the industrial development will be used for future restoration activities. A preliminary site plan for the proposed Project is shown on Exhibit 1-B. The Project will consist of two new warehouse buildings totaling a combined 1,000,451 SF¹. Building 1 will be 212,028 SF, inclusive of 5,000 SF of ground floor office, 5,000 SF of mezzanine, and include 23 dock doors along the southwest side of the building. Building 2 will be 788,423 SF inclusive of 10,000 SF of ground floor office, 10,000 SF of mezzanine, and include 110 dock doors along the northeast side of the building. Building 1 will be located at the northwestern end of the site and Building 2 will be located at the southeastern end of the site. Additionally, the Project will include 888,930 SF of landscaping area, 406 parking stalls, and 399 trailer parking stalls. Construction of the proposed Project is expected to begin in April 2026 and last through August 2027 over a duration of 16 months, with an anticipated Opening Year of 2027. Grading activities will require 50,000 cubic yards of export for earthwork activities.

To support the Project development, off-site improvements will be limited to Baker Street and Nichols Street, the Baker Street realignment to Nichols Street, and include improvements from Pierce Street to Hoff Avenue southwest of the site. There will be lift station improvements to the temporary lift station at the intersection of Pierce Street and Nichols Street. Additionally, installation of approximately 7,650 feet of 16-inch force main is anticipated at Nichols Road and Collier Avenue to a discharge manhole at the intersection of Collier Avenue and Riverside Drive. Construction of the off-site/lift station improvements is expected to begin in August 2025 and last through May 2027 over a duration of 20 months, with an anticipated Opening Year of 2027. Trip characteristics available from the Baker Lake Elsinore Traffic Impact Analysis were utilized in

¹ It should be noted that the TIA report analyzed 90% (900,4059 SF) high-cube cold storage and 10% (100,045 SF) manufacturing. However, given that the high-cube buildings are designed with flexibility to accommodate 10% manufacturing and 10% cold storage uses, the building was analyzed as 80% high cube fulfillment (800,361), 10% manufacturing (100,045 SF), and 10% cold storage (100,451 SF) utilizing the trips disclosed in the TIA report.


this analysis (2). Per the Baker Lake Elsinore Traffic Analysis, the proposed Project is expected to generate approximately 2,385 total trips per day, consisting of 1,400 passenger car trips and 985 truck trips. It should be noted that the TIA report analyzed 90% (900,4059 SF) high-cube cold storage and 10% (100,045 SF) manufacturing. However, given that the high-cube buildings are designed with flexibility to accommodate 10% manufacturing and 10% cold storage uses, the building was analyzed as 80% high cube fulfillment (800,361), 10% manufacturing (100,045 SF), and 10% cold storage (100,451 SF) utilizing the trips disclosed in the TIA report. As such, the high cube fulfillment warehouse land use was analyzed utilizing the cold storage ITE trip rates and vehicle class from the TIA.

The on-site Project-related noise sources are expected to include: loading dock activity, tractor trailer storage activity, parking lot vehicle activities, roof-top air conditioning units, trash enclosure activity and truck movements. This Noise and Vibration Analysis is intended to describe noise level impacts associated with the expected typical operational activities at the Project site. To present a conservative approach, this report assumes the Project would operate 24-hours daily for seven days per week.

EXHIBIT 1-A: LOCATION MAP



EXHIBIT 1-B: PRELIMINARY SITE PLAN

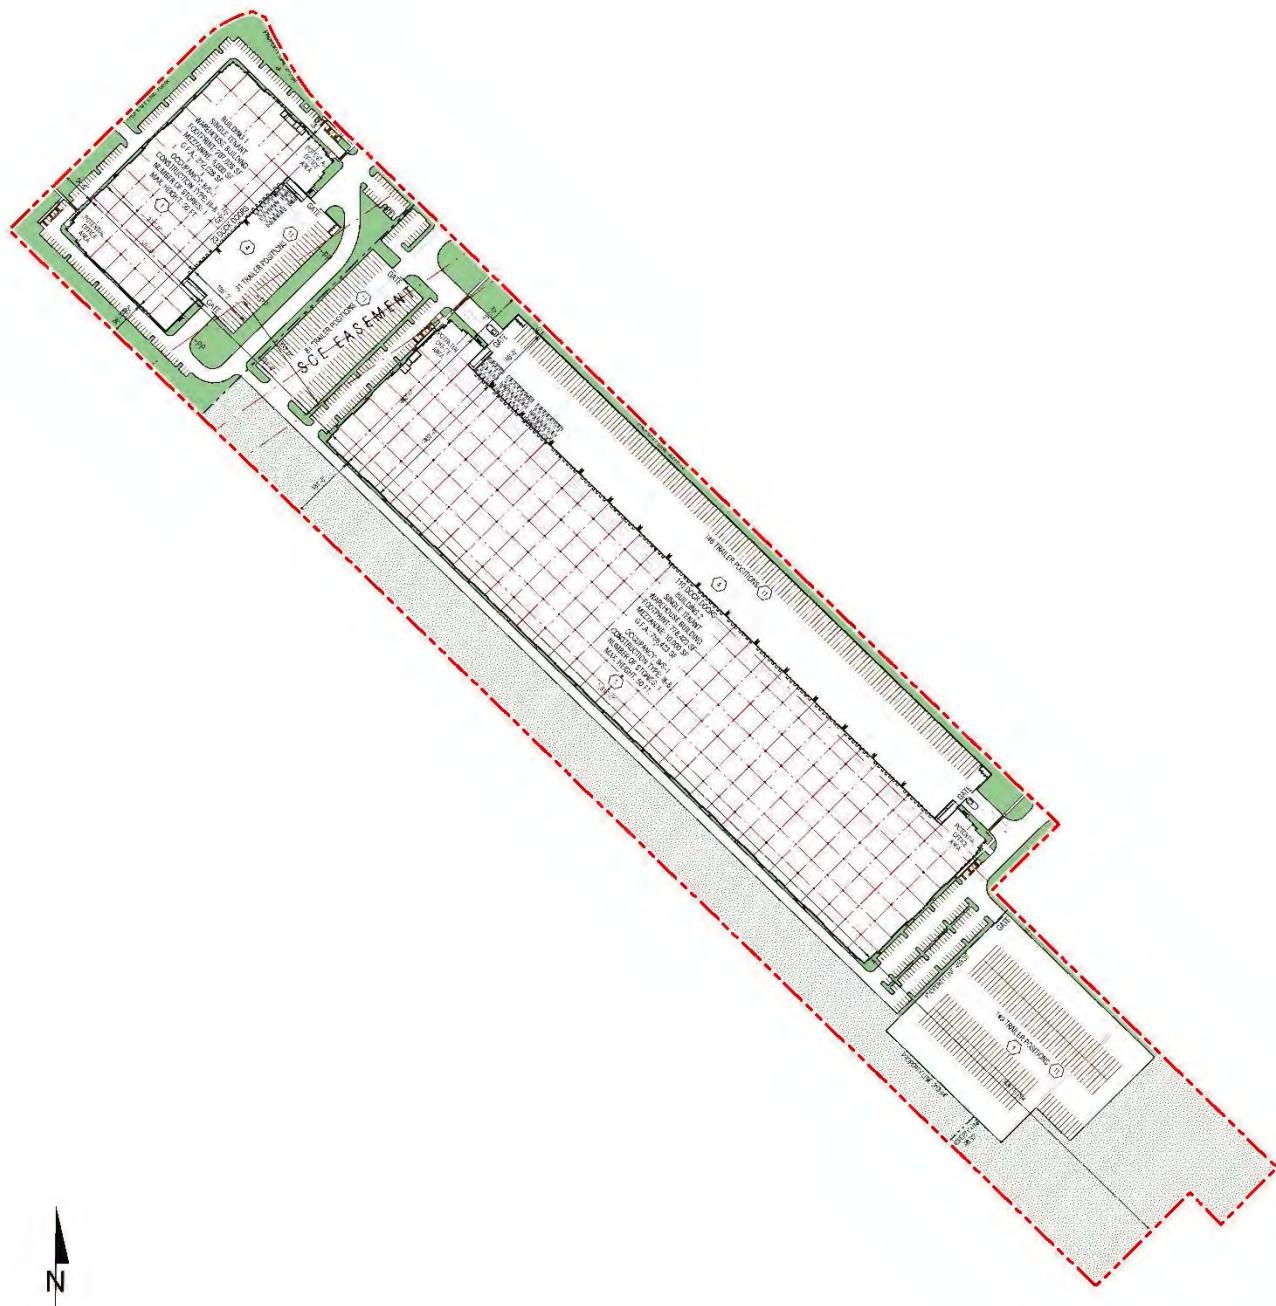

2 FUNDAMENTALS

Noise is simply defined as "unwanted sound." Sound becomes unwanted when it interferes with normal activities, when it causes actual physical harm, or when it has adverse effects on health. Noise is measured on a logarithmic scale of sound pressure level known as a decibel (dB). A-weighted decibels (dBA) approximate the subjective response of the human ear to broad frequency noise source by discriminating against very low and very high frequencies of the audible spectrum. They are adjusted to reflect only those frequencies which are audible to the human ear. Exhibit 2-A presents a summary of the typical noise levels and their subjective loudness and effects that are described in more detail below.

EXHIBIT 2-A: TYPICAL NOISE LEVELS

COMMON OUTDOOR ACTIVITIES	COMMON INDOOR ACTIVITIES	A - WEIGHTED SOUND LEVEL dBA	SUBJECTIVE LOUDNESS	EFFECTS OF NOISE
THRESHOLD OF PAIN		140	INTOLERABLE OR DEAFENING	HEARING LOSS
NEAR JET ENGINE		130		
		120		
JET FLY-OVER AT 300m (1000 ft)	ROCK BAND	110		
LOUD AUTO HORN		100	VERY NOISY	SPEECH INTERFERENCE
GAS LAWN MOWER AT 1m (3 ft)		90		
DIESEL TRUCK AT 15m (50 ft), at 80 km/hr (50 mph)	FOOD BLENDER AT 1m (3 ft)	80		
NOISY URBAN AREA, DAYTIME	VACUUM CLEANER AT 3m (10 ft)	70	LOUD	SLEEP DISTURBANCE
HEAVY TRAFFIC AT 90m (300 ft)	NORMAL SPEECH AT 1m (3 ft)	60		
QUIET URBAN DAYTIME	LARGE BUSINESS OFFICE	50	MODERATE	NO EFFECT
QUIET URBAN NIGHTTIME	THEATER, LARGE CONFERENCE ROOM (BACKGROUND)	40		
QUIET SUBURBAN NIGHTTIME	LIBRARY	30	FAINT	
QUIET RURAL NIGHTTIME	BEDROOM AT NIGHT, CONCERT HALL (BACKGROUND)	20		
	BROADCAST/RECORDING STUDIO	10	VERY FAINT	
LOWEST THRESHOLD OF HUMAN HEARING	LOWEST THRESHOLD OF HUMAN HEARING	0		

Source: Environmental Protection Agency Office of Noise Abatement and Control, Information on Levels of Environmental Noise Requisite to Protect Public Health and Welfare with an Adequate Margin of Safety (EPA/ONAC 550/9-74-004) March 1974.

2.1 RANGE OF NOISE

Since the range of intensities that the human ear can detect is so large, the scale frequently used to measure intensity is a scale based on multiples of 10, the logarithmic scale. The scale for measuring intensity is the decibel scale. Each interval of 10 decibels indicates a sound energy ten times greater than before, which is perceived by the human ear as being roughly twice as loud. (3) The most common sounds vary between 40 dBA (very quiet) to 100 dBA (very loud). Normal conversation at three feet is roughly at 60 dBA, while loud jet engine noises equate to 110 dBA

at approximately 1,000 feet, which can cause serious discomfort. (4) Another important aspect of noise is the duration of the sound and the way it is described and distributed in time.

2.2 NOISE DESCRIPTORS

Environmental noise descriptors are generally based on averages, rather than instantaneous, noise levels. The most used metric is the equivalent level (L_{eq}). Equivalent sound levels are not measured directly but are calculated from sound pressure levels typically measured in A-weighted decibels (dBA). The equivalent sound level (L_{eq}) represents a steady state sound level containing the same total energy as a time varying signal over a given sample period and is commonly used to describe the “average” noise levels within the environment.

Peak hour or average noise levels, while useful, do not completely describe a given noise environment. Noise levels lower than peak hour may be disturbing if they occur during times when quiet is most desirable, namely evening and nighttime (sleeping) hours. To account for this, the Community Noise Equivalent Level (CNEL), representing a composite 24-hour noise level is utilized. The CNEL is the weighted average of the intensity of a sound, with corrections for time of day, and averaged over 24 hours. The time-of-day corrections require the addition of 5 decibels to dBA L_{eq} sound levels in the evening from 7:00 p.m. to 10:00 p.m., and the addition of 10 decibels to dBA L_{eq} sound levels at night between 10:00 p.m. and 7:00 a.m. These additions are made to account for the noise sensitive time periods during the evening and night hours when noise can become more intrusive. CNEL does not represent the actual sound level heard at any time, but rather represents the total sound exposure. The City of Lake Elsinore relies on the 24-hour CNEL level to assess land use compatibility with transportation related noise sources.

2.3 SOUND PROPAGATION

When sound propagates over a distance, it changes in level and frequency content. The way noise reduces with distance depends on the following factors.

2.3.1 GEOMETRIC SPREADING

Sound from a localized source (i.e., a stationary point source) propagates uniformly outward in a spherical pattern. The sound level attenuates (or decreases) at a rate of 6 dB for each doubling of distance from a point source. Highways consist of several localized noise sources on a defined path and hence can be treated as a line source, which approximates the effect of several point sources. Noise from a line source propagates outward in a cylindrical pattern, often referred to as cylindrical spreading. Sound levels attenuate at a rate of 3 dB for each doubling of distance from a line source. (3)

2.3.2 GROUND ABSORPTION

The propagation path of noise from a highway to a receiver is usually very close to the ground. Noise attenuation from ground absorption and reflective wave canceling adds to the attenuation associated with geometric spreading. Traditionally, the excess attenuation has also been expressed in terms of attenuation per doubling of distance. This approximation is usually

sufficiently accurate for distances of less than 200 ft. For acoustically hard sites (i.e., sites with a reflective surface between the source and the receiver, such as a parking lot or body of water), no excess ground attenuation is assumed. For acoustically absorptive or soft sites (i.e., those sites with an absorptive ground surface between the source and the receiver such as soft dirt, grass, or scattered bushes and trees), an excess ground attenuation value of 1.5 dB per doubling of distance is normally assumed. When added to the cylindrical spreading, the excess ground attenuation results in an overall drop-off rate of 4.5 dB per doubling of distance from a line source. (5)

2.3.3 ATMOSPHERIC EFFECTS

Receivers located downwind from a source can be exposed to increased noise levels relative to calm conditions, whereas locations upwind can have lowered noise levels. Sound levels can be increased at large distances (e.g., more than 500 feet) due to atmospheric temperature inversion (i.e., increasing temperature with elevation). Other factors such as air temperature, humidity, and turbulence can also have significant effects. (3)

2.3.4 SHIELDING

A large object or barrier in the path between a noise source and a receiver can substantially attenuate noise levels at the receiver. The amount of attenuation provided by shielding depends on the size of the object and the frequency content of the noise source. Shielding by trees and other such vegetation typically only has an “out of sight, out of mind” effect. That is, the perception of noise impact tends to decrease when vegetation blocks the line-of-sight to nearby residents. However, for vegetation to provide a substantial, or even noticeable, noise reduction, the vegetation area must be at least 15 feet in height, 100 feet wide and dense enough to completely obstruct the line-of-sight between the source and the receiver. This size of vegetation may provide up to 5 dBA of noise reduction. The Federal Highway Administration (FHWA) does not consider the planting of vegetation to be a noise abatement measure. (6)

2.4 NOISE CONTROL

Noise control is the process of obtaining an acceptable noise environment for an observation point or receiver by controlling the noise source, transmission path, receiver, or all three. This concept is known as the source-path-receiver concept. In general, noise control measures can be applied to these three elements.

2.5 NOISE BARRIER ATTENUATION

Effective noise barriers can reduce noise levels by 10 to 15 dBA, cutting the loudness of traffic noise in half. A noise barrier is most effective when placed close to the noise source or receiver. Noise barriers, however, do have limitations. For a noise barrier to work, it must block the line-of-sight path of sound from the noise source.

2.6 LAND USE COMPATIBILITY WITH NOISE


Some land uses are more tolerant of noise than others. For example, schools, hospitals, churches, and residences are more sensitive to noise intrusion than are commercial or industrial developments and related activities. As ambient noise levels affect the perceived amenity or livability of a development, so too can the mismanagement of noise impacts impair the economic health and growth potential of a community by reducing the area's desirability as a place to live, shop and work. For this reason, land use compatibility with the noise environment is an important consideration in the planning and design process. The FHWA encourages State and Local government to regulate land development in such a way that noise-sensitive land uses are either prohibited from being located adjacent to a highway, or that the developments are planned, designed, and constructed in such a way that noise impacts are minimized. (7)

2.7 COMMUNITY RESPONSE TO NOISE

Approximately sixteen percent of the population has a very low tolerance for noise and will object to any noise not of their making. Consequently, even in the quietest environment, some complaints may occur. Twenty to thirty percent of the population will not complain even in very severe noise environments. (8 pp. 8-6) Thus, a variety of reactions can be expected from people exposed to any given noise environment.

Surveys have shown that community response to noise varies from no reaction to vigorous action for newly introduced noises averaging from 10 dB below existing to 25 dB above existing. (9) According to research originally published in the Noise Effects Handbook (8), the percentage of high annoyance ranges from approximately 0 percent at 45 dB or less, 10 percent are highly annoyed around 60 dB, and increases rapidly to approximately 70 percent being highly annoyed at approximately 85 dB or greater. Despite this variability in behavior on an individual level, the population can be expected to exhibit the following responses to changes in noise levels as shown on Exhibit 2-B. A change of 3 dBA is considered barely perceptible, and changes of 5 dBA are considered readily perceptible. (5)

EXHIBIT 2-B: NOISE LEVEL INCREASE PERCEPTION

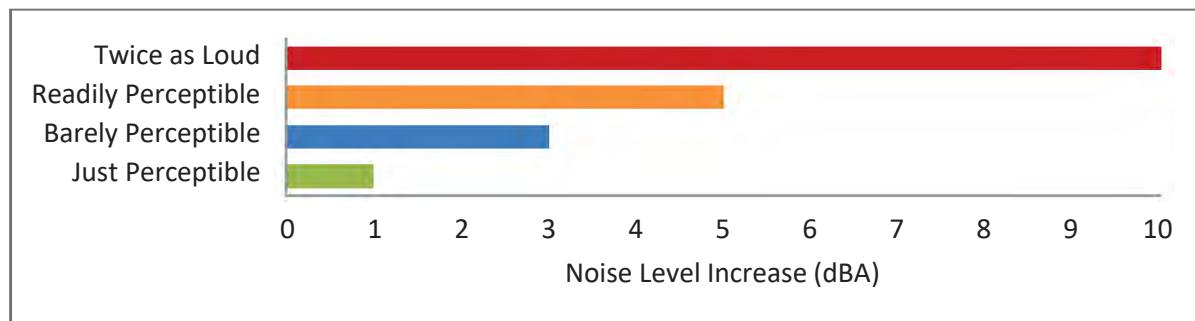


2.8 VIBRATION

Per the Federal Transit Administration (FTA) *Transit Noise and Vibration Impact Assessment Manual*, vibration is the periodic oscillation of a medium or object. The rumbling sound caused by the vibration of room surfaces is called structure-borne noise. Sources of ground-borne vibrations include natural phenomena (e.g., earthquakes, volcanic eruptions, sea waves, landslides) or human-made causes (e.g., explosions, machinery, traffic, trains, construction equipment). Vibration sources may be continuous, such as factory machinery, or transient, such as explosions. As is the case with airborne sound, ground-borne vibrations may be described by amplitude and frequency. Additionally, in contrast to airborne noise, ground-borne vibration outdoors is not a common environmental problem and annoyance from ground-borne vibration is almost exclusively an indoor phenomenon (9). Therefore, the effects of vibrations should only be evaluated at a structure and the effects of the building structure on the vibration should be considered. Wood-frame buildings, such as typical residential structures, are more easily excited by ground vibration than heavier buildings. In contrast, large masonry buildings with spread footings have a low response to ground vibration (9). In general, the heavier a building is, the lower the response will be to the incident vibration energy. However, all structurers reduce vibration levels due to the coupling of the building to the soil.

There are several different methods that are used to quantify vibration. The peak particle velocity (PPV) is defined as the maximum instantaneous peak of the vibration signal (9). The PPV is most frequently used to describe vibration impacts to buildings but is not always suitable for evaluating human response (annoyance) because it takes some time for the human body to respond to vibration signals. Instead, the human body responds to average vibration amplitude often described as the root mean square (RMS). The RMS amplitude is defined as the average of the squared amplitude of the signal and is most frequently used to describe the effect of vibration on the human body (9). However, the RMS amplitude and PPV are related mathematically, and the RMS amplitude of equipment is typically calculated from the PPV reference level. The RMS amplitude is approximately 70% of the PPV (10). Thus, either can be used in the description of vibration impacts.

While not universally accepted, vibration decibel notation (VdB) is another vibration notation developed and used by the FTA in their guidance manual to describe vibration levels and provide a background of common vibration levels and set vibration limits. (9) Decibel notation (VdB) serves to reduce the range of numbers used to describe vibration levels and is used in this report to describe vibration levels. As stated in the FTA guidance manual, the background vibration-velocity level in residential areas is generally 50 VdB. Ground-borne vibration is normally perceptible to humans at approximately 65 VdB. For most people, a vibration-velocity level of 75 VdB is the approximate dividing line between barely perceptible and distinctly perceptible levels. Typical outdoor sources of perceptible ground-borne vibration are construction equipment, steel-wheeled trains, and traffic on rough roads. If a roadway is smooth, the ground-borne vibration is rarely perceptible. The range of interest is from approximately 50 VdB, which is the typical background vibration-velocity level, to 100 VdB, which is the general threshold where minor damage can occur in fragile buildings. Exhibit 2-C illustrates common vibration sources and the human and structural response to ground-borne vibration

EXHIBIT 2-C: TYPICAL LEVELS OF GROUND-BORNE VIBRATION

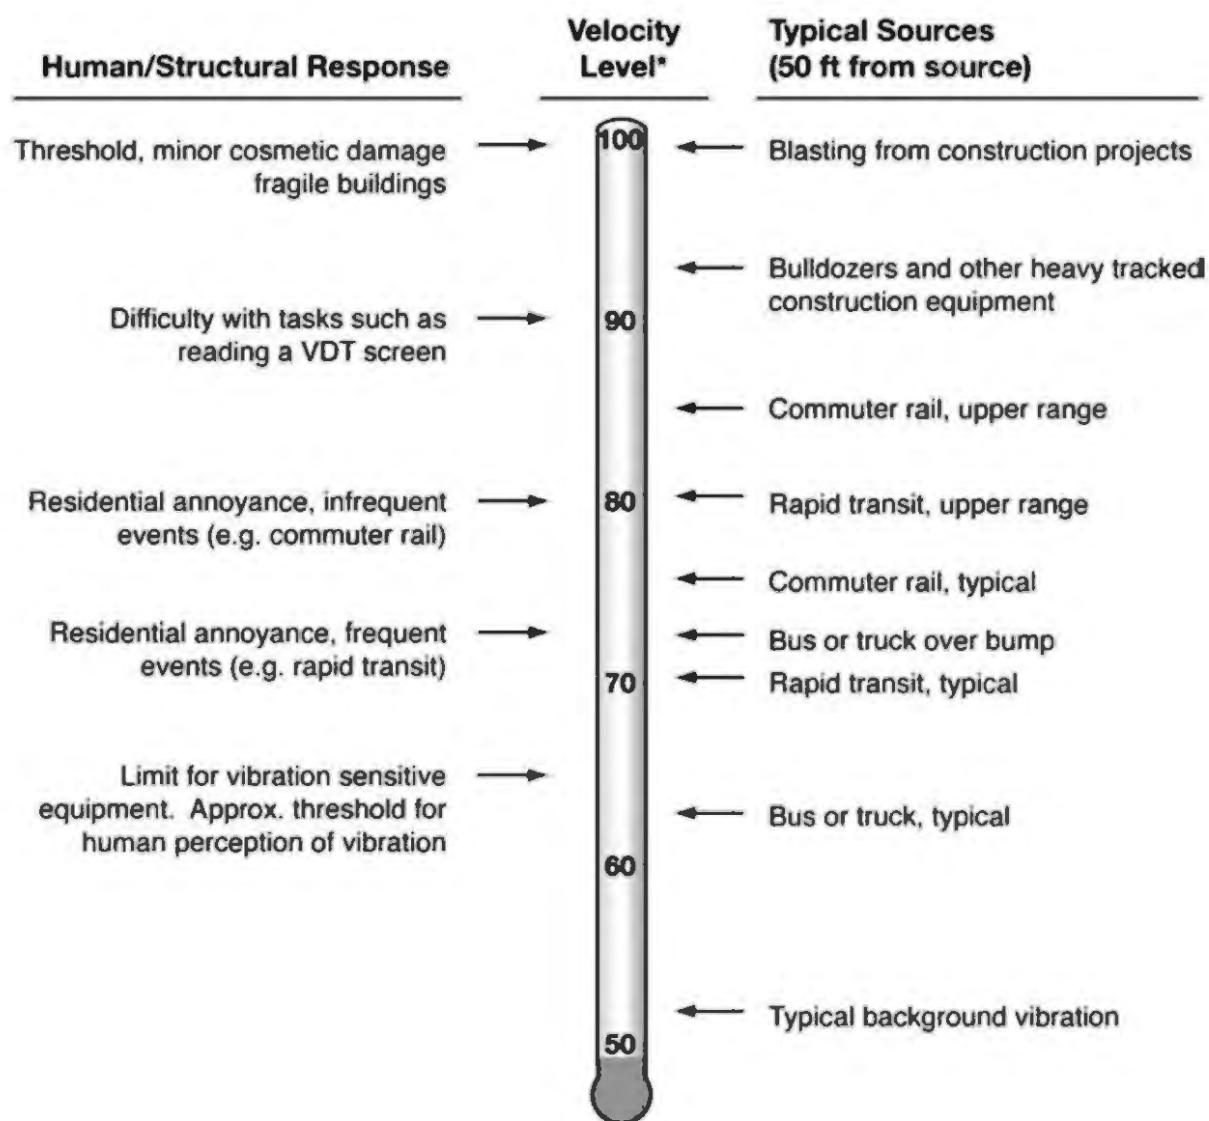

* RMS Vibration Velocity Level in VdB relative to 10^{-6} inches/second

3 REGULATORY SETTING

To limit population exposure to physically and/or psychologically damaging as well as intrusive noise levels, the federal government, the State of California, various county governments, and most municipalities in the state have established standards and ordinances to control noise. In most areas, automobile and truck traffic is the major source of environmental noise. Traffic activity generally produces an average sound level that remains constant with time. Air and rail traffic, and commercial and industrial activities are also major sources of noise in some areas. Federal, state, and local agencies regulate different aspects of environmental noise. Federal and state agencies generally set noise standards for mobile sources such as aircraft and motor vehicles, while regulation of stationary sources is left to local agencies.

3.1 STATE OF CALIFORNIA NOISE REQUIREMENTS

The State of California regulates freeway noise, sets standards for sound transmission, provides occupational noise control criteria, identifies noise standards, and provides guidance for local land use compatibility. State law requires that each county and city adopt a General Plan that includes a Noise Element which is to be prepared per guidelines adopted by the Governor's Office of Planning and Research (OPR). (11) The purpose of the Noise Element is to *limit the exposure of the community to excessive noise levels*. In addition, the California Environmental Quality Act (CEQA) requires that all known environmental effects of a project be analyzed, including environmental noise impacts.

3.2 CITY OF LAKE ELSINORE GENERAL PLAN NOISE ELEMENT

The City of Lake Elsinore has adopted Section 3.7, *Noise*, of the Public Safety and Welfare Element (12) of the General Plan to control and abate environmental noise, and to protect the citizens of Lake Elsinore from excessive exposure to noise. The Noise section specifies the maximum allowable exterior noise levels for new developments impacted by transportation noise sources such as arterial roads, freeways, airports, and railroads. In addition, the Noise section identifies noise policies designed to protect, create, and maintain an environment free from noise that may jeopardize the health or welfare of sensitive receivers, or degrade quality of life. To protect City of Lake Elsinore residents from excessive noise, the Noise section contains the following goal related to the Project:

Goal 7 *Maintain an environment for all City residents and visitors free of unhealthy, obtrusive, or otherwise excessive noise.*

To ensure noise-sensitive land uses are protected from excessive noise levels (Goal 7), the Noise section identifies the following policies:

- 7.1 *Apply the noise standards set forth in the Lake Elsinore Noise and Land Use Compatibility Matrix (see Table 3-1) and Interior and Exterior Noise Standards (see Table 3-2) when considering all new development and redevelopment proposed within the City.*
- 7.2 *Require that mixed-use structures and areas be designed to prevent transfer of noise and vibration from commercial areas to residential areas.*

7.3 Strive to reduce the effect of transportation noise on the I-15.

7.4 Consider estimated roadway noise contours based upon Figure 3.6, Noise Contours, when making land use design decisions along busy roadways throughout the City.

7.5 Participate and cooperate with other agencies and jurisdictions in the development of noise abatement plans for highways.

EXHIBIT 3-A: NOISE AND LAND USE COMPATIBILITY MATRIX

Land Use Categories		Uses	Day-Night Noise Level (LDN)					
Categories			≤55	60	65	70	75	80≥
Residential	Single, Family, Duplex, Multiple Family	A	A	B	B	C	D	D
Residential	Mobile Homes	A	A	B	C	C	D	D
Commercial Regional District	Hotel, Motel, Transient Lodging	A	A	B	B	C	C	D
Commercial Regional Village, District Special	Commercial, Retail, Bank, Restaurant, Movie Theatre	A	A	A	A	B	B	C
Commercial Industrial Institutional	Office Building, Research and Development, Professional Offices, City Office Building	A	A	A	B	B	C	D
Commercial Regional Institutional Civic Center	Amphitheatre, Concert Hall	B	B	C	C	D	D	D
	Auditorium, Meeting Hall							
Commercial Recreation	Children's Amusement Park, Miniature Golf Course, Go-cart Track, Equestrian Center, Sports Club	A	A	A	B	B	D	D
Commercial General, Special Industrial Institutional	Automobile Service Station, Auto Dealership, Manufacturing, Warehousing, Wholesale, Utilities	A	A	A	A	B	B	B
Institutional General	Hospital, Church, Library, Schools, Classroom	A	A	B	C	C	D	D
Open Space	Parks	A	A	A	B	C	D	D
Open Space	Golf Course, Cemeteries, Nature Centers, Wildlife Reserves, Wildlife Habitat	A	A	A	A	B	C	C
Agriculture	Agriculture	A	A	A	A	A	A	A
Interpretation								
Zone A Clearly Compatible	Specified land use is satisfactory, based upon the assumption that any buildings involved are of normal conventional construction without any special noise insulation requirements.							
Zone B Normally Compatible	New construction or development should be undertaken only after detailed analysis of the noise reduction requirements are made and needed noise insulation features in the design are determined. Conventional construction, with closed windows and fresh air supply systems or air conditioning, will normally suffice.							
Zone C Normally Incompatible	New construction or development should generally be discouraged. If new construction or development does proceed, a detailed analysis of noise reduction requirements must be made and needed noise insulation features included in the design.							
Zone D Clearly Incompatible	New construction or development should generally not be undertaken.							

Source: City of Lake Elsinore General Plan, Public Safety and Welfare Element, Table 3-1.

3.2.1 LAND USE COMPATIBILITY GUIDELINES

The *Noise and Land Use Compatibility Matrix* (Table 3-1) in the City of Lake Elsinore General Plan Noise section provides guidelines to evaluate the land use compatibility of transportation related noise. The compatibility criteria, shown on Exhibit 3-A, provides the city with a planning tool to gauge the compatibility of land uses relative to existing and future exterior noise levels.

The *Noise and Land Use Compatibility Matrix* describes categories of compatibility and not specific noise standards. According to these categories of compatibility, the non-noise sensitive commercial/industrial use of the Project is considered *clearly compatible* with unmitigated exterior noise levels of less than 75 dBA CNEL and *normally compatible* with unmitigated exterior noise levels of less than 80 dBA CNEL. The existing noise sensitive residential land use in the Project Study area is considered *clearly compatible* with exterior noise levels below 60 dBA CNEL and *normally compatible* with exterior noise levels below 70 dBA CNEL. For *normally compatible* land use, *new construction or development should be undertaken only after a detailed analysis of noise reduction requirements is made and needed noise insulation features are included in the design. Conventional construction, but with closed windows and fresh air supply systems or air conditioning, will normally suffice.* (12)

3.3 OPERATIONAL NOISE STANDARDS

To analyze noise impacts originating from a designated fixed location or private property such as the Baker Lake Elsinore Project, stationary-source (operational) noise such as loading dock activity, tractor trailer storage activity, parking lot vehicle activities, roof-top air conditioning units, trash enclosure activity and truck movements are typically evaluated against standards established under a City's Municipal Code.

Section 17.176.060 of the City of Lake Elsinore Municipal Code (LEMC) states the following: *No person shall, operate or cause to be operated, any source of sound at any location within the incorporated City or allow the creation of any noise on property owned, leased, occupied, or otherwise controlled by such person which causes the noise level when measured on any other property, either incorporated or unincorporated to exceed...the maximum permissible sound levels by receiving land use.* For residential land use, the Municipal Code identifies base exterior noise level limits for the daytime (7:00 a.m. to 10:00 p.m.) hours of 50 dBA L_{50} and 40 dBA L_{50} during the nighttime (10:00 p.m. to 7:00 a.m.) hours. These standards shall apply for a cumulative period of 30 minutes in any hour (L_{50}), as well as the standard plus 5 dBA cannot be exceeded for a cumulative period of more than 15 minutes in any hour (L_{25}), or the standard plus 10 dBA for a cumulative period of more than 5 minutes in any hour (L_8), or the standard plus 15 dBA for a cumulative period of more than 1 minute in any hour (L_2), or the standard plus 20 dBA for any period of time (L_{max}). (13). In addition, Section 17.176.060[A][3] indicates that if the existing ambient noise level already exceeds any of the exterior noise level limit categories, then the standard shall be adjusted to reflect the ambient conditions. Table 3-1 shows the City of Lake Elsinore noise standards by land use.

TABLE 3-1: OPERATIONAL EXTERIOR NOISE LEVEL STANDARDS

Receiving Land Use	Condition	Based Exterior Noise Level Standards (dBA) ²				
		L ₅₀ (30 mins)	L ₂₅ (15 mins)	L ₈ (5 mins)	L ₂ (1 min)	L _{max} (Anytime)
Single-Family Residential	Daytime	50	55	60	65	70
	Nighttime	40	45	50	55	60
Multi-Family Residential	Daytime	50	55	60	65	70
	Nighttime	45	50	55	60	65
Public Space/ Light Comm.	Daytime	60	65	70	75	80
	Nighttime	55	60	65	70	75
General Commercial	Daytime	65	70	75	80	85
	Nighttime	60	65	70	75	80
Light Industrial	Anytime	70	75	80	85	90
Heavy Industrial	Anytime	75	80	85	90	95

¹ City of Lake Elsinore Municipal Code, Section 17.176.060[A][2] & Table 1 (Appendix 3.1).² "Daytime" = 7:00 a.m. to 10:00 p.m.; "Nighttime" = 10:00 p.m. to 7:00 a.m.

The percentile noise descriptors are provided to ensure that the duration of the noise source is fully considered. However, due to the relatively constant intensity of the Project operational activities, the L₅₀ or average L_{eq} noise level metrics best describe the loading dock activity, tractor trailer storage activity, parking lot vehicle activities, roof-top air conditioning units, trash enclosure activity and truck movements. The L_{eq} noise level metric accounts for noise fluctuations over time by energy averaging louder and quieter events and giving more weight to the louder events. In addition, due to the mathematical relationship between the median (L₅₀) and the mean (L_{eq}), the L_{eq} will always be larger than or equal to the L₅₀. In effect, the more variable the noise becomes, the larger the L_{eq} becomes in comparison to the L₅₀. Therefore, this noise study conservatively relies on the energy average L_{eq} sound level limits to describe the Project operational noise levels.

3.4 CONSTRUCTION NOISE STANDARDS

The City of Lake Elsinore has set hourly restrictions, mobile noise level limits and stationary noise level limits *where technically and economically feasible*, to control noise impacts associated with the construction of the proposed Project. Section 17.176.080[F], Construction/Demolition, indicates that *operating or causing the operation of any tools or equipment used in construction, drilling, repair, alteration, or demolition work between weekday hours of 7:00 p.m. and 7:00 a.m., or at any time on weekends or holidays, such that the sound therefrom creates a noise disturbance across a residential or commercial real property line, except for emergency work of public service utilities or by variance issued by the City.*

Table 3-2 presents a summary of the mobile equipment noise level limits outlined in Section 17.176.080[F]. The mobile equipment noise limits best describe the construction noise activities that are evaluated as multiple moving point sources within the limits of construction since the speed and power of the equipment vary, and the equipment constantly changes position in terms

of its distance and direction relative to the receivers. (9) (14) The mobile equipment noise level limits account for construction activities that frequently shift from one location to another. For example, during site preparation, grading and paving construction stages, noise-generating activities generally involves construction equipment moving back and forth in a predictable pattern throughout the site.

TABLE 3-2: MOBILE EQUIPMENT NOISE LEVEL LIMITS

Type	Receiving Land Use Category	Time Period	Maximum Noise Levels (dBA L _{eq}) ¹
I	Single-Family Residential	Daytime (7:00 a.m. - 7:00 p.m.)	75
		Nighttime (7:00 p.m. - 7:00 a.m.)	60
II	Multi-Family Residential	Daytime (7:00 a.m. - 7:00 p.m.)	80
		Nighttime (7:00 p.m. - 7:00 a.m.)	65
III	Semi-Residential/Commercial	Daytime (7:00 a.m. - 7:00 p.m.)	85
		Nighttime (7:00 p.m. - 7:00 a.m.)	70

¹ Maximum noise levels for nonscheduled, intermittent, short-term operation (less than 10 days) of mobile equipment, City of Lake Elsinore Municipal Code 17.176.080[F] (Appendix 3.1).

However, other stationary construction activities such as building construction and architectural coating work generally concentrate near the building footprint. Table 3-3 presents the construction noise levels when stationary equipment is operating near the building structure.

TABLE 3-3: STATIONARY EQUIPMENT NOISE LEVEL LIMITS

Type	Receiving Land Use Category	Time Period	Maximum Noise Levels (dBA L _{eq}) ¹
I	Single-Family Residential	Daytime (7:00 a.m. - 7:00 p.m.)	60
		Nighttime (7:00 p.m. - 7:00 a.m.)	50
II	Multi-Family Residential	Daytime (7:00 a.m. - 7:00 p.m.)	65
		Nighttime (7:00 p.m. - 7:00 a.m.)	55
III	Semi-Residential/Commercial	Daytime (7:00 a.m. - 7:00 p.m.)	70
		Nighttime (7:00 p.m. - 7:00 a.m.)	60

¹ Maximum noise levels for repetitively scheduled and relatively long-term operation (period of 10 days or more) of stationary equipment, City of Lake Elsinore Municipal Code 17.176.080[F] (Appendix 3.1).

3.5 CONSTRUCTION VIBRATION STANDARDS

Construction activity can result in varying degrees of ground-borne vibration, depending on the equipment and methods used, distance to the affected structures and soil type. Construction vibration is generally associated with pile driving and rock blasting. Other construction equipment such as air compressors, light trucks, hydraulic loaders, etc., generates little or no ground vibration. (9) To analyze vibration impacts originating from the operation and construction of the Project, vibration-generating activities are appropriately evaluated against standards established under the Municipal Code.

The LEMC Section 17.176.080[G], states that *operating or permitting the operation of any device that creates a vibration which is above the vibration perception threshold of an individual at or beyond the property boundary of the source if on private property or at one hundred fifty (150) feet (46 meters) from the source if on a public space or public right-of-way*. LEMC 17.176.020 defines the vibration perception threshold to be a motion velocity of 0.01 RMS inches per second (in/sec) over the range of one to 100 Hz. An RMS of 0.01 in/sec is equivalent to a peak particle velocity (PPV) level of 0.04 in/sec.

3.6 CITY OF LAKE ELSINORE GOOD NEIGHBOR POLICY

On April 25, 2023, the City of Lake Elsinore adopted the Good Neighbor Policy for Warehousing, Logistics, and Distribution Uses. The policy provides a framework for larger-scale warehousing, logistics and distribution projects to be designed and operated to mitigate negative impacts on sensitive receptors and the environment and to preserve and advance the City Council's vision as set forth in the City's General Plan and Dream Extreme 2040 Plan. The policy is meant to apply Best Management Practices ("BMPs") to help minimize potential impacts to sensitive receptors and will be used in addition to applicable requirements of the City's Zoning Code and the California Environmental Quality Act (CEQA). In addition, to the more restrictive operational noise standards outlined in Table 3-1, Policy 12 states that *at no time during normal business hours shall the noise generated from the adjacent industrial operation exceed 65 dBA as measured from the closest property line of a sensitive receptor*.

4 SIGNIFICANCE CRITERIA

The following significance criteria are based on currently adopted guidance provided by Appendix G of the State CEQA Guidelines. (1) For the purposes of this report, impacts would be potentially significant if the Project results in or causes:

- A. Generation of a substantial temporary or permanent increase in ambient noise levels in the vicinity of the project in excess of standards established in the local general plan or noise ordinance, or applicable standards of other agencies?
- B. Generation of excessive ground-borne vibration or ground-borne noise levels?
- C. For a project located within the vicinity of a private airstrip or an airport land use plan or, where such a plan has not been adopted, within two miles of a public airport or public use airport, would the project expose people residing or working in the project area to excessive noise levels?

4.1 NOISE LEVEL INCREASES (THRESHOLD A)

Noise level increases resulting from the Project are evaluated based on the Appendix G CEQA Guidelines described above at the closest sensitive receiver locations. Under CEQA, consideration must be given to the magnitude of the increase, the existing baseline ambient noise levels, and the location of noise-sensitive receivers to determine if a noise increase represents a significant adverse environmental impact. This approach recognizes *that there is no single noise increase that renders a noise impact significant.* (15) This is primarily because of the wide variation in individual thresholds of annoyance and differing individual experiences with noise. Thus, an important way of determining a person's subjective reaction to a new noise is the comparison of it to the existing environment to which one has adapted—the so-called *ambient* environment. In general, the more a new noise level exceeds the previously existing ambient noise level, the less acceptable the new noise level will typically be judged.

Sensitive receivers are areas where humans are participating in activities that may be subject to the stress of significant interference from noise and often include residential dwellings, mobile homes, hotels, motels, hospitals, nursing homes, educational facilities, and libraries. Other receivers include office and industrial buildings, which are not considered as sensitive as single-family homes, but are still protected by the City of Lake Elsinore land use compatibility standards, as discussed below.

4.1.1 NOISE-SENSITIVE RECEIVERS (SUBSTANTIAL PERMANENT NOISE LEVEL INCREASE)

The Federal Interagency Committee on Noise (FICON) (16) developed guidance to be used for the assessment of project-generated increases in noise levels that consider the ambient noise level. The FICON recommendations are based on studies that relate aircraft noise levels to the percentage of persons highly annoyed by aircraft noise. Although the FICON recommendations were specifically developed to assess aircraft noise impacts, these recommendations are often used in environmental noise impact assessments involving the use of cumulative noise exposure metrics, such as the average-daily noise level (CNEL) and equivalent continuous noise level (L_{eq}).

As previously stated, the approach used in this noise study recognizes *that there is no single noise increase that renders a noise impact significant*, based on a 2008 California Court of Appeal ruling on *Gray v. County of Madera*. (15) For example, if the ambient noise environment is quiet (<60 dBA) and the new noise source greatly increases the noise levels, an impact may occur if the noise criteria may be exceeded. Therefore, for this analysis, a *readily perceptible* 5 dBA or greater project-related noise level increase is considered a significant impact when the without project noise levels are below 60 dBA. Per the FICON, in areas where the without project noise levels range from 60 to 65 dBA, a 3 dBA *barely perceptible* noise level increase appears to be appropriate for most people. When the without project noise levels already exceed 65 dBA, any increase in community noise louder than 1.5 dBA or greater is considered a significant impact if the noise criteria for a given land use is exceeded, since it likely contributes to an existing noise exposure exceedance.

The FICON guidance provides an established source of criteria to assess the impacts of substantial temporary or permanent increase in baseline ambient noise levels. Based on the FICON criteria, the amount to which a given noise level increase is considered acceptable is reduced when the without Project (baseline) noise levels are already shown to exceed certain land-use specific exterior noise level criteria. The specific levels are based on typical responses to noise level increases of 5 dBA or *readily perceptible*, 3 dBA or *barely perceptible*, and 1.5 dBA depending on the underlying without Project noise levels for noise-sensitive uses. These levels of increases and their perceived acceptance at noise sensitive receiver locations are consistent with guidance provided by both the Federal Highway Administration (5 p. 9) and Caltrans (3 p. 2_44). An off-site traffic or operational noise increase exceeding the FICON criteria at noise sensitive receiver locations is considered a substantial noise increase representing a potentially significant noise impact.

4.1.2 NON-NOISE-SENSITIVE RECEIVERS (SUBSTANTIAL PERMANENT NOISE LEVEL INCREASE)

The City of Lake Elsinore General Plan Noise Element, *Noise and Land Use Compatibility Matrix* was used to establish the satisfactory noise levels of significance for non-noise-sensitive land uses in the Project study area. As previously shown on Exhibit 3-A, the *normally compatible* exterior noise level for non-noise-sensitive commercial/industrial land uses is 75 dBA CNEL. To determine if Project-related traffic noise increases are significant at off-site non-noise-sensitive land uses, a *barely perceptible* 3 dBA criteria is used. When the without Project noise levels are greater than the *completely compatible* 75 dBA CNEL land use compatibility criteria, a *barely perceptible* 3 dBA or greater noise level increase is considered a significant impact since the noise level criteria is already exceeded. The noise level increases used to determine significant impacts for non-noise-sensitive land uses is generally consistent with the FICON noise level increase thresholds for noise-sensitive land uses but instead rely on the City of Lake Elsinore General Plan, *Noise and Land Use Compatibility Matrix* *clearly compatible* 75 dBA CNEL exterior noise level criteria.

4.1.3 CONSTRUCTION NOISE (SUBSTANTIAL TEMPORARY NOISE INCREASE)

To control the noise-generating construction activities, the temporary noise level increases over the existing ambient conditions must be considered under CEQA Significance Threshold A. Therefore, the Caltrans Traffic Noise Analysis Protocol 12 dBA Leq substantial noise level increase threshold is used in this analysis to assess temporary noise level increases. (17) In California a substantial noise increase is considered to occur when the project's predicted noise level exceeds the existing noise level by 12 dBA or more. The use of 12 dB was established in California many years ago and is based on the concept that a 10 dB increase generally is perceived as a doubling of loudness. (3 pp. 3-2) Therefore, if the Project-related construction noise levels generate a temporary noise level increase above the existing ambient noise levels of up to 12 dBA Leq, then the Project construction noise level increases will be considered a potentially significant impact.

4.2 VIBRATION (THRESHOLD B)

As described in Section 3.5, the vibration generating activities originating from the construction of Baker Lake Elsinore, vibration-generating activities are appropriately evaluated using a peak particle velocity (PPV) level of 0.04 in/sec.

4.3 CEQA GUIDELINES NOT FURTHER ANALYZED (THRESHOLD C)

The Project site is not located within two miles of a public airport or within an airport land use plan impacting the proposed development. The nearest public airport is the privately operated Skylark Field supporting the skydiving operations located over five miles southeast of the Project site on Cereal Street just west of Corydon Road. As such, the Project site would not be exposed to excessive noise levels from airport operations, and therefore, impacts are considered *less than significant*, and no further noise analysis is conducted in relation to Threshold C.

4.4 SIGNIFICANCE CRITERIA SUMMARY

Noise impacts shall be considered significant if any of the following occur as a direct result of the proposed development. Table 4-1 shows the significance criteria summary matrix that includes the allowable criteria used to identify potentially significant incremental noise level increases.

TABLE 4-1: SIGNIFICANCE CRITERIA SUMMARY

Analysis	Receiving Land Use	Condition(s)	Significance Criteria	
			Daytime	Nighttime
Off-Site Traffic	Noise-Sensitive	If ambient is < 60 dBA CNEL ¹	≥ 5 dBA CNEL Project increase	
		If ambient is 60 - 65 dBA CNEL ¹	≥ 3 dBA CNEL Project increase	
		If ambient is > 65 dBA CNEL ¹	≥ 1.5 dBA CNEL Project increase	
	Non-Noise-Sensitive	If ambient is > 75 dBA CNEL ²	≥ 3 dBA CNEL Project increase	
Operational	Noise-Sensitive	Exterior Noise Level Standards ³	See Table 3-1	
		If ambient is < 60 dBA L _{eq} ¹	≥ 5 dBA L _{eq} Project increase	
		If ambient is 60 - 65 dBA L _{eq} ¹	≥ 3 dBA L _{eq} Project increase	
		If ambient is > 65 dBA L _{eq} ¹	≥ 1.5 dBA L _{eq} Project increase	
Construction	Noise-Sensitive	Noise Level Thresholds ⁴	See Tables 3-2 & 3-3	
		Exterior Noise Level Increase ⁵	12 dBA L _{eq}	
		Vibration Level Threshold ⁶	0.04 PPV (in/sec)	

¹FICON, 1992.²Section 3.7, Noise, of the Public Safety and Welfare Element Noise and Land Use Compatibility Matrix (Exhibit 3-A)³City of Lake Elsinore Municipal Code, Section 17.176.060[A][2] & Table 1 (Appendix 3.1).⁴City of Lake Elsinore Municipal Code, Section 17.176.080[F], (Appendix 3.1)⁵Caltrans Traffic Noise Analysis Protocol, April 2020.⁶City of Lake Elsinore Municipal Code, Section 17.176.080[G], (Appendix 3.1)

Operational: "Daytime" = 7:00 a.m. to 10:00 p.m.; "Nighttime" = 10:00 p.m. to 7:00 a.m. (17.176.060[A][2] & Table 1)

Construction: "Daytime" = 7:00 a.m. to 7:00 p.m.; "Nighttime" = 7:00 p.m. to 7:00 a.m. (17.176.080[G])

5 EXISTING NOISE LEVEL MEASUREMENTS

To assess the existing noise level environment, 24-hour noise level measurements were taken at six locations in the Project study area. The noise level measurement locations were selected to describe and document the existing noise environment within the Project study area. Exhibit 5-A provides the boundaries of the Project study area and the noise level measurement locations. To fully describe the existing noise conditions, noise level measurements were collected by Urban Crossroads, Inc. on Tuesday, June 25, 2024. Appendix 5.1 includes study area photos.

5.1 MEASUREMENT PROCEDURE AND CRITERIA

To describe the existing noise environment, the hourly noise levels were measured during typical weekday conditions over a 24-hour period. By collecting individual hourly noise level measurements, it is possible to describe the equivalent daytime and nighttime hourly noise levels and calculate the 24-hour CNEL. The long-term noise readings were recorded using Piccolo Type 2 integrating sound level meter and dataloggers. The Piccolo sound level meters were calibrated using a Larson-Davis calibrator, Model CAL 150. All noise meters were programmed in "slow" mode to record noise levels in "A" weighted form. The sound level meters and microphones were equipped with a windscreen during all measurements. All noise level measurement equipment satisfies the American National Standards Institute (ANSI) standard specifications for sound level meters ANSI S1.4-2014/IEC 61672-1:2013. (18)

5.2 NOISE MEASUREMENT LOCATIONS

The long-term noise level measurements were positioned as close to the nearest sensitive receiver locations as possible to assess the existing ambient hourly noise levels surrounding the Project site. Both Caltrans and the FTA recognize that it is not reasonable to collect noise level measurements that can fully represent every part of a private yard, patio, deck, or balcony normally used for human activity when estimating impacts for new development projects. This is demonstrated in the Caltrans general site location guidelines which indicate that *sites must be free of noise contamination by sources other than sources of interest. Avoid sites located near sources such as barking dogs, lawnmowers, pool pumps, and air conditioners unless it is the express intent of the analyst to measure these sources.* (3) Further, FTA guidance states, *that it is not necessary nor recommended that existing noise exposure be determined by measuring at every noise-sensitive location in the project area. Rather, the recommended approach is to characterize the noise environment for clusters of sites based on measurements or estimates at representative locations in the community.* (9)

Based on recommendations of Caltrans and the FTA, it is not necessary to collect measurements at each individual building or residence, because each receiver measurement represents a group of buildings that share acoustical equivalence. (9) In other words, the area represented by the receiver shares similar shielding, terrain, and geometric relationship to the reference noise source. Receivers represent a location of noise sensitive areas and are used to estimate the future noise level impacts. Collecting reference ambient noise level measurements at the nearby sensitive receiver locations allows for a comparison of the before and after Project noise levels

and is necessary to assess potential noise impacts due to the Project's contribution to the ambient noise levels.

5.3 NOISE MEASUREMENT RESULTS

The noise measurements presented below focus on the equivalent or the energy average hourly sound levels (L_{eq}). The equivalent sound level (L_{eq}) represents a steady state sound level containing the same total energy as a time varying signal over a given sample period. Table 5-1 identifies the hourly daytime (7:00 a.m. to 10:00 p.m.) and nighttime (10:00 p.m. to 7:00 a.m.) noise levels at each noise level measurement location.

TABLE 5-1: AMBIENT NOISE LEVEL MEASUREMENTS

Location ¹	Description	Energy Average Noise Level (dBA L_{eq}) ²		CNEL
		Daytime	Nighttime	
L1	Located west of the site near the residence at 28750 Pierce St.	52.4	50.3	57.2
L2	Located west of the site near the future residence at Florence Dr.	54.9	48.3	57.0
L3	Located southwest of the site near the residence at 29093 Gunder Av.	51.7	45.0	53.4
L4	Located south of the site near the residence at 16950 Gunnerson St.	57.7	54.0	61.7
L5	Located south of the site near the residence at 17250 Gunnerson St.	55.9	52.5	60.2
L6	Located east of the site near the residence at 17401 Baker St.	52.0	53.9	60.2

¹ See Exhibit 5-A for the noise level measurement locations.

² Energy (logarithmic) average levels. The long-term 24-hour measurement worksheets are included in Appendix 5.2.

"Daytime" = 7:00 a.m. to 10:00 p.m.; "Nighttime" = 10:00 p.m. to 7:00 a.m.

Table 5-1 provides the equivalent noise levels used to describe the daytime and nighttime ambient conditions. These daytime and nighttime energy average noise levels represent the average of all hourly noise levels observed during these time periods expressed as a single number. Appendix 5.2 provides summary worksheets of the noise levels for each hour as well as the minimum, maximum, L_1 , L_2 , L_5 , L_8 , L_{25} , L_{50} , L_{90} , L_{95} , and L_{99} percentile noise levels observed during the daytime and nighttime periods.

EXHIBIT 5-A: NOISE MEASUREMENT LOCATIONS



This page intentionally left blank

6 TRAFFIC NOISE METHODS AND PROCEDURES

The following section outlines the methods and procedures used to estimate and analyze the future traffic noise environment. Consistent with the land use/noise compatibility (see Exhibit 3-A), all transportation-related noise levels are presented in terms of the 24-hour CNEL's. Unlike a simple arithmetic average noise level, CNEL represents the logarithmic summation of the equivalent hourly noise levels with evening and nighttime noise penalties recognizing that noise may have different impacts on people depending on when it occurs.

6.1 FHWA TRAFFIC NOISE PREDICTION MODEL

The expected roadway noise level increases from vehicular traffic were calculated by Urban Crossroads, Inc. using a computer program that replicates the Federal Highway Administration (FHWA) Traffic Noise Prediction Model- FHWA-RD-77-108. (19) This methodology is commonly used to describe the off-site traffic noise levels throughout southern California. The FHWA Model arrives at a predicted noise level through a series of adjustments to the Reference Energy Mean Emission Level (REMETL) by vehicle type. REMETL represents the maximum sound level (L_{max}) of individual vehicle "pass by" events by vehicle type when measured at a "reference distance" of 50 feet from the center of the travel lane.

In California the national REMETLs are substituted with the California Vehicle Noise (Calveno) Emission Levels. (20) Adjustments are then made to the REMETL to account for: the roadway classification (e.g., collector, secondary, major or arterial), the roadway active width (i.e., the distance between the center of the outermost travel lanes on each side of the roadway), the total average daily traffic (ADT), the travel speed, the percentages of automobiles, medium trucks, and heavy trucks in the traffic volume, the roadway grade, the angle of view (e.g., whether the roadway view is blocked), the site conditions ("hard" or "soft" relates to the absorption of the ground, pavement, or landscaping), and the percentage of total ADT which flows each hour throughout a 24-hour period. Research conducted by Caltrans has shown that the use of soft site conditions is appropriate for the application of the FHWA traffic noise prediction model used in this analysis. (21)

6.2 OFF-SITE TRAFFIC NOISE PREDICTION MODEL INPUTS

Table 6-1 presents the roadway parameters used to assess the Project's off-site transportation noise impacts. Table 6-1 identifies the four off-site study area roadway segments, the distance from the centerline to the adjacent land use based on the functional roadway classifications per the City of Lake Elsinore General Plan, and the vehicle speeds. It is expected that the Project related off-site traffic noise level contributions on other roadway segments outside the Project study area will dissipate as traffic disperses on the roadway network. The analysis below provides off-site roadway segment analysis for the following traffic scenarios.

- Existing
- Existing with Project
- Opening Year Cumulative (OYC) (2027) without Project
- Opening Year Cumulative (OYC) (2027) with Project

To describe the Project off-site traffic impacts, the receiving land use adjacent to each roadway segment is identified as a sensitive or non-sensitive land use. Sensitive land uses are limited to the existing noise sensitive residential uses based on a review of aerial imagery. It is expected that only the existing noise sensitive receivers will experience a change in the ambient noise levels over time.

TABLE 6-1: OFF-SITE ROADWAY PARAMETERS

ID	Roadway	Segment	Classification ¹	Receiving Land Use ²	Distance from Centerline to Receiving Land Use (Feet) ³	Vehicle Speed (mph)
1	Nichols Rd.	between Terra Cotta and Baker St.	Major	Non-Sensitive	50'	40
2	Nichols Rd.	between Baker St. and Collier Av.	Major	Non-Sensitive	50'	40
3	Nichols Rd.	between Collier Avenue and 1-15 SB Ramps	Major	Non-Sensitive	50'	40
4	Nichols Rd.	between 1-15 SB Ramps and I-15 NB Ramps	Major	Non-Sensitive	50'	40

¹ City of Chino General Plan Roadway Classifications (Figure 2.3).

² Based on a review of existing aerial imagery. Noise sensitive uses limited to existing residential land uses.

³ Distance to receiving land use is based upon the right-of-way distances.

The ADT volumes used in this study area presented on Table 6-2 are based on *Baker Lake Elsinore Traffic Impact Analysis*, prepared by EPD Solutions, Inc. (2) The ADT volumes vary for each roadway segment based on the existing traffic volumes and the combination of project traffic distributions. To quantify the off-site noise levels, the Project related truck trips (actual trips) were added to the heavy truck category in the FHWA noise prediction model. The addition of the Project related truck trips increases the percentage of heavy trucks in the vehicle mix. This approach recognizes that the FHWA noise prediction model is significantly influenced by the number of heavy trucks in the vehicle mix.

TABLE 6-2: AVERAGE DAILY TRAFFIC VOLUMES

ID	Roadway	Segment	Average Daily Traffic Volumes ¹			
			Existing		OYC (2027)	
			Without Project	With Project	Without Project	With Project
1	Nichols Rd.	between Terra Cotta and Baker St.	10,709	11,067	12,583	12,940
2	Nichols Rd.	between Baker St. and Collier Av.	10,539	12,447	12,402	14,310
3	Nichols Rd.	between Collier Avenue and 1-15 SB Ramps	10,545	12,214	12,318	13,987
4	Nichols Rd.	between 1-15 SB Ramps and I-15 NB Ramps	10,056	11,010	11,799	12,753

¹ Baker Lake Elsinore Traffic Impact Analysis, EPD Solutions, Inc.

Table 6-3 provides the time of day (daytime, evening, and nighttime) vehicle splits. The unadjusted daily Project truck trip-ends were assigned to the individual off-site study area roadway segments based on the Project truck trip distribution percentages documented in the *Baker Lake Elsinore Traffic Analysis*. Table 6-3 presents the traffic flow by vehicle type (vehicle mix) used for all without Project traffic scenarios, and Tables 6-4 to 6-5 show the vehicle mixes used for the with Project traffic scenarios.

TABLE 6-3: TIME OF DAY VEHICLE SPLITS

Time of Day	Vehicle Mix			Time of Day Split
	Autos	Medium Trucks	Heavy Trucks	
Daytime	75.09%	0.13%	2.87%	78.08%
Evening	10.65%	0.01%	0.01%	10.67%
Nighttime	10.28%	0.01%	0.95%	11.24%
Daily	96.02%	0.15%	3.83%	100.00%

¹ Based on the March 5, 2024, 24-hour directional vehicle classification count collected on Nichols Road west of Baker Street.

"Daytime" = 7:00 a.m. to 7:00 p.m.; "Evening" = 7:00 p.m. to 10:00 p.m.; "Nighttime" = 10:00 p.m. to 7:00 a.m.

TABLE 6-4: EXISTING WITH PROJECT VEHICLE MIX

ID	Roadway	Segment	With Project ¹			
			Autos	Medium Trucks	Heavy Trucks	Total ²
1	Nichols Rd.	between Terra Cotta and Baker St.	94.82%	0.58%	4.61%	100.00%
2	Nichols Rd.	between Baker St. and Collier Av.	90.30%	2.17%	7.53%	100.00%
3	Nichols Rd.	between Collier Avenue and 1-15 SB Ramps	90.92%	1.95%	7.13%	100.00%
4	Nichols Rd.	between 1-15 SB Ramps and I-15 NB Ramps	92.79%	1.29%	5.92%	100.00%

¹ Total of vehicle mix percentage values rounded to the nearest one-hundredth.

TABLE 6-5: OYCP (2027) WITH PROJECT VEHICLE MIX

ID	Roadway	Segment	With Project ¹			
			Autos	Medium Trucks	Heavy Trucks	Total ²
1	Nichols Rd.	between Terra Cotta and Baker St.	94.99%	0.51%	4.50%	100.00%
2	Nichols Rd.	between Baker St. and Collier Av.	91.05%	1.91%	7.05%	100.00%
3	Nichols Rd.	between Collier Avenue and 1-15 SB Ramps	91.57%	1.72%	6.71%	100.00%
4	Nichols Rd.	between 1-15 SB Ramps and I-15 NB Ramps	93.23%	1.14%	5.63%	100.00%

¹ Total of vehicle mix percentage values rounded to the nearest one-hundredth.

This page intentionally left blank

7 OFF-SITE TRAFFIC NOISE ANALYSIS

As described in Section 4.1, the off-site traffic noise impacts are evaluated based on noise level increases resulting from the Project. Under CEQA, consideration must be given to the magnitude of the increase, the existing ambient noise levels, and the location of noise-sensitive receivers to determine if a noise increase represents a significant adverse environmental impact. To assess the off-site transportation CNEL noise level impacts associated with development of the Project, noise contours were developed for each of the Project conditions outlined in the *Baker Lake Elsinore Traffic Impact Analysis* prepared by EPD Solutions, Inc. (2)

7.1 TRAFFIC NOISE CONTOURS

Noise contours were used to assess the Project's incremental 24-hour dBA CNEL traffic-related noise impacts at land uses adjacent to roadways conveying Project traffic. The noise contours included in Appendix 7.1 represent the distance to noise levels of a constant value and are measured from the center of the roadway for the 70, 65, and 60 dBA CNEL noise levels. The noise contours do not consider the effect of any existing noise barriers or topography that may attenuate ambient noise levels. In addition, because the noise contours reflect modeling of vehicular noise on area roadways, they appropriately do not include noise contributions from the surrounding stationary noise sources within the Project study area. Tables 7-1 to 7-5 present a summary of the exterior traffic noise levels for each traffic condition.

7.2 OFF-SITE TRUCK TRAFFIC

The noise level calculations included in Appendix 7.1, present the maximum sound levels (L_{max}) of individual "pass by" events (REMEL) by vehicle type for each of the study area roadway segments. To demonstrate compliance with the *Noise and Land Use Compatibility Matrix* (see Exhibit 3-A), all exterior noise levels are first expressed using the equivalent hourly noise levels for the peak, daytime, evening, and nighttime hours. This approach permits the calculation of the 24-hour CNEL necessary to demonstrate compliance with the established thresholds of significance. CNEL is commonly used for planning purposes and to assess changes in the long-term traffic noise exposure in a way that reflects its impact on communities over time, considering both daytime and nighttime periods when people may be more sensitive to noise. Since the CNEL noise levels include penalties for the evening and nighttime hours, the CNEL level will always be higher than any of the equivalent hourly noise levels.

TABLE 7-1: EXISTING WITHOUT PROJECT CONTOURS

ID	Road	Segment	Receiving Land Use ¹	CNEL at Receiving Land Use (dBA) ²	Distance to Contour from Centerline (Feet)		
					70 dBA CNEL	65 dBA CNEL	60 dBA CNEL
1	Nichols Rd.	between Terra Cotta and Baker St.	Non-Sensitive	70.3	52	112	242
2	Nichols Rd.	between Baker St. and Collier Av.	Non-Sensitive	70.2	52	111	240
3	Nichols Rd.	between Collier Avenue and 1-15 SB Ramps	Non-Sensitive	70.2	52	111	240
4	Nichols Rd.	between 1-15 SB Ramps and I-15 NB Ramps	Non-Sensitive	70.0	50	108	232

¹ Based on a review of existing aerial imagery. Noise sensitive uses limited to existing residential land uses.² The CNEL is calculated at the boundary of the right-of-way of the receiving adjacent land use.

"RW" = Location of the respective noise contour falls within the right-of-way of the road.

TABLE 7-2: EXISTING WITH PROJECT NOISE CONTOURS

ID	Road	Segment	Receiving Land Use ¹	CNEL at Receiving Land Use (dBA) ²	Distance to Contour from Centerline (Feet)		
					70 dBA CNEL	65 dBA CNEL	60 dBA CNEL
1	Nichols Rd.	between Terra Cotta and Baker St.	Non-Sensitive	71.1	59	127	273
2	Nichols Rd.	between Baker St. and Collier Av.	Non-Sensitive	73.3	83	180	387
3	Nichols Rd.	between Collier Avenue and 1-15 SB Ramps	Non-Sensitive	73.1	80	172	371
4	Nichols Rd.	between 1-15 SB Ramps and I-15 NB Ramps	Non-Sensitive	71.9	67	145	311

¹ Based on a review of existing aerial imagery. Noise sensitive uses limited to existing residential land uses.² The CNEL is calculated at the boundary of the right-of-way of the receiving adjacent land use.

"RW" = Location of the respective noise contour falls within the right-of-way of the road.

TABLE 7-3: OYC (2027) WITHOUT PROJECT NOISE CONTOURS

ID	Road	Segment	Receiving Land Use ¹	CNEL at Receiving Land Use (dBA) ²	Distance to Contour from Centerline (Feet)		
					70 dBA CNEL	65 dBA CNEL	60 dBA CNEL
1	Nichols Rd.	between Terra Cotta and Baker St.	Non-Sensitive	71.0	58	125	270
2	Nichols Rd.	between Baker St. and Collier Av.	Non-Sensitive	70.9	58	124	267
3	Nichols Rd.	between Collier Avenue and 1-15 SB Ramps	Non-Sensitive	70.9	57	123	266
4	Nichols Rd.	between 1-15 SB Ramps and I-15 NB Ramps	Non-Sensitive	70.7	56	120	258

¹ Based on a review of existing aerial imagery. Noise sensitive uses limited to existing residential land uses.² The CNEL is calculated at the boundary of the right-of-way of the receiving adjacent land use.

"RW" = Location of the respective noise contour falls within the right-of-way of the road.

TABLE 7-4: OYCP (2027) WITH PROJECT CONTOURS

ID	Road	Segment	Receiving Land Use ¹	CNEL at Receiving Land Use (dBA) ²	Distance to Contour from Centerline (Feet)		
					70 dBA CNEL	65 dBA CNEL	60 dBA CNEL
1	Nichols Rd.	between Terra Cotta and Baker St.	Non-Sensitive	71.6	64	139	299
2	Nichols Rd.	between Baker St. and Collier Av.	Non-Sensitive	73.7	88	190	409
3	Nichols Rd.	between Collier Avenue and 1-15 SB Ramps	Non-Sensitive	73.4	84	182	392
4	Nichols Rd.	between 1-15 SB Ramps and I-15 NB Ramps	Non-Sensitive	72.4	72	155	334

¹ Based on a review of existing aerial imagery. Noise sensitive uses limited to existing residential land uses.

² The CNEL is calculated at the boundary of the right-of-way of the receiving adjacent land use.

"RW" = Location of the respective noise contour falls within the right-of-way of the road.

7.2 EXISTING PROJECT NOISE LEVEL INCREASES

An analysis of existing traffic noise levels plus traffic noise generated by the proposed Project has been included in this report to fully analyze all the existing traffic scenarios identified in the *Baker Lake Elsinore Traffic Impact Analysis*. This condition is provided solely for informational purposes and will not occur, since the Project will not be fully developed and occupied under Existing conditions. Table 7-1 shows the Existing without Project conditions CNEL noise levels. The Existing without Project exterior noise levels are expected to range from 70.0 to 70.3 dBA CNEL, without accounting for any noise attenuation features such as noise barriers or topography. Table 7-2 shows the Existing with Project conditions will range from 71.1 to 73.3 dBA CNEL. Table 7-5 shows that the Project off-site traffic noise level impacts will range from 0.8 to 3.1 dBA CNEL. Based on the significance criteria for off-site traffic noise presented in Table 4-1, the non-sensitive land uses adjacent to the study area roadway segments would experience *less than significant* noise level impacts due to existing with Project-related traffic noise increases.

7.3 OYC (2027) PROJECT TRAFFIC NOISE LEVEL INCREASES

Table 7-3 shows the OYC without Project conditions CNEL noise levels. The OYC without Project exterior noise levels are expected to range from 70.7 to 71.0 dBA CNEL, without accounting for any noise attenuation features such as noise barriers or topography. Table 7-4 shows that the OYC with Project conditions will range from 71.6 to 73.7 dBA CNEL. Table 7-6 shows that the OYC Project off-site traffic noise level impacts will range from 0.6 to 2.8 dBA CNEL. Based on the significance criteria for off-site traffic noise presented in Table 4-1, the non-sensitive land uses adjacent to the study area roadway segments would experience *less than significant* noise level impacts due to existing with Project-related traffic noise increases.

TABLE 7-5: EXISTING WITH PROJECT TRAFFIC NOISE LEVEL INCREASES

ID	Road	Segment	Receiving Land Use ¹	CNEL at Receiving Land Use (dBA) ¹			Incremental Noise Level Increase Threshold ²	
				No Project	With Project	Project Addition	Limit	Exceeded?
1	Nichols Rd.	between Terra Cotta and Baker St.	Non-Sensitive	70.3	71.1	0.8	n/a	No
2	Nichols Rd.	between Baker St. and Collier Av.	Non-Sensitive	70.2	73.3	3.1	n/a	No
3	Nichols Rd.	between Collier Avenue and 1-15 SB Ramps	Non-Sensitive	70.2	73.1	2.9	n/a	No
4	Nichols Rd.	between 1-15 SB Ramps and I-15 NB Ramps	Non-Sensitive	70.0	71.9	1.9	n/a	No

¹ Based on a review of existing aerial imagery. Noise sensitive uses limited to existing residential land uses.² The CNEL is calculated at the boundary of the right-of-way of each roadway and the property line of the receiving land use.³ Does the Project create an incremental noise level increase exceeding the significance criteria (Table 4-1)?**TABLE 7-6: OYCP (2027) WITH PROJECT TRAFFIC NOISE LEVEL INCREASES**

ID	Road	Segment	Receiving Land Use ¹	CNEL at Receiving Land Use (dBA) ¹			Incremental Noise Level Increase Threshold ²	
				No Project	With Project	Project Addition	Limit	Exceeded?
1	Nichols Rd.	between Terra Cotta and Baker St.	Non-Sensitive	71.0	71.6	0.6	n/a	No
2	Nichols Rd.	between Baker St. and Collier Av.	Non-Sensitive	70.9	73.7	2.8	n/a	No
3	Nichols Rd.	between Collier Avenue and 1-15 SB Ramps	Non-Sensitive	70.9	73.4	2.5	n/a	No
4	Nichols Rd.	between 1-15 SB Ramps and I-15 NB Ramps	Non-Sensitive	70.7	72.4	1.7	n/a	No

¹ Based on a review of existing aerial imagery. Noise sensitive uses limited to existing residential land uses.² The CNEL is calculated at the boundary of the right-of-way of each roadway and the property line of the receiving land use.³ Does the Project create an incremental noise level increase exceeding the significance criteria (Table 4-1)?

8 RECEIVER LOCATIONS

To assess the potential for long-term operational and short-term construction noise impacts, the following sensitive receiver locations, as shown on Exhibit 8-A, were identified as representative locations for analysis. The selection of receiver locations is based on FHWA guidelines and is consistent with additional guidance provided by Caltrans and the FTA, as previously described in Section 5.2. Sensitive receivers are generally defined as locations where people reside or where the presence of unwanted sound could otherwise adversely affect the use of the land. Noise-sensitive land uses are generally considered to include schools, hospitals, single-family dwellings, mobile home parks, churches, libraries, and recreation areas. Moderately noise-sensitive land uses typically include multi-family dwellings, hotels, motels, dormitories, out-patient clinics, cemeteries, golf courses, country clubs, athletic/tennis clubs, and equestrian clubs. Land uses that are considered relatively insensitive to noise include business, commercial, and professional developments. Land uses that are typically not affected by noise include: industrial, manufacturing, utilities, agriculture, undeveloped land, parking lots, warehousing, liquid and solid waste facilities, salvage yards, and transit terminals.

To describe the potential off-site Project noise levels, six noise sensitive receiver locations in the vicinity of the Project site were identified. Other sensitive land uses in the Project study area that are located at greater distances than those identified in this noise study will experience lower noise levels than those presented in this report due to the additional attenuation from distance and the shielding of intervening structures. Distance is measured in a straight line from the Project boundary to each receiver location.

- R1: Location R1 represents the existing residence at 28750 Pierce Street, approximately 92 feet west of the Project site. Receiver R1 is placed in the private outdoor living areas (backyards) facing the Project site. A 24-hour noise measurement was taken near this location, L1, to describe the existing ambient noise environment.
- R2: Location R2 represents the future residence on Florence Drive, approximately 1,216 feet west of the Project site. Receiver R2 is placed in the private outdoor living areas (backyards) facing the Project site. A 24-hour noise measurement was taken near this location, L2, to describe the existing ambient noise environment.
- R3: Location R3 represents the existing residence at 29093 Gundersen Avenue, approximately 1,515 feet southwest of the Project site. R3 is placed in the private outdoor living areas (backyards) facing the Project site. A 24-hour noise measurement was taken near this location, L3, to describe the existing ambient noise environment.
- R4: Location R4 represents the existing residence at 16950 Gunnerson Street, approximately 1,380 feet southeast of the Project site. R4 is placed in the private outdoor living areas (backyards) facing the Project site. A 24-hour noise measurement was taken near this location, L4, to describe the existing ambient noise environment.
- R5: Location R5 represents the existing residence at 17250 Gunnerson Street, approximately 1,393 feet south of the Project site. R5 is placed in the private outdoor living areas (backyards) facing the Project site. A 24-hour noise measurement was taken near this location, L5, to describe the existing ambient noise environment.

R6: Location R6 represents the existing legal non-conforming residence at 17401 Baker Street, approximately 155 feet east of the Project site. R6 is placed in the private outdoor living areas (backyards) facing the Project site. A 24-hour noise measurement was taken near this location, L6, to describe the existing ambient noise environment.

EXHIBIT 8-A: RECEIVER LOCATIONS



9 OPERATIONAL NOISE IMPACTS

This section analyzes the potential stationary-source operational noise impacts at the nearby receiver locations, identified in Section 8, resulting from the operation of the proposed Baker Lake Elsinore Project. To conservatively describe the potential worst-case noise environment, Exhibit 9-A presents the noise source activities used to assess the operational noise levels.

9.1 OPERATIONAL NOISE SOURCES

This operational noise analysis is intended to describe noise level impacts associated with the expected typical of daytime and nighttime activities at the Project site. To present the potential worst-case noise conditions, this analysis assumes the Project would be operational 24 hours per day, seven days per week. Consistent with similar warehouse and industrial uses, the Project business operations would primarily be conducted within the enclosed buildings, except for traffic movement, parking, as well as loading and unloading of trucks at designated loading bays. The on-site Project-related noise sources are expected to include: loading dock activity, tractor trailer storage activity, parking lot vehicle activities, roof-top air conditioning units, trash enclosure activity and truck movements.

9.2 REFERENCE NOISE LEVELS

To estimate the Project operational noise impacts, reference noise level measurements were collected from similar types of activities to represent the noise levels expected with the development of the proposed Project. This section provides a detailed description of the reference noise level measurements shown on Table 9-1 used to estimate the Project operational noise impacts. It is important to note that the following projected noise levels assume the worst-case noise environment with the loading dock activity, tractor trailer storage activity, parking lot vehicle activities, roof-top air conditioning units, trash enclosure activity and truck movements all operating at the same time. These sources of noise activity will likely vary throughout the day.

9.2.1 MEASUREMENT PROCEDURES

The reference noise level measurements presented in this section were collected using a Larson Davis LxT Type 1 precision sound level meter (serial number 01146). The LxT sound level meter was calibrated using a Larson-Davis calibrator, Model CAL 200, was programmed in "slow" mode to record noise levels in "A" weighted form and was located at approximately five feet above the ground elevation for each measurement. The sound level meters and microphones were equipped with a windscreens during all measurements. All noise level measurement equipment satisfies the American National Standards Institute (ANSI) standard specifications for sound level meters ANSI S1.4-2014/IEC 61672-1:2013. (18)

EXHIBIT 9-A: OPERATIONAL NOISE SOURCE LOCATIONS

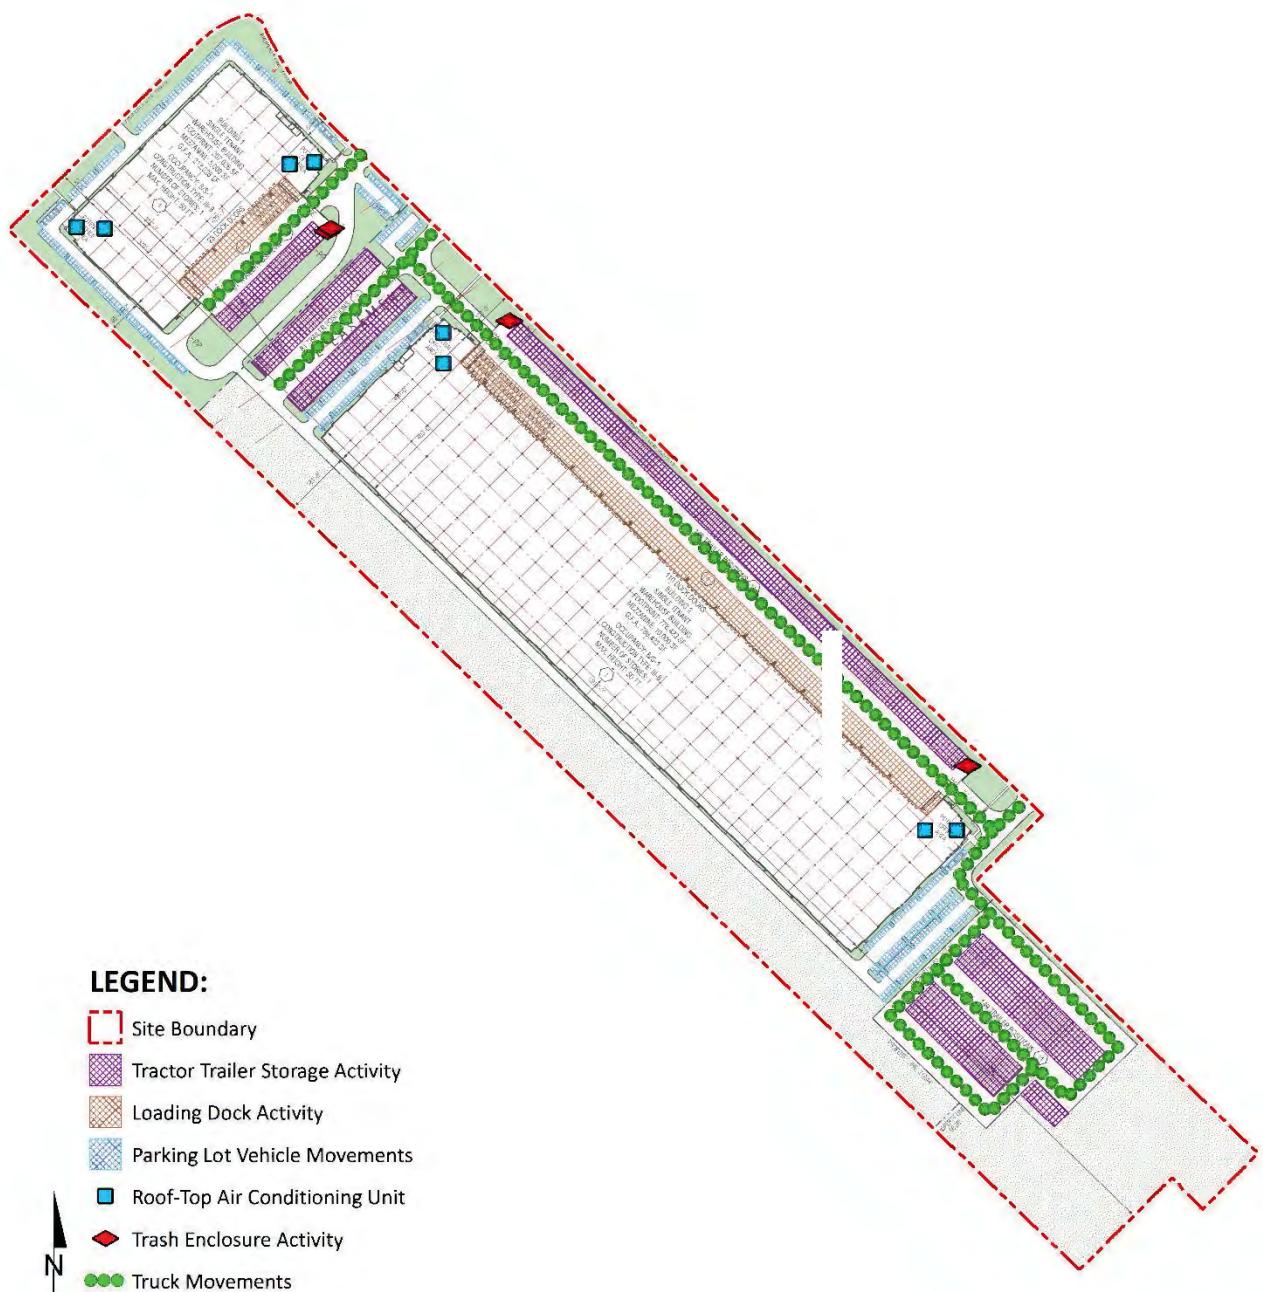


TABLE 9-1: REFERENCE NOISE LEVEL MEASUREMENTS

Reference Noise Source	Noise Source Height (Feet)	Min./Hour ¹		Reference Noise Level (dBA L _{eq}) @ 50 Feet	Sound Power Level (dBA) ²
		Day	Night		
Loading Dock Activity	8'	60	60	65.7	111.5
Tractor Trailer Storage Activity	8'	60	60	62.8	103.4
Roof-Top Air Conditioning Units	5'	39	28	57.2	88.9
Parking Lot Vehicle Movements	5'	60	60	52.6	81.1
Trash Enclosure Activity	5'	60	30	57.3	89.0
Truck Movements	8'	60	60	59.8	93.2

¹ Anticipated duration (minutes within the hour) of noise activity during typical hourly conditions expected at the Project site.

"Daytime" = 7:00 a.m. - 10:00 p.m.; "Nighttime" = 10:00 p.m. - 7:00 a.m.

² Sound power level represents the total amount of acoustical energy (noise level) produced by a sound source independent of distance or surroundings. Sound power levels calculated using the CadnaA noise model at the reference distance to the noise source. Numbers may vary due to size differences between point and area noise sources.

9.2.2 LOADING DOCK ACTIVITY

The reference loading dock activities are intended to describe the typical outdoor operational noise activities associated with the Project. This includes truck idling, reefer activity (refrigerator truck/cold storage), deliveries, backup alarms, trailer docking including a combination of tractor trailer semi-trucks, two-axle delivery trucks, and background operation activities. Since the noise levels generated by cold storage loading dock activity can be slightly higher due to the use of refrigerated trucks or reefers, this reference noise level conservatively assumes that all loading dock activity is associated with cold storage facilities. The reference noise level measurement was taken in the center of the loading dock activity area and represents multiple concurrent noise sources resulting in a combined noise level of 65.7 dBA L_{eq} at a uniform distance of 50 feet. Specifically, the reference noise level measurement represents one truck located approximately 30 feet from the noise level meter with another truck passing by to park roughly 20 feet away, both with their engines idling. Throughout the reference noise level measurement, a separate docked and running reefer truck was located approximately 50 feet east of the measurement location. Additional background noise sources included truck pass-by noise, truck drivers talking to each other next to docked trucks, and air brake release noise when trucks parked.

9.2.3 TRACTOR TRAILER STORAGE ACTIVITY

To evaluate the noise levels associated with truck idling, backup alarms, tractor trailer movements and storage activities, Urban Crossroads collected a reference noise level measurement at an existing parcel hub facility to describe the potential operational noise levels associated with Project tractor trailer storage activities. The measured reference noise level at 50 feet from activity was measured at 62.8 dBA L_{eq}. The reference noise level measurement includes a semi-truck with trailer pass-by event, background switcher cab trailer towing, drop-off, idling, and backup alarm events. Tractor trailer activity is estimated during all the daytime, evening, and nighttime hours.

9.2.4 ROOF-TOP AIR CONDITIONING UNITS

The noise level measurements describe a single mechanical roof-top air conditioning unit. The reference noise level represents a Lennox SCA120 series 10-ton model packaged air conditioning unit. At the uniform reference distance of 50 feet, the reference noise level is 57.2 dBA L_{eq} . Based on the typical operating conditions observed over a four-day measurement period, the roof-top air conditioning units are estimated to operate for an average 39 minutes per hour during the daytime hours, and 28 minutes per hour during the nighttime hours. These operating conditions reflect peak summer cooling requirements with measured temperatures approaching 96 degrees Fahrenheit ($^{\circ}$ F) with average daytime temperatures of 82 $^{\circ}$ F. For this noise analysis, the air conditioning units are expected to be located on the roof of the Project buildings.

9.2.5 PARKING LOT VEHICLE MOVEMENTS

To describe the on-site parking lot activity, a long-term 29-hour reference noise level measurement was collected in the center of activity within the staff parking lot of a warehouse distribution center. At 50 feet from the center of activity, the parking lot produced a reference noise level of 52.6 dBA L_{eq} . Parking activities are expected to take place during the full hour (60 minutes) throughout the daytime and evening hours. The parking lot noise levels are mainly due to cars pulling in and out of parking spaces in combination with car doors opening and closing.

9.2.6 TRASH ENCLOSURE ACTIVITY

To describe the noise levels associated with a trash enclosure activity, Urban Crossroads collected a reference noise level measurement at an existing trash enclosure containing two dumpster bins. The trash enclosure noise levels describe metal gates opening and closing, metal scraping against concrete floor sounds, dumpster movement on metal wheels, and trash dropping into the metal dumpster. The reference noise levels describe trash enclosure noise activities when trash is dropped into an empty metal dumpster, as would occur at the Project Site. The measured reference noise level at the uniform 50-foot reference distance is 57.3 dBA L_{eq} for the trash enclosure activity. The reference noise level describes the expected noise source activities associated with the trash enclosures for the Project's proposed building.

9.2.7 TRUCK MOVEMENTS

The truck movements reference noise level measurement was collected over a period of 1 hour and 28 minutes and represent multiple heavy trucks entering and exiting the outdoor loading dock area producing a reference noise level of 59.8 dBA L_{eq} at 50 feet. The noise sources included at this measurement location account for trucks entering and exiting the Project driveways and maneuvering in and out of the outdoor loading dock activity area.

9.3 CADNA A NOISE PREDICTION MODEL

To fully describe the exterior operational noise levels from the Project, Urban Crossroads, Inc. developed a noise prediction model using the CadnaA (Computer Aided Noise Abatement) computer program. CadnaA can analyze multiple types of noise sources using the spatially accurate Project site plan, georeferenced Nearmap aerial imagery, topography, buildings, and barriers in its calculations to predict outdoor noise levels. Using the ISO 9613-2 protocol, CadnaA will calculate the distance from each noise source to the noise receiver locations, using the ground absorption, distance, and barrier/building attenuation inputs to provide a summary of noise level at each receiver and the partial noise level contributions by noise source.

Consistent with the ISO 9613-2 protocol, the CadnaA noise prediction model relies on the reference sound power level (L_w) to describe individual noise sources. While sound pressure levels (e.g., L_{eq}) quantify in decibels the intensity of given sound sources at a reference distance, sound power levels (L_w) are connected to the sound source and are independent of distance. Sound pressure levels vary substantially with distance from the source and diminish because of intervening obstacles and barriers, air absorption, wind, and other factors. Sound power is the acoustical energy emitted by the sound source and is an absolute value that is not affected by the environment. The operational noise level calculations provided in this noise study account for the distance attenuation provided due to geometric spreading, when sound from a localized stationary source (i.e., a point source) propagates uniformly outward in a spherical pattern. A default ground attenuation factor of 0.5 was used in the noise analysis to account for mixed ground representing a combination of hard and soft surfaces. Appendix 9.1 includes the detailed noise dBA L_{eq} model inputs used to estimate the Project operational noise levels presented in this section.

9.4 PROJECT OPERATIONAL NOISE LEVELS

Using the reference noise levels to represent the proposed Project operations that include loading dock activity, tractor trailer storage activity, parking lot vehicle activities, roof-top air conditioning units, trash enclosure activity and truck movements, Urban Crossroads, Inc. calculated the operational source noise levels that are expected to be generated at the Project site and the Project-related noise level increases that would be experienced at each of the sensitive receiver locations. Table 9-2 shows the Project operational noise levels during the daytime hours of 7:00 a.m. to 10:00 p.m. The daytime hourly noise levels at the off-site receiver locations are expected to range from 42.1 to 54.3 dBA L_{eq} at the existing noise sensitive receiver locations.

TABLE 9-2: DAYTIME PROJECT OPERATIONAL NOISE LEVELS

Noise Source ¹	Operational Noise Levels by Receiver Location (dBA L _{eq})					
	R1	R2	R3	R4	R5	R6
Cold Storage Loading Dock Activity	31.6	30.3	42.1	39.5	34.1	49.1
Tractor Trailer Storage Activity	39.2	42.2	41.4	42.2	41.1	52.0
Roof-Top Air Conditioning Units	36.1	26.4	24.1	22.2	20.2	33.8
Parking Lot Vehicle Movements	35.6	22.7	18.5	19.4	17.1	31.8
Trash Enclosure Activity	14.6	23.9	21.5	14.6	12.9	34.6
Truck Movements	26.2	28.1	29.2	30.4	28.7	43.3
Total (All Noise Sources)	42.5	42.8	45.0	44.3	42.1	54.3

¹ See Exhibit 9-A for the noise source locations. CadnaA noise model calculations are included in Appendix 9.1.

Table 9-3 shows the Project operational noise levels during the nighttime hours of 10:00 p.m. to 7:00 a.m. The nighttime hourly noise levels at the off-site receiver locations are expected to range from 42.1 to 54.3 dBA L_{eq} at the existing noise sensitive receiver locations. The differences between the daytime and nighttime noise levels are largely related to the estimated duration of noise activity as outlined in Table 9-1 and Appendix 9.1.

TABLE 9-3: NIGHTTIME PROJECT OPERATIONAL NOISE LEVELS

Noise Source ¹	Operational Noise Levels by Receiver Location (dBA L _{eq})					
	R1	R2	R3	R4	R5	R6
Cold Storage Loading Dock Activity	31.6	30.3	42.1	39.5	34.1	49.1
Tractor Trailer Storage Activity	39.2	42.2	41.4	42.2	41.1	52.0
Roof-Top Air Conditioning Units	33.7	24.0	21.7	19.8	17.8	31.3
Parking Lot Vehicle Movements	35.6	22.7	18.5	19.4	17.1	31.8
Trash Enclosure Activity	13.6	22.9	20.5	13.7	12.0	33.7
Truck Movements	26.2	28.1	29.2	30.4	28.7	43.3
Total (All Noise Sources)	42.1	42.8	44.9	44.3	42.1	54.3

¹ See Exhibit 9-A for the noise source locations. CadnaA noise model calculations are included in Appendix 9.1.

9.5 PROJECT OPERATIONAL NOISE LEVEL COMPLIANCE

To demonstrate compliance with local noise regulations, the unmitigated Project-only operational noise levels are evaluated against exterior noise level thresholds based on the City of Lake Elsinore exterior noise level standards at nearby noise-sensitive receiver locations. Table 9-4 shows the unmitigated operational noise levels associated with Baker Lake Elsinore will not exceed the exterior noise level standards, adjusted in five dBA increments to reflect the ambient noise levels (see Table 5-1) per the City of Lake Elsinore Municipal Code Section 17.176.060[A][3]. Therefore, the stationary operational noise impacts are considered *less than significant* at the nearest noise-sensitive receiver locations.

TABLE 9-4: OPERATIONAL NOISE LEVEL COMPLIANCE

Receiver Location ¹	Measurement Location	Project Operational Noise Levels (dBA Leq) ²		Noise Level Standards (dBA Leq) ³		Noise Level Standards Exceeded? ⁴	
		Daytime	Nighttime	Daytime	Nighttime	Daytime	Nighttime
R1	L1	42.5	42.1	50	55	No	No
R2	L2	42.8	42.8	55	50	No	No
R3	L3	45.0	44.9	55	45	No	No
R4	L4	44.3	44.3	60	55	No	No
R5	L5	42.1	42.1	60	55	No	No
R6	L6	54.3	54.3	55	55	No	No

¹ See Exhibit 8-A for the receiver locations.² Proposed Project operational noise levels as shown on Tables 9-2 and 9-3.³ Exterior noise level standards, adjusted in five (5) dBA increments to reflect the ambient noise levels (see Table 5-1) per the Lake Elsinore Municipal Code Section 17.176.060[A][3].⁴ Do the estimated Project operational noise source activities exceed the noise level standards?

5 Project operational noise levels provided for informational purposes

"Daytime" = 7:00 a.m. - 10:00 p.m.; "Nighttime" = 10:00 p.m. - 7:00 a.m.

9.6 PROJECT OPERATIONAL NOISE LEVEL INCREASES

To describe the Project operational noise level increases, the Project operational noise levels are combined with the existing ambient noise levels measurements for the nearby receiver locations that may be potentially impacted by Project operational noise sources. Since the units used to measure noise, decibels (dB), are logarithmic units, the Project-operational and existing ambient noise levels cannot be combined using standard arithmetic equations. (3) Instead, they must be logarithmically added using the following base equation:

$$SPL_{Total} = 10\log_{10}[10^{SPL1/10} + 10^{SPL2/10} + \dots + 10^{SPLn/10}]$$

Where "SPL1," "SPL2," etc. are equal to the sound pressure levels being combined, or in this case, the Project-operational and existing ambient noise levels. The difference between the combined Project and ambient noise levels describes the Project noise level increases to the existing ambient noise environment. Noise levels that would be experienced at receiver locations when Project-source noise is added to the daytime and nighttime ambient conditions are presented on Tables 9-5 and 9-6, respectively. As indicated on Table 9-5, the Project will generate a daytime operational noise increase ranging from 0.2 to 4.3 dBA Leq at the nearest receiver locations. Table 9-6 shows that the Project will generate a nighttime operational noise increase ranging from 0.4 to 3.2 dBA Leq at the nearest receiver locations. Project-related operational noise level increases will not exceed the operational noise level increase significance criteria presented in Table 4-1. Therefore, Project related operational noise level increases at the sensitive receiver locations will be *less than significant*.

TABLE 9-5: DAYTIME PROJECT OPERATIONAL NOISE LEVEL INCREASES

Receiver Location ¹	Total Project Operational Noise Level ²	Measurement Location ³	Reference Ambient Noise Levels ⁴	Combined Project and Ambient ⁵	Project Increase ⁶	Increase Criteria ⁷	Increase Criteria Exceeded?
R1	42.5	L1	52.4	52.8	0.4	5.0	No
R2	42.8	L2	54.9	55.2	0.3	5.0	No
R3	45.0	L3	51.7	52.5	0.8	5.0	No
R4	44.3	L4	57.7	57.9	0.2	5.0	No
R5	42.1	L5	55.9	56.1	0.2	5.0	No
R6	54.3	L6	52.0	56.3	4.3	5.0	No

¹ See Exhibit 8-A for the receiver locations.² Total Project daytime operational noise levels as shown on Table 9-2.³ Reference noise level measurement locations as shown on Exhibit 5-A.⁴ Observed daytime ambient noise levels as shown on Table 5-1.⁵ Represents the combined ambient conditions plus the Project activities.⁶ The noise level increase expected with the addition of the proposed Project activities.⁷ Significance increase criteria as shown on Table 4-1.**TABLE 9-6: NIGHTTIME OPERATIONAL NOISE LEVEL INCREASES**

Receiver Location ¹	Total Project Operational Noise Level ²	Measurement Location ³	Reference Ambient Noise Levels ⁴	Combined Project and Ambient ⁵	Project Increase ⁶	Increase Criteria ⁷	Increase Criteria Exceeded?
R1	42.1	L1	50.3	50.9	0.6	5.0	No
R2	42.8	L2	48.3	49.4	1.1	5.0	No
R3	44.9	L3	45.0	48.0	3.0	5.0	No
R4	44.3	L4	54.0	54.4	0.4	5.0	No
R5	42.1	L5	52.5	52.9	0.4	5.0	No
R6	54.3	L6	53.9	57.1	3.2	5.0	No

¹ See Exhibit 8-A for the receiver locations.² Total Project nighttime operational noise levels as shown on Table 9-3.³ Reference noise level measurement locations as shown on Exhibit 5-A.⁴ Observed nighttime ambient noise levels as shown on Table 5-1.⁵ Represents the combined ambient conditions plus the Project activities.⁶ The noise level increase expected with the addition of the proposed Project activities.⁷ Significance increase criteria as shown on Table 4-1.

10 CONSTRUCTION IMPACTS

This section analyzes potential impacts resulting from the short-term construction activities associated with the development of the Project. Exhibit 10-A shows the on-site construction noise source activity in relation to the nearest sensitive receiver locations previously described in Section 8. According to LEMC Section 17.176.080[F], Construction/Demolition, *operating or causing the operation of any tools or equipment used in construction, drilling, repair, alteration, or demolition work between weekday hours of 7 p.m. and 7 a.m., or at any time on weekends or holidays, such that the sound therefrom creates a noise disturbance across a residential or commercial real property line, except for emergency work of public service utilities or by variance issued by the City.* In addition, LEMC Section 17.176.080[F] requires construction activities to be conducted in such a manner that the noise levels at affected residential properties will not exceed the daytime (7:00 a.m. to 7:00 p.m.) mobile exterior noise level limit of 75 dBA L_{eq} and 60 dBA L_{eq} during the nighttime hours of 7:00 p.m. to 7:00 a.m.

10.1 CONSTRUCTION NOISE LEVELS


The FTA *Transit Noise and Vibration Impact Assessment Manual* recognizes that construction projects are accomplished in several different stages and outlines the procedures for assessing noise impacts during construction. Each stage has a specific equipment mix, depending on the work to be completed during that stage. As a result of the equipment mix, each stage has its own noise characteristics; some stages have higher continuous noise levels than others, and some have higher impact noise levels than others. The Project construction activities are expected to occur in the following stages:

- Site Preparation
- Grading
- Building Construction
- Paving
- Architectural Coating

10.2 CONSTRUCTION REFERENCE NOISE LEVELS

To describe construction noise activities, this construction noise analysis was prepared using reference construction equipment noise levels from the Federal Highway Administration (FHWA) published the Roadway Construction Noise Model (RCNM), which includes a national database of construction equipment reference noise emission levels. (22) The RCNM equipment database, provides a comprehensive list of the noise generating characteristics for specific types of construction equipment. In addition, the database provides an acoustical usage factor to estimate the fraction of time each piece of construction equipment is operating at full power (i.e., its loudest condition) during a construction operation.

EXHIBIT 10-A: CONSTRUCTION NOISE SOURCE LOCATIONS

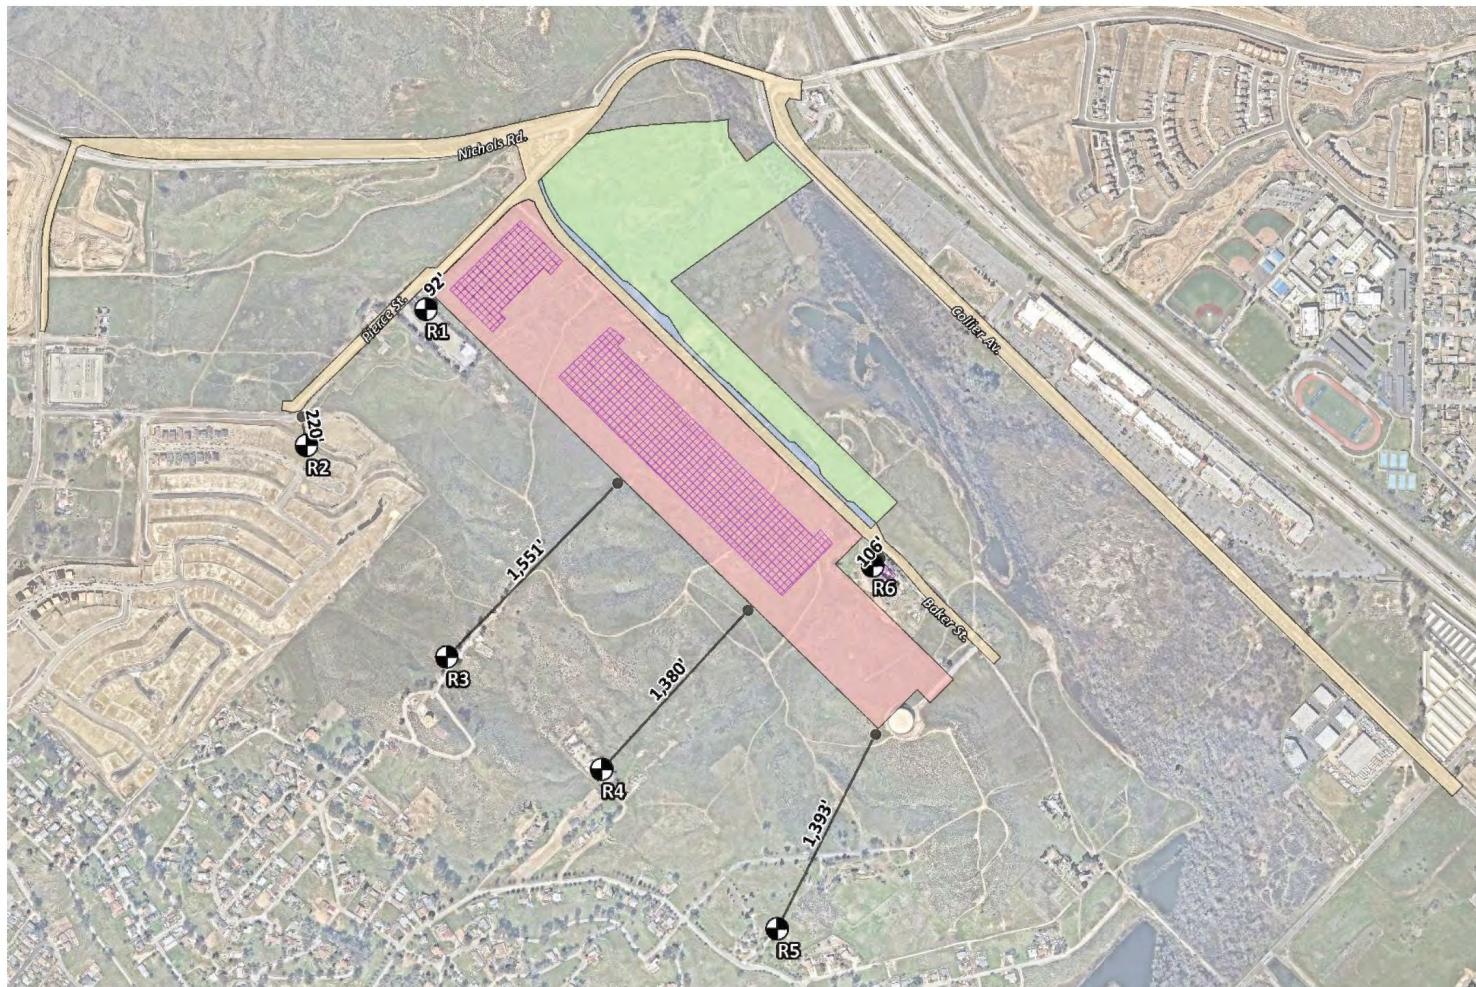

LEGEND:

Mobile Construction Activity	RCA Conserved Area	Receiver Locations
Stationary Construction Activity	Shared Offsite Impacts	—● Distance from receiver to construction activity (in feet)
Disturbed EIP Excess Property		

10.3 CONSTRUCTION NOISE ANALYSIS

Using the reference construction equipment noise levels and the CadnaA noise prediction model, calculations of the mobile and stationary Project construction noise levels at the nearby sensitive receiver locations were completed. Consistent with FTA guidance for general construction noise assessment, Table 10-1 presents the combined noise levels for the noisiest pieces of construction equipment expected to be used in each phase, assuming all equipment operates at the same time.

TABLE 10-1: CONSTRUCTION REFERENCE NOISE LEVELS

Construction Stage	Reference Construction Equipment ¹	Reference Noise Level @ 50 Feet (dBA L _{eq})	Composite Reference Noise Level (dBA L _{eq}) ²	Reference Power Level (dBA L _w) ³
Site Preparation	Tractor	80	84.0	115.6
	Backhoe	74		
	Grader	81		
Grading	Scraper	80	83.3	114.9
	Excavator	77		
	Dozer	78		
Building Construction	Crane	73	80.6	112.2
	Generator	78		
	Front End Loader	75		
Paving	Paver	74	77.8	109.5
	Dump Truck	72		
	Roller	73		
Architectural Coating	Man Lift	68	76.2	107.8
	Compressor (air)	74		
	Generator (<25kVA)	70		

¹ FHWA Road Construction Noise Model.

² Represents the combined noise level for all equipment assuming they operate at the same time consistent with FTA Transit Noise and Vibration Impact Assessment guidance.

³ Sound power level represents the total amount of acoustical energy (noise level) produced by a sound source independent of distance or surroundings.

10.3.1 MOBILE CONSTRUCTION NOISE LEVELS

To account for the dynamic nature of mobile construction activities, the CadnaA construction noise analysis evaluates the equipment as multiple moving point sources or work crews using an area source method within the construction area (limits of all Project construction). Construction projects involve various stages, and activities frequently shift from one location to another. For example, during the initial stages, noise-generating activities might concentrate in one area, and then move to another section as construction progresses. Typical construction impacts are based on the highest noise level calculated at each receiver location. As shown on Table 10-2, the

mobile construction noise levels are expected to range from 44.7 to 62.4 dBA L_{eq} at the nearby receiver locations. Appendix 10.1 includes the mobile construction noise model calculations.

TABLE 10-2: MOBILE CONSTRUCTION EQUIPMENT SUMMARY

Receiver Location ¹	Mobile Construction Noise Levels (dBA L _{eq})					
	Site Preparation	Grading	Building Construction	Paving	Architectural Coating	Highest Levels ²
R1	61.3	60.6	57.9	55.2	53.5	61.3
R2	54.1	53.4	50.7	48.0	46.3	54.1
R3	52.3	51.6	48.9	46.2	44.5	52.3
R4	52.3	51.6	48.9	46.2	44.5	52.3
R5	50.0	49.3	46.6	43.9	42.2	50.0
R6	60.9	60.2	57.5	54.8	53.1	60.9

¹ Construction noise source and receiver locations are shown on Exhibit 10-A.

² CadnaA mobile construction noise model calculations are included in Appendix 10.1.

10.3.2 MOBILE CONSTRUCTION NOISE LEVEL COMPLIANCE

To evaluate whether the Project will generate potentially significant short-term mobile construction noise levels at nearest receiver locations, a construction-related daytime noise level threshold of 75 dBA L_{eq} is used to assess the daytime mobile construction noise level impacts. The construction noise analysis shows that the nearest receiver locations will satisfy the daytime 75 dBA L_{eq} significance threshold during Project mobile construction activities as shown on Table 10-3. Therefore, the noise impacts due to Project construction noise are considered *less than significant* at all receiver locations.

TABLE 10-3: MOBILE CONSTRUCTION NOISE LEVEL COMPLIANCE

Receiver Location ¹	Mobile Construction Noise Levels (dBA L _{eq})		
	Highest Construction Noise Levels ²	Threshold ³	Threshold Exceeded? ⁴
R1	61.3	75	No
R2	54.1	75	No
R3	52.3	75	No
R4	52.3	75	No
R5	50.0	75	No
R6	60.9	75	No

¹ Construction noise source and receiver locations are shown on Exhibit 10-A.

² Highest construction noise level calculations based on distance from the construction noise source activity to the nearest receiver locations as shown on Table 10-2.

³ Mobile Construction noise level thresholds as shown on Table 3-2.

⁴ Do the estimated Project construction noise levels exceed the construction noise level threshold?

10.3.3 MOBILE CONSTRUCTION TEMPORARY NOISE LEVEL INCREASES

To describe the temporary Project construction noise contributions to the existing ambient noise environment, the Project construction noise levels were combined with the existing ambient noise levels measurements at the nearest off-site receiver locations. The difference between the combined Project-construction and ambient noise levels is used to describe the construction noise level contributions. Temporary noise increases that would be experienced at sensitive receiver locations when Project construction-source noise is added to the ambient daytime conditions are presented on Table 10-4. A temporary noise level increase of 12 dBA is considered a *potentially significant* impact based on the Caltrans substantial noise level increase criteria consistent which is used to assess the Project-construction noise level increases. (17) As indicated in Table 10-4, the Project will generate mobile construction noise increases ranging from 1.0 to 9.4 dBA L_{eq} during the daytime hours at the nearest receiver locations. The construction noise analysis shows that the nearest receiver locations will not exceed Caltrans *substantial* 12 dBA L_{eq} noise increase significance threshold during Project mobile construction activities. The temporary construction noise level increase analysis shows that the noise impacts due to Project mobile construction noise increase are considered *less than significant*.

TABLE 10-4: MOBILE CONSTRUCTION NOISE LEVEL INCREASES

Receiver Location ¹	Mobile Construction Noise Level ²	Measurement Location ³	Reference Ambient Noise Levels ⁴	Combined Project and Ambient ⁵	Project Increase ⁶	Increase Criteria ⁷	Increase Criteria Exceeded?
R1	61.3	L1	52.4	61.8	9.4	12	No
R2	54.1	L2	54.9	57.5	2.6	12	No
R3	52.3	L3	51.7	55.0	3.3	12	No
R4	52.3	L4	57.7	58.8	1.1	12	No
R5	50.0	L5	55.9	56.9	1.0	12	No
R6	60.9	L6	52.0	61.4	9.4	12	No

¹ Construction noise source and receiver locations are shown on Exhibit 10-A.

² Mobile construction noise levels as shown on Table 10-3.

³ Reference noise level measurement locations as shown on Exhibit 5-A.

⁴ Observed daytime ambient noise levels as shown on Table 5-1.

⁵ Represents the combined ambient conditions plus the Project construction activities.

⁶ The noise level increase expected with the addition of the Project mobile construction activities.

⁷ Caltrans Traffic Noise Analysis Protocol, April 2020.

10.3.4 STATIONARY SOURCE CONSTRUCTION NOISE LEVELS

Mobile construction noise sources, such as excavators, trucks, and concrete mixers, generate noise while moving around a site, leading to varying noise levels at different locations. In contrast, stationary noise sources, like generators, compressors, and tower cranes, generally concentrate in one place near the building during the building construction and architectural coating stages of construction. Table 10-5 shows that the stationary source construction equipment noise levels are expected to range from 41.9 to 57.5 dBA L_{eq} at the nearby receiver locations. Appendix 10.2 includes stationary construction noise model calculations.

TABLE 10-5: STATIONARY CONSTRUCTION EQUIPMENT SUMMARY

Receiver Location ¹	Stationary Construction Noise Levels (dBA L _{eq})					
	Site Preparation	Grading	Building Construction	Paving	Architectural Coating	Highest Levels ²
R1			57.5		53.1	57.5
R2			47.8		43.4	47.8
R3			46.4		42.0	46.4
R4			45.5		41.1	45.5
R5			41.9		37.5	41.9
R6			51.5		47.1	51.5

¹ Construction noise source and receiver locations are shown on Exhibit 10-A.² CadnaA stationary construction noise model calculations are included in Appendix 10.2.**10.3.5 STATIONARY CONSTRUCTION NOISE LEVEL COMPLIANCE**

To evaluate whether the Project will generate potentially significant short-term stationary construction noise levels at nearest receiver locations, a construction-related daytime noise level threshold of 60 dBA L_{eq} is used to assess the daytime stationary construction noise level impacts. The construction noise analysis shows that the nearest receiver locations will satisfy the daytime 60 dBA L_{eq} significance threshold during Project stationary construction activities as shown on Table 10-6. Therefore, the noise impacts due to Project stationary construction noise are considered *less than significant* at all receiver locations.

TABLE 10-6: STATIONARY CONSTRUCTION NOISE LEVEL COMPLIANCE

Receiver Location ¹	Mobile Construction Noise Levels (dBA L _{eq})		
	Highest Construction Noise Levels ²	Threshold ³	Threshold Exceeded? ⁴
R1	57.5	60	No
R2	47.8	60	No
R3	46.4	60	No
R4	45.5	60	No
R5	41.9	60	No
R6	51.5	60	No

¹ Construction noise source and receiver locations are shown on Exhibit 10-A.² Highest construction noise level calculations based on distance from the construction noise source activity to the nearest receiver locations as shown on Table 10-2.³ Stationary construction noise level thresholds as shown on Table 3-3.⁴ Do the estimated Project construction noise levels exceed the construction noise level threshold?

10.3.6 STATIONARY CONSTRUCTION TEMPORARY NOISE LEVEL INCREASES

As shown in Table 10-7, the Project will generate stationary construction noise increases ranging from 0.2 to 6.3 dBA L_{eq} during the daytime hours at the nearest receiver locations. The unmitigated construction noise analysis shows that the nearest receiver locations will not exceed Caltrans *substantial* 12 dBA L_{eq} noise increase significance threshold during Project stationary construction activities. The temporary construction noise analysis shows that the noise impacts due to Project stationary construction noise increase are considered *less than significant*.

TABLE 10-7: STATIONARY CONSTRUCTION NOISE LEVEL INCREASES

Receiver Location ¹	Stationary Construction Noise Level ²	Measurement Location ³	Reference Ambient Noise Levels ⁴	Combined Project and Ambient ⁵	Project Increase ⁶	Increase Criteria ⁷	Increase Criteria Exceeded?
R1	57.5	L1	52.4	58.7	6.3	12	No
R2	47.8	L2	54.9	55.7	0.8	12	No
R3	46.4	L3	51.7	52.8	1.1	12	No
R4	45.5	L4	57.7	58.0	0.3	12	No
R5	41.9	L5	55.9	56.1	0.2	12	No
R6	51.5	L6	52.0	54.8	2.8	12	No

¹ Construction noise source and receiver locations are shown on Exhibit 10-A.

² Stationary construction noise levels as shown on Table 10-5.

³ Reference noise level measurement locations as shown on Exhibit 5-A.

⁴ Observed daytime ambient noise levels as shown on Table 5-1.

⁵ Represents the combined ambient conditions plus the Project construction activities.

⁶ The noise level increase expected with the addition of the Project mobile construction activities.

⁷ Caltrans Traffic Noise Analysis Protocol, April 2020.

10.4 OFF-SITE ROADWAY AND LIFT STATION CONSTRUCTION NOISE ANALYSIS

To support the Project development, there will be off-site roadway improvements limited to Baker Street and Nichols Street, the Baker Street realignment to Nichols Street, and improvements from Pierce Street to Hoff Ave southwest of the site. Exhibit 10-A presents the limits of construction that includes the planned off-site roadway and lift station improvements. There will be improvements to the temporary lift station at the intersection of Pierce Street and Nichols Street, which will include the following:

- Install 3 pumps (2 duty, 1 standby), each rated for 1100 gpm with 25 horsepower motors.
- Construct above grade control building
- Standby diesel generator to be rated for 200 kW
- New electrical service to site and onsite electrical and building electrical improvements.
- Site improvements including 8'-0" high perimeter block wall, paving inside site.

Additionally, installation of approximately 7,650 feet of 16-inch force main is anticipated at Nichols Road and Collier Avenue to a discharge manhole at the intersection of Collier Avenue and Riverside Drive. Construction of the off-site roadway and utility improvements will be primarily

within the existing public right-of-way (ROW) and be of brief duration. The physical ROW constraints would limit the amount of construction equipment that could be used at any one location, and any off-site and roadway and utility infrastructure construction would not take place at any one location for more than a few days due to the nature of the linear construction activity. The construction noise from this off-site work would, therefore, be relatively short-term and the noise levels would be reduced as construction work moves linearly along with the selected alignment and farther from sensitive uses.

Table 10-8 presents the estimated Project-related roadway and lift station construction noise levels at distances ranging from 10 to 100 feet using the highest reference noise levels shown on Table 10-1. At distances ranging from 10 to 100 feet, the mobile off-site construction noise levels are estimated to range from 59.8 to 65.7 dBA L_{eq}. Since the mobile off-site construction activities will not exceed the 75 dBA L_{eq} construction noise level standard for off-site receivers located within 10 feet, the noise impacts due to these off-site activities are considered *less than significant*. Appendix 10.3 includes the CadnaA off-site mobile construction noise calculations.

TABLE 10-8: OFF-SITE CONSTRUCTION NOISE ANALYSIS

Distance From Construction (Feet)	Construction Noise Levels (dBA L _{eq})		
	Construction Noise Levels ¹	Threshold ²	Threshold Exceeded? ³
10'	65.7	75	No
20'	64.3	75	No
50'	61.8	75	No
100'	59.8	75	No

¹ Based on the highest combined reference construction noise levels as shown on Table 10-1.

² Construction noise level thresholds as shown on Table 4-1.

³ Do the estimated Project construction noise levels exceed the construction noise level threshold?

10.5 NIGHTTIME CONCRETE POUR NOISE ANALYSIS

It is our understanding that nighttime concrete pouring activities will occur as a part of Project building construction activities. Nighttime concrete pouring activities are often used to support reduced concrete mixer truck transit times and lower air temperatures than during the daytime hours and are generally limited to the actual building pad area. Since the nighttime concrete pours will take place outside the hours permitted by LEMC Section 17.176.080[F], the Project Applicant will be required to obtain authorization for nighttime work from the City of Lake Elsinore. Any nighttime construction noise activities are evaluated against the exterior construction noise level threshold of 60 dBA L_{eq} for noise sensitive residential land use.

10.5.1 NIGHTTIME CONCRETE POUR REFERENCE NOISE LEVEL MEASUREMENTS

To estimate the noise levels due to nighttime concrete pouring activities, sample reference noise level measurements were taken during a nighttime concrete pouring at a construction site. Urban Crossroads, Inc. collected short-term nighttime concrete pour reference noise level measurements during the noise-sensitive nighttime hours between 1:00 a.m. to 2:00 a.m. at

27334 San Bernardino Avenue in the City of Redlands. The reference noise levels describe the expected concrete pour noise sources that may include concrete mixer truck movements and pouring activities, concrete paving equipment, rear mounted concrete mixer truck backup alarms, engine idling, air brakes, generators, and workers communicating/whistling. To describe the nighttime concrete pour noise levels associated with the construction of the Baker Lake Elsinore, this analysis relies on reference sound pressure level of 67.7 dBA L_{eq} at 50 feet representing a sound power level of 100.3 dBA L_w . While the Project noise levels will depend on the actual duration of activities and specific equipment fleet in use at the time of construction, the reference sound power level of 100.3 dBA L_w is used to describe the expected Project nighttime concrete pour noise activities.

10.5.2 NIGHTTIME CONCRETE POUR NOISE LEVEL COMPLIANCE

As shown on Table 10-9, the noise levels associated with the nighttime concrete pour activities are estimated to range from 37.0 to 52.6 dBA L_{eq} at the existing noise sensitive receiver locations. The analysis shows that the nighttime concrete pour activities will not exceed the 60 dBA L_{eq} nighttime residential noise level threshold at all the nearest noise sensitive receiver locations. Therefore, the noise impacts due to Project construction nighttime concrete pour noise activity are considered *less than significant* at all receiver locations with prior authorization for nighttime work from the City of Lake Elsinore. Appendix 10.4 includes the CadnaA nighttime concrete pour noise model inputs.

TABLE 10-9: NIGHTTIME CONCRETE POUR NOISE LEVEL COMPLIANCE

Receiver Location ¹	Concrete Pour Construction Noise Levels (dBA L_{eq})		
	Exterior Noise Levels ²	Threshold ³	Threshold Exceeded? ⁴
R1	52.6	60	No
R2	42.9	60	No
R3	41.5	60	No
R4	40.6	60	No
R5	37.0	60	No
R6	46.6	60	No

¹ Construction noise source and receiver locations are shown on Exhibit 10-A.

² Nighttime Concrete Pour noise model inputs are included in Appendix 10.3.

³ Construction noise level thresholds as shown on Table 4-1.

⁴ Do the estimated Project construction noise levels exceed the construction noise level threshold?

10.6 CONSTRUCTION VIBRATION ANALYSIS

Construction activity can result in varying degrees of ground vibration, depending on the equipment and methods employed. The operation of construction equipment causes ground vibrations that spread through the ground and diminish in strength with distance. Ground vibration levels associated with various types of construction equipment are summarized on Table 10-10. Based on the representative vibration levels presented for various construction equipment types, it is possible to estimate the potential for human response (annoyance) and

building damage using the following vibration assessment methods defined by the FTA. To describe the vibration impacts the FTA provides the following equation: $PPV_{equip} = PPV_{ref} \times (25/D)^{1.5}$

TABLE 10-10: VIBRATION SOURCE LEVELS FOR CONSTRUCTION EQUIPMENT

Equipment	PPV (in/sec) at 25 feet
Small bulldozer	0.003
Jackhammer	0.035
Loaded Trucks	0.076
Large bulldozer	0.089
Vibratory Roller	0.210

Federal Transit Administration, Transit Noise and Vibration Impact Assessment Manual

Table 10-11 presents the expected Project related vibration levels at the nearby receiver locations. At distances ranging from 92 to 1,551 feet from Project construction activities, construction vibration velocity levels are estimated to range from 0.000 to 0.030 PPV (in/sec). Based on LEMC vibration perception threshold of 0.04 PPV (in/sec), the Project construction vibration levels will not exceed the vibration perception thresholds. Therefore, the Project-related vibration impacts are considered *less than significant* during typical construction activities at the Project site.

TABLE 10-11: PROJECT CONSTRUCTION VIBRATION LEVELS

Location ¹	Distance to Const. Activity (Feet) ²	Typical Construction Vibration Levels PPV (in/sec) ³						Thresholds PPV (in/sec) ⁴	Thresholds Exceeded? ⁵
		Small bulldozer	Jack-hammer	Loaded Trucks	Large bulldozer	Vibratory Roller	Highest Vibration Level		
R1	92'	0.000	0.005	0.011	0.013	0.030	0.030	0.04	No
R2	220'	0.000	0.001	0.003	0.003	0.008	0.008	0.04	No
R3	1,551'	0.000	0.000	0.000	0.000	0.000	0.000	0.04	No
R4	1,380'	0.000	0.000	0.000	0.000	0.001	0.001	0.04	No
R5	1,393'	0.000	0.000	0.000	0.000	0.001	0.001	0.04	No
R6	106'	0.000	0.004	0.009	0.010	0.024	0.024	0.04	No

¹Construction noise source and receiver locations are shown on Exhibit 10-A.

²Distance from receiver building facade to Project construction boundary (Project site boundary).

³Based on the Vibration Source Levels of Construction Equipment (Table 10-10).

⁴City of Lake Elsinore Municipal Code, Section 17.176.080[G], (Appendix 3.1)

⁵Does the peak vibration exceed the acceptable vibration thresholds?

"PPV" = Peak Particle Velocity

11 REFERENCES

1. **California Natural Resources Agency.** *2024 California Environmental Quality Act (CEQA) Statue and Guidelines.* s.l. : Association of Environmental Professionals.
2. **EPD Solutions, Inc.** *Baker Lake Elsinore Traffic Impact Analysis.* 2024.
3. **California Department of Transportation.** *Technical Noise Supplement - A Technical Supplement to the Traffic Noise Analysis Protocol.* Sacramento, CA : s.n., September 2013.
4. **Environmental Protection Agency Office of Noise Abatement and Control.** *Information on Levels of Environmental Noise Requisite to Protect Public Health and Welfare with an Adequate Margin of Safety.* March 1974. EPA/ONAC 550/9/74-004.
5. **U.S. Department of Transportation, Federal Highway Administration, Office of Environment and Planning, Noise and Air Quality Branch.** *Highway Traffic Noise Analysis and Abatement Policy and Guidance.* December 2011.
6. **U.S. Department of Transportation Federal Highway Administration.** *Highway Noise Barrier Design Handbook.* 2001.
7. **U.S. Department of Transportation, Federal Highway Administration.** *Highway Traffic Noise in the United States, Problem and Response.* April 2000. p. 3.
8. **U.S. Environmental Protection Agency Office of Noise Abatement and Control.** *Noise Effects Handbook-A Desk Reference to Health and Welfare Effects of Noise.* October 1979 (revised July 1981). EPA 550/9/82/106.
9. **U.S. Department of Transportation, Federal Transit Administration.** *Transit Noise and Vibration Impact Assessment Manual, FTA Report No. 0123.* September 2018.
10. **California Department of Transportation.** *Transportation and Construction Vibration Guidance Manual.* April 2020.
11. **Office of Planning and Research.** *State of California General Plan Guidelines.* October 2017.
12. **City of Lake Elsinore.** *City of Lake Elsinore General Plan Section 3.0: Public Safety & Welfare.* December 2011.
13. —. *Municipal Code, Chapter 17.176 Noise Control.*
14. **U.S. Department of Transportation, Federal Highway Administration.** *FHWA Highway Construction Noise Handbook.* Final Report August 2006.
15. **California Court of Appeal.** *Gray v. County of Madera, F053661.* 167 Cal.App.4th 1099; - Cal.Rptr.3d, October 2008.
16. **Federal Interagency Committee on Noise.** *Federal Agency Review of Selected Airport Noise Analysis Issues.* August 1992.
17. **California Department of Transportation.** *Traffic Noise Analysis Protocol for New Highway Construction, Reconstruction, and Retrofit Barrier Projects.* May 2011.
18. **American National Standards Institute (ANSI).** *Specification for Sound Level Meters ANSI S1.4-2014/IEC 61672-1:2013.*
19. **U.S. Department of Transportation, Federal Highway Administration.** *FHWA Highway Traffic Noise Prediction Model.* December 1978. FHWA-RD-77-108.

20. **California Department of Transportation, Office of Environmental Engineering.** *Use of California Vehicle Noise Reference Energy Mean Emission Levels (Calveno REMELs) in FHWA Highway Traffic Noise Prediction.* September 1995. TAN 95-03.
21. **California Department of Transportation.** *Traffic Noise Attenuation as a Function of Ground and Vegetation Final Report.* June 1995. FHWA/CA/TL-95/23.
22. **U.S. Department of Transportation, Federal Highway Administration, Office of Environment and Planning.** *FHWA Roadway Construction Noise Model.* January, 2006.
23. **California Department of Transportation.** *Technical Noise Supplement.* November 2009.
24. —. *Traffic Noise Analysis Protocol.* April 2020.

12 CERTIFICATION

The contents of this noise study report represent an accurate depiction of the noise environment and impacts associated with the proposed Baker Lake Elsinore Project. The information contained in this noise study report is based on the best available data at the time of preparation. If you have any questions, please contact me directly at (949) 584-3148.

Bill Lawson, P.E., INCE
Principal
URBAN CROSSROADS, INC.
1133 Camelback #8329
Newport Beach, CA 92658
(949) 581-3148
blawson@urbanxroads.com



EDUCATION

Master of Science in Civil and Environmental Engineering
California Polytechnic State University, San Luis Obispo • December, 1993

Bachelor of Science in City and Regional Planning
California Polytechnic State University, San Luis Obispo • June, 1992

PROFESSIONAL REGISTRATIONS

PE – Registered Professional Traffic Engineer – TR 2537 • January, 2009

AICP – American Institute of Certified Planners – 013011 • June, 1997–January 1, 2012

PTP – Professional Transportation Planner • May, 2007 – May, 2013

INCE – Institute of Noise Control Engineering • March, 2004

PROFESSIONAL AFFILIATIONS

ASA – Acoustical Society of America
ITE – Institute of Transportation Engineers

PROFESSIONAL CERTIFICATIONS

Certified Acoustical Consultant – County of San Diego • March, 2018

Certified Acoustical Consultant – County of Orange • February, 2011

FHWA-NHI-142051 Highway Traffic Noise Certificate of Training • February, 2013

This page intentionally left blank

APPENDIX 3.1:

CITY OF LAKE ELSINORE MUNICIPAL CODE

This page intentionally left blank

Chapter 17.176

NOISE CONTROL

Sections:

- 17.176.010 Purpose.
- 17.176.020 Definitions.
- 17.176.030 Authority and duties of the Noise Control Office(r) (NCO).
- 17.176.040 General noise regulations.
- 17.176.050 Noise measurement procedure.
- 17.176.060 Exterior noise limits.
- 17.176.070 Interior noise standards.
- 17.176.080 Prohibited acts.
- 17.176.090 Motor vehicles operating on public right-of-way.
- 17.176.100 Special provisions – Exemptions.
- 17.176.110 Special variances.

17.176.010 Purpose.

In order to control unnecessary, excessive and annoying noise and vibration in the City, it is hereby declared to be the policy of the City to prohibit such noise and vibration generated from or by all sources as specified in this chapter. It shall be the policy of the City to maintain quiet in those areas which exhibit low noise levels and to implement programs aimed at reducing noise in those areas within the City where noise levels are above acceptable values.

It is determined that certain noise levels and vibrations are detrimental to the public health, welfare and safety, and are contrary to public interest. Therefore, the City Council does ordain and declare that creating, maintaining, causing or allowing to be created, caused or maintained, any noise or vibration in a manner prohibited by or not in conformity with the provisions of this chapter, is a public nuisance and shall be punishable as such. [Ord. 772 § 17.78.010, 1986. Code 1987 § 17.78.010].

17.176.020 Definitions.

All terminology used in this chapter, not defined below, shall be in conformance with applicable publications of the American National Standards Institute (ANSI) or its successor body.

The following words, phrases and terms as used in this chapter shall have the meaning as indicated below:

“A-weighted sound level” means the sound level in decibels as measured on a sound level meter using the A-weighting network. The level so read is designated dB(A) or dBA.

“Agricultural property” means a parcel of real property of not less than 10 contiguous acres in size, which is undeveloped for any use other than agricultural purposes.

“Ambient noise level” means the composite of noise from all sources near and far. In this context, the ambient noise level constitutes the normal of existing level of environmental noise at a given location.

“Commercial area” means property which is zoned for commercial purposes, including, but not limited to, retail and wholesale businesses, personal services, and professional offices.

“Construction” means any site preparation, assembly, erection, substantial repair, alteration, or similar action, for or of public or private rights-of-way, structures, utilities or similar property.

“Cumulative period” means an additive period of time composed of individual time segments which may be continuous or interrupted.

“Decibel” means a unit for measuring the amplitude of a sound, equal to 20 times the logarithm to the ratio of the sound measured to the reference pressure, which is 20 micropascals.

“Demolition” means any dismantling, intentional destruction or removal of structures, utilities, public or private right-of-way surfaces, or similar property.

“Emergency work” means any work performed for the purpose of preventing or alleviating the physical trauma or property damage threatened or caused by an emergency.

“Fixed noise source” means a stationary device which creates sounds while fixed or motionless, including, but not limited to, residential, agricultural, industrial and commercial machinery and equipment, pumps, fans, compressors, air conditioners, and refrigeration.

“Gross vehicle weight rating (GVWR)” means the value specified by the manufacturer as the recommended maximum loaded weight of a single motor vehicle. In cases where trailers and tractors are separable, the gross combination weight rating, which is the value specified by the manufacturer as the recommended maximum loaded weight of the combination vehicle, shall be used.

“Impulsive sound” means sound of short duration, usually less than one second, with an abrupt onset and rapid decay. Examples of sources of impulsive sound include explosions, drop forge impacts, and the discharge of firearms.

“Industrial area” means property which is zoned for manufacturing and related uses.

“Intrusive noise” means that noise which intrudes over and above the existing ambient noise at a given location. The relative intrusiveness of a sound depends upon its amplitude, duration, frequency and time of occurrence, and tonal or informational content as well as the prevailing ambient noise level.

“Licensed” means the possession of a formal license or a permit issued by the appropriate jurisdictional authority; or, where no permits or licenses are issued, the sanctioning of the activity by the jurisdiction as noted in public record.

“Mobile noise source” means any noise source other than a fixed source.

“Motor vehicle” shall include any and all self-propelled vehicles as defined in the California Motor Vehicle Code, including all on-highway type motor vehicles subject to registration under said code, and all off-highway type motor vehicles subject to identification under said code.

“Motorboat” means any vessel propelled by machinery, whether or not such machinery is the principal source of propulsion but shall not include a vessel which has a valid marine document issued by the Bureau of Customs of the United States government or any Federal agency successor thereto (Section 651(d), Harbors and Navigation Code).

“Muffler or sound dissipative device” means a device consisting of a series of chambers or baffle plates, or other mechanical design, for the purpose of receiving exhaust gas from an internal combustion engine, and effective in reducing noise.

“Noise Control Officer (NCO)” means a person or persons designated by the Community Development Director as responsible for enforcement of this chapter.

“Noise disturbance” means any sound which, as judged by the Noise Control Officer, (1) endangers or injures the safety or health of human beings or animals, or (2) annoys or disturbs reasonable persons of normal sensitivities, or (3) endangers or injures personal or real property, or (4) violates the factors set forth in LEMC 17.176.040. Compliance with the quantitative standards as listed herein shall constitute elimination of a noise disturbance.

“Noise sensitive zone” means any area designated pursuant to LEMC 17.176.070 for the purpose of ensuring exceptional quiet.

“Noise zone” means any defined areas or regions of a generally consistent land use wherein the ambient noise levels are within a range of five dB.

“Person” means any individual, association, partnership, or corporation, and includes any officer, employee, department, agency or instrumentality of a State or any political subdivision of a State.

“Powered model vehicle” means any self-propelled, airborne, waterborne, or land-borne plane, vessel, or vehicle, which is not designed to carry persons, including, but not limited to, any model airplane, boat, car, or rocket.

“Public right-of-way” means any street, avenue, boulevard, highway, sidewalk or alley or similar place which is owned or controlled by a governmental entity.

“Public space” means any real property or structures thereon which are owned or controlled by a governmental entity.

“Pure tone” means any sound which can be judged as audible as a single pitch or a set of single pitches by the Noise Control Officer. For the purposes of this chapter, a pure tone shall exist if the one-third octave band sound pressure level in the band with the tone exceeds the arithmetic average of the sound pressure levels of the two contiguous one-third octave bands by five dB for center frequencies of 500 Hz and above and by eight dB for center frequencies between 160 and 400 Hz and by 15 dB for center frequencies less than or equal to 125 Hz.

“Real property boundary” means an imaginary line along the ground surface, and its vertical extension, which separates the real property owned by one person from that owned by another person, but not including intrabuilding real property divisions.

“Residential area” means property which is zoned for residential uses.

“Sound amplifying equipment” means any device for the amplification of the human voice, music, or any other sound, excluding standard automobile radios when used and heard only by the occupants of the vehicle in which the radio is installed, and, as used in this chapter, warning devices on authorized emergency vehicles or horns or other warning devices on any vehicle used only for traffic safety purposes.

“Sound level meter” means an instrument, including a microphone, an amplifier, an output meter, and frequency weighting networks for the measurement of sound levels, which meets or exceeds the requirements pertinent for type S2A meters in American National Standards Institute specifications for sound level meters, S1.4-1971, or the most recent revision thereof.

“Sound truck” means any motor vehicle, or any other vehicle, regardless of motive power, whether in motion or stationary, having mounted thereon, or attached thereto, any sound amplifying equipment.

“Vibration perception threshold” means the minimum ground- or structure-borne vibrational motion necessary to cause a normal person to be aware of the vibration by such direct means as, but not limited to, sensation by touch or visual observation of moving objects. The perception threshold shall be presumed to be a motion velocity of 0.01 inches per second over the range of one to 100 Hz.

“Weekday” means any day, Monday through Friday, which is not a legal holiday. [Ord. 772 § 17.78.020, 1986. Code 1987 § 17.78.020].

17.176.030 Authority and duties of the Noise Control Office(r) (NCO).

A. Lead Agency. The noise control program established by this chapter shall be administered by the Community Development Director.

B. Powers. In order to implement and enforce this chapter and for the general purpose of noise abatement and control, the NCO shall have, in addition to any other authority vested in it, the power to:

1. Conduct, or cause to be conducted, studies, research, and monitoring related to noise, including joint cooperative investigation with public or private agencies, and the application for, and acceptance of, grants.
2. On all public and private projects which are likely to cause noise in violation of this chapter and which are subject to mandatory review or approval by other departments.

- a. Review for compliance with the intent and provisions of this chapter.
- b. Require sound analyses which identify existing and projected noise sources and associated noise levels.
- c. Require usage of adequate measures to avoid violation of any provision of this chapter.

3. Upon presentation of proper credentials, enter and/or inspect any private property, place, report, or records at any time when granted permission by the owner or by some other person with apparent authority to act for the owner. When permission is refused or cannot be obtained, a search warrant may be obtained from a court of competent jurisdiction upon showing of probable cause to believe that a violation of this chapter may exist. Such inspection may include administration of any necessary tests.

4. Prepare recommendations, to be approved by the City Council, for the designation of noise sensitive zones which contain noise sensitive activities.

5. Prepare recommendations, based upon noise survey data and analytical studies, to be approved by the City Council, for the designation of zones of similar ambient environmental noise within regions of generally consistent land use. These zones shall be identified in terms of their day and nighttime ambient noise levels and their land use classifications as given in LEMC 17.176.060, Table 1. [Ord. 772 § 17.78.030, 1986. Code 1987 § 17.78.030].

17.176.040 General noise regulations.

Notwithstanding any other provision of this chapter, and in addition thereto, it shall be unlawful for any person to willfully or negligently make or continue, or cause to be made or continued, any loud, unnecessary, or unusual noise which disturbs the peace and quiet of any neighborhood or which causes any discomfort or annoyance to any reasonable person of normal sensitiveness residing in the area.

The factors which shall be considered in determining whether a violation of the provisions of this section exists shall include, but not be limited to, the following:

- A. The sound level of the objectionable noise.
- B. The sound level of the ambient noise.
- C. The proximity of the noise to residential sleeping facilities.
- D. The nature and zoning of the area within which the noise emanates.
- E. The number of persons affected by the noise source.
- F. The time of day or night the noise occurs.
- G. The duration of the noise and its tonal, informational or musical content.
- H. Whether the noise is continuous, recurrent, or intermittent.
- I. Whether the noise is produced by a commercial or noncommercial activity. [Ord. 772 § 17.78.040, 1986. Code 1987 § 17.78.040].

17.176.050 Noise measurement procedure.

A. Upon receipt of a complaint from a citizen, the Noise Control Office(r) or his agent, equipped with sound level measurement equipment satisfying the requirements specified in LEMC 17.176.020, shall investigate the complaint. The investigation shall consist of a measurement and the gathering of data to adequately define the noise problem and shall include the following:

1. Nonacoustic Data.
 - a. Type of noise source.

- b. Location of noise source relative to complainant's property.
- c. Time period during which noise source is considered by complainant to be intrusive.
- d. Total duration of noise produced by noise source.
- e. Date and time of noise measurement survey.

B. Noise Measurement Procedure. Utilizing the A-weighting scale of the sound level meter and the "slow" meter response (use "fast" response for impulsive type sounds), the noise level shall be measured at a position or positions at any point on the receiver's property.

In general, the microphone shall be located four to five feet above the ground; 10 feet or more from the nearest reflective surface where possible. However, in those cases where another elevation is deemed appropriate, the latter shall be utilized. If the noise complaint is related to interior noise levels, interior noise measurements shall be made within the affected residential unit. The measurements shall be made at a point at least four feet from the wall, ceiling, or floor nearest the noise source, with windows in the normal seasonal configuration. Calibration of the measurement equipment, utilizing an acoustic calibration, shall be performed immediately prior to recording any noise data. [Ord. 772 § 17.78.050, 1986. Code 1987 § 17.78.050].

17.176.060 Exterior noise limits.

A. Maximum Permissible Sound Levels by Receiving Land Use.

- 1. The noise standards for the various categories of land use identified by the Noise Control Office(r) as presented in Table 1 shall, unless otherwise specifically indicated, apply to all such property within a designated zone.
- 2. No person shall operate, or cause to be operated, any source of sound at any location within the incorporated City or allow the creation of any noise on property owned, leased, occupied or otherwise controlled by such person, which causes the noise level when measured on any other property, either incorporated or unincorporated, to exceed:
 - a. The noise standard for that land use as specified in Table 1 for a cumulative period of more than 30 minutes in any hour; or
 - b. The noise standard plus five dB for a cumulative period of more than 15 minutes in any hour; or
 - c. The noise standard plus 10 dB for a cumulative period of more than five minutes in any hour; or
 - d. The noise standard plus 15 dB for a cumulative period of more than one minute in any hour; or
 - e. The noise standard plus 20 dB or the maximum measured ambient level, for any period of time.
- 3. If the measured ambient level differs from that permissible within any of the fast four noise limit categories above, the allowable noise exposure standard shall be adjusted in five dB increments in each category as appropriate to encompass or reflect said ambient noise level.

In the event the ambient noise level exceeds the fifth noise limit category, the maximum allowable noise level under this category shall be increased to reflect the maximum ambient noise level

- 4. If the measurement location is on a boundary between two different zones, the noise level limit applicable to the lower noise zone plus six dB shall apply.
- 5. If possible, the ambient noise shall be measured at the same location along the property line utilized in subsection (A)(2) of this section with the alleged offending noise source inoperative. If, for any reason, the alleged offending noise source cannot be shut down, the ambient noise must be estimated by performing a measurement in the same general area of the source but at a sufficient distance such that the noise from the source is at least 10 dB below the ambient in order that only the ambient level be measured. If the difference

between the ambient and the noise source is five to 10 dB, then the level of the ambient itself can be reasonably determined by subtracting a one-decibel correction to account for the contribution of the source.

B. Correction for Character of Sound. In the event the alleged offensive noise, as judged by the Noise Control Officer, contains a steady, audible tone such as a whine, screech, or hum, or is a repetitive noise such as hammering or riveting, or contains music or speech conveying informational content, the standard limits set forth in Table 1 shall be reduced by five dB.

TABLE 1
EXTERIOR NOISE LIMITS
(Levels Not to Be Exceeded More Than 30 Minutes in Any Hour)

Receiving Land Use Category	Time Period	Noise Level (dBA)
Single-Family Residential	10:00 p.m. – 7:00 a.m.	40
	7:00 a.m. – 10:00 p.m.	50
Multiple Dwelling Residential	10:00 p.m. – 7:00 a.m.	45
	7:00 a.m. – 10:00 p.m.	50
Public Space		
Limited Commercial and Office	10:00 p.m. – 7:00 a.m.	55
	7:00 a.m. – 10:00 p.m.	60
General Commercial	10:00 p.m. – 7:00 a.m.	60
	7:00 a.m. – 10:00 p.m.	65
Light Industrial	Anytime	70
Heavy Industrial	Anytime	75

[Ord. 772 § 17.78.060, 1986. Code 1987 § 17.78.060].

17.176.070 Interior noise standards.

A. Maximum Permissible Dwelling Interior Sound Levels.

1. The interior noise standards for multifamily residential dwellings as presented in Table 2 shall apply, unless otherwise specifically indicated, within all such dwellings with windows in their normal seasonal configuration.

TABLE 2

Noise Zone	Type of Land Use	Time Internal	Allowable Interior Noise Level (dBA)
All	Multifamily Residential	10:00 p.m. – 7:00 a.m. 7:00 a.m. – 10:00 p.m.	35 45

2. No person shall operate or cause to be operated within a dwelling unit, any source of sound or allow the creation of any noise which causes the noise level when measured inside a neighboring receiving dwelling unit to exceed:

- The noise standard as specified in Table 2 for a cumulative period of more than five minutes in any hour; or
- The noise standard plus five dB for a cumulative period of more than one minute in any hour; or
- The noise standard plus 10 dB or the maximum measured ambient, for any period of time.

3. If the measured ambient level differs from that permissible within any of the noise limit categories above, the allowable noise exposure standard shall be adjusted in five dB increments in each category as appropriate to reflect said ambient noise level.

B. Correction for Character of Sound. In the event the alleged offensive noise, as judged by the Noise Control Officer, contains a steady, audible tone such as a whine, screech, or hum, or is a repetitive noise such as hammering or riveting, or contains music or speech conveying informational content, the standard limits set forth in Table 2 shall be reduced by five dB. [Ord. 772 § 17.78.070, 1986. Code 1987 § 17.78.070].

17.176.080 Prohibited acts.

No person shall unnecessarily make, continue, or cause to be made or continued, any noise disturbance. The following acts, and the causing or permitting thereof, are declared to be in violation of this chapter:

A. Operating, playing or permitting the operation or playing of any radio, television set, phonograph, drum, musical instrument, or similar device which produces or reproduces sound:

1. Between the hours of 10:00 p.m. and 7:00 a.m. in such a manner as to create a noise disturbance across a residential or commercial real property line or at any time to violate the provisions of LEMC 17.176.060(A), except for which a variance has been issued by the City.
2. In such a manner as to exceed the levels set forth for public space in Table 1, measured at a distance of at least 50 feet (15 meters) from such device operating on a public right-of-way or public space.

B. Using or operating for any purpose any loudspeaker, loudspeaker system, or similar device between the hours of 10:00 p.m. and 7:00 a.m., such that the sound therefrom creates a noise disturbance across a residential real property line, or at any time violates the provisions of LEMC 17.176.060(A), except for any noncommercial public speaking, public assembly or other activity for which a variance has been issued by the City.

C. Offering for sale, selling anything, or advertising by shouting or outcry within any residential or commercial area or noise sensitive zone of the City except by variance issued by the City. The provisions of this section shall not be construed to prohibit the selling by outcry of merchandise, food, and beverages at licensed sporting events, parades, fairs, circuses, or other similar licensed public entertainment events.

D. Owning, possessing or harboring any animal or bird which frequently or for long duration, howls, barks, meows, squawks, or makes other sounds which create a noise disturbance across a residential or commercial real property line or within a noise sensitive zone. This provision shall not apply to public zoos.

E. Loading, unloading, opening, closing or other handling of boxes, crates, containers, building materials, garbage cans, or similar objects between the hours of 10:00 p.m. and 7:00 a.m. in such a manner as to cause a noise disturbance across a residential real property line or at any time to violate the provisions of LEMC 17.176.060(A).

F. Construction/Demolition.

1. Operating or causing the operation of any tools or equipment used in construction, drilling, repair, alteration, or demolition work between weekday hours of 7:00 p.m. and 7:00 a.m., or at any time on weekends or holidays, such that the sound therefrom creates a noise disturbance across a residential or commercial real property line, except for emergency work of public service utilities or by variance issued by the City.
2. Noise Restrictions at Affected Properties. Where technically and economically feasible, construction activities shall be conducted in such a manner that the maximum noise levels at affected properties will not exceed those listed in the following schedule:

AT RESIDENTIAL PROPERTIES:

Mobile Equipment

Maximum noise levels for nonscheduled, intermittent, short-term operation (less than 10 days) of mobile equipment:

Type I Areas Single-Family Residential	Type II Areas Multifamily Residential	Type III Areas Semi-Residential/Commercial
--	---	---

Daily, except Sundays and Legal Holidays 7:00 a.m. to 7:00 p.m.	75 dBA	80 dBA	85 dBA
Daily, 7:00 p.m. to 7:00 a.m. and all day Sunday and Legal Holidays	60 dBA	65 dBA	70 dBA
Stationary Equipment			

Maximum noise levels for repetitively scheduled and relatively long-term operation (period of 10 days or more) of stationary equipment:

	Type I Areas Single-Family Residential	Type II Areas Multifamily Residential	Type III Areas Semi-Residential/Commercial
Daily, except Sundays and Legal Holidays 7:00 a.m. to 7:00 p.m.	60 dBA	65 dBA	70 dBA
Daily, 7:00 p.m. to 7:00 a.m. and all day Sunday and Legal Holidays	50 dBA	55 dBA	60 dBA

AT BUSINESS PROPERTIES:

Mobile Equipment

Maximum noise levels for nonscheduled, intermittent, short-term operation of mobile equipment:

Daily, including Sundays and Legal Holidays, all hours: maximum of 85 dBA.

Stationary Equipment

Maximum noise levels for repetitively scheduled and relatively long-term operation of stationary equipment:

Daily, including Sundays and Legal Holidays, all hours: maximum of 75 dBA.

3. All mobile or stationary internal combustion engine powered equipment or machinery shall be equipped with suitable exhaust and air intake silencers in proper working order.

G. Operating or permitting the operation of any device that creates a vibration which is above the vibration perception threshold of any individual at or beyond the property boundary of the source if on private property or at 150 feet (46 meters) from the source if on a public space or public right-of-way.

H. Powered Model Vehicles. Operating or permitting the operation of powered model vehicles:

1. Between the hours of 7:00 p.m. and 7:00 a.m. so as to create a noise disturbance across a residential or commercial real property line or at any time to violate the provisions of LEMC 17.176.060(A).
2. In such a manner as to exceed the levels set forth for public space land use in Table 1, measured at a distance not less than 100 feet (30 meters) from any point on the path of a vehicle operating on public space or public right-of-way.

I. Stationary Nonemergency Signaling Devices.

1. Sounding or permitting the sounding of any electronically amplified signal from any stationary bell, chime, siren, whistle, or similar device, intended primarily for nonemergency purposes, from any place, for more than 10 seconds in any hourly period.
2. Houses of religious worship shall be exempt from the operation of this provision.
3. Sound sources covered by this provision and not exempted under subsection (I)(2) of this section shall be exempted by a variance issued by the City.

J. Emergency Signaling Devices.

1. The intentional sounding or permitting the sounding outdoors of any fire, burglar, or civil defense alarm, siren, whistle, or similar stationary emergency signaling device, except for emergency purposes or for testing, as provided in subsection (J)(2) of this section.
2. a. Testing of a stationary emergency signaling system shall not occur before 7:00 a.m. or after 7:00 p.m. Any such testing shall use only the minimum cycle test time. In no case shall such test time exceed 60 seconds.
 - b. Testing of the complete emergency signaling system, including the functioning of the signaling device and the personnel response to the signaling device, shall not occur more than once in each calendar month. Such testing shall not occur before 7:00 a.m., or after 10:00 p.m. The time limit specified in subsection (J)(2)(a) of this section shall not apply to such complete system testing.
3. Sounding or permitting the sounding of any exterior burglar or fire alarm or any motor vehicle burglar alarm unless such alarm is terminated within 15 minutes of activation.

K. Noise Sensitive Zones.

1. Creating or causing the creation of any sound within any noise sensitive zone, so as to exceed the specified land use noise standards set forth in LEMC 17.176.060(A); provided, that conspicuous signs are displayed indicating the zone; or
2. Creating or causing the creation of any sound within or adjacent to any noise sensitive zone, containing a hospital, nursing home, school, court or other designated area, so as to interfere with the functions of such activity or annoy the occupants in the activity; provided, that conspicuous signs are displayed indicating the presence of the zone.

L. Domestic Power Tools and Machinery.

1. Operating or permitting the operation of any mechanically powered saw, sander, drill, grinder, lawn or garden tool, or similar tool between 10:00 p.m. and 7:00 a.m., so as to create a noise disturbance across a residential or commercial real property line.
2. Any motor, machinery, pump, such as swimming pool equipment, etc., shall be sufficiently enclosed or muffled and maintained so as not to create a noise disturbance in accordance with LEMC 17.176.060.

M. Residential Air-Conditioning or Air-Handling Equipment. Operating or permitting the operation of any air-conditioning or air-handling equipment in such a manner as to exceed any of the following sound levels:

Measurement Location	Units Installed before 1-1-80 dB(A)	Units Installed on or after 1-1-80 dB(A)
Any point on neighboring property line, 5 feet above grade level, no closer than 3 feet from any wall.	60	55
Center of neighboring patio, 5 feet above grade level, no closer than 3 feet from any wall.	55	50
Outside the neighboring living area window nearest the equipment location, not more than 3 feet from the window opening, but at least 3 feet from any other surface.	55	50

N. Places of Public Entertainment. Operating or permitting the operation or playing of any loudspeaker, musical instrument, motorized racing vehicle, or other source of sound in any place of public entertainment that exceeds 95

dBA as read on the slow response of a sound level meter at any point normally occupied by a customer, without a conspicuous and legible sign stating:

WARNING! SOUND LEVELS WITHIN MAY CAUSE HEARING IMPAIRMENT.

[Ord. 772 § 17.78.080, 1986. Code 1987 § 17.78.080].

17.176.090 Motor vehicles operating on public right-of-way.

Motor vehicles noise limits on a public right-of-way are regulated as set forth in the California Motor Vehicle Code, Sections 23130 and 23130.5. Equipment violations which create noise problems are covered under Sections 27150 and 27151. Any peace officer of any jurisdiction in California may enforce these provisions. Therefore, it shall be the policy of the City to enforce these sections of the California Motor Vehicle Code.

A. Refuse Collection Vehicles.

1. No person shall collect refuse with a refuse collection vehicle between the hours of 7:00 p.m. and 7:00 a.m. within or adjacent to a residential area or noise sensitive zone.
2. No person authorized to engage in waste disposal service or garbage collection shall operate any truck-mounted waste or garbage loading and/or compacting equipment or similar device in any manner so as to create any noise exceeding the following levels, measured at a distance of 50 feet from the equipment in an open area:
 - a. New equipment purchased or leased on or after a date six months from the effective date of the ordinance codified in this chapter: 80 dBA.
 - b. New equipment purchased or leased on or after 36 months from the effective date of the ordinance codified in this chapter: 75 dBA.
 - c. Existing equipment, on or after five years from the effective date of the ordinance codified in this chapter: 80 dBA.

B. Motor Vehicle Horns. It is unlawful for any person to sound a vehicular horn except as a warning signal (Motor Vehicle Code, Section 27001).

C. Motorized Recreational Vehicles Operating off Public Right-of-Way. No person shall operate or cause to be operated any motorized recreational vehicle off a public right-of-way in such a manner that the sound levels emitted therefrom violate the provisions of LEMC 17.176.060(A). This section shall apply to all motorized recreational vehicles whether or not duly licensed and registered, including, but not limited to, commercial or noncommercial racing vehicles, motorcycles, go carts, amphibious craft, campers, snowmobiles and dune buggies, but not including motorboats.

D. Reserved.

E. Vehicle, Motorboat, or Aircraft Repair and Testing.

1. Repairing, rebuilding, modifying, or testing any motor vehicle, motorboat, or aircraft in such a manner as to create a noise disturbance across a residential real property line, or at any time to violate the provisions of LEMC 17.176.060(A).
2. Nothing in this section shall be construed to prohibit, restrict, penalize, enjoin, or in any manner regulate the movement of aircraft which are in all respects conducted in accordance with, or pursuant to, applicable Federal laws or regulations.

F. Standing Motor Vehicles. No person shall operate or permit the operation of any motor vehicle with a gross vehicle weight rating (GVWR) in excess of 10,000 pounds, or any auxiliary equipment attached to such a vehicle, for a period longer than 15 minutes in any hour while the vehicle is stationary, for reasons other than traffic congestion, on a public right-of-way or public space within 150 feet (46 meters) of a residential area or designated

noise sensitive zone, between the hours of 10:00 p.m. and 7:00 a.m. [Ord. 984, 1994; Ord. 772 § 17.78.090, 1986. Code 1987 § 17.78.090].

17.176.100 Special provisions – Exemptions.

The following activities shall be exempted from the provisions of this chapter:

- A. The emission of sound for the purpose of alerting persons to the existence of an emergency.
- B. The emission of sound in the performance of emergency work.
- C. Warning devices necessary for the protection of public safety, as for example, police, fire and ambulance sirens, and train horns.
- D. Regularly scheduled school bands, school athletic and school entertainment events between the hours of 8:45 a.m. and 10:00 p.m., provided a special events permit is also required for band activities on City streets.
- E. Regularly scheduled activities conducted on public parks, public playgrounds, and public or private school grounds. However, the use of public address or amplified music systems is not permitted to exceed the exterior noise standard of adjacent property at the property line.
- F. All mechanical devices, apparatus or equipment which are utilized for the protection or salvage of agricultural crops during periods of potential or actual frost damage or other adverse weather conditions.
- G. Mobile noise sources associated with agricultural pest control through pesticide application; provided, that the application is made in accordance with restricted material permits issued by or regulations enforced by the Agricultural Commissioner.
- H. Mobile noise sources associated with agricultural operations, provided such operations take place on Monday through Friday, excepting legal holidays, between the hours of 7:00 a.m. and 6:00 p.m. All other operations shall comply with this chapter.
- I. Noise sources associated with the maintenance of real property, provided such operations take place on Monday through Friday, excepting legal holidays, between the hours of 7:00 a.m. and 6:00 p.m., or on holidays and weekends between the hours of 9:00 a.m. and 6:00 p.m. All other operations shall comply with this chapter.
- J. Any activity to the extent that regulation thereof has been preempted by State or Federal law. [Ord. 772 § 17.78.100, 1986. Code 1987 § 17.78.100].

17.176.110 Special variances.

A. The NCO is authorized to grant variances for exemption from any provision of this chapter, subject to limitations as to area, noise levels, time limits, and other terms and conditions as the NCO determines are appropriate to protect the public health, safety, and welfare from the noise emanating therefrom. This section shall in no way affect the duty to obtain any permit or license required by law for such activities.

B. Any person seeking a variance pursuant to this section shall file an application with the NCO. The application shall contain information which demonstrates that bringing the source of sound or activity for which the variance is sought into compliance with this chapter would constitute an unreasonable hardship on the applicant, on the community, or on other persons. The application shall be accompanied by a fee. A separate application shall be filed for each noise source; provided, however, that several mobile sources under common ownership, or several fixed sources on a single property may be combined into one application. Notice of an application for a variance shall be published according to City code. Any individual who claims to be adversely affected by allowance of the variance may file a statement with the NCO containing any information to support his claim. If at any time the NCO finds that a sufficient controversy exists regarding an application, a public hearing will be held.

C. In determining whether to grant or deny the application, the NCO shall balance the hardship on the applicant, the community, and other persons of not granting the variance against the adverse impact on the health, safety, and welfare of persons affected, the adverse impact on property affected, and any other adverse impacts of granting the variance. Applicants for variances and persons contesting variances may be required to submit such information as

the NCO may reasonably require. In granting or denying an application, the NCO shall keep on public file a copy of the decision and the reasons for denying or granting the variance.

D. Variances shall be granted by notice to the applicant containing all necessary conditions, including a time limit on the permitted activity. The variance shall not become effective until all conditions are agreed to by the applicant. Noncompliance with any condition of the variance shall terminate the variance and subject the person holding it to those provisions of this chapter for which the variance was granted.


E. A variance will not exceed 365 days from the date on which it was granted. Application for extension of time limits specified in variances or for modification of other substantial conditions shall be treated like applications for initial variances under subsection (B) of this section. [Ord. 772 § 17.78.110, 1986. Code 1987 § 17.78.110].

APPENDIX 5.1:


STUDY AREA PHOTOS

This page intentionally left blank

JN:15852

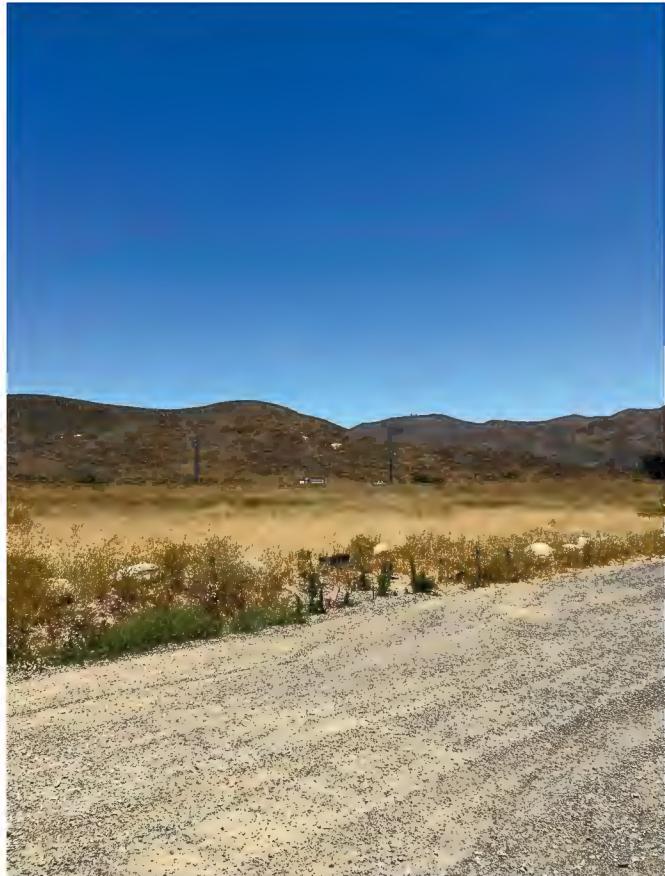

15852_L1_C 1.North
33, 42' 12.050000", 117, 22' 2.010000"

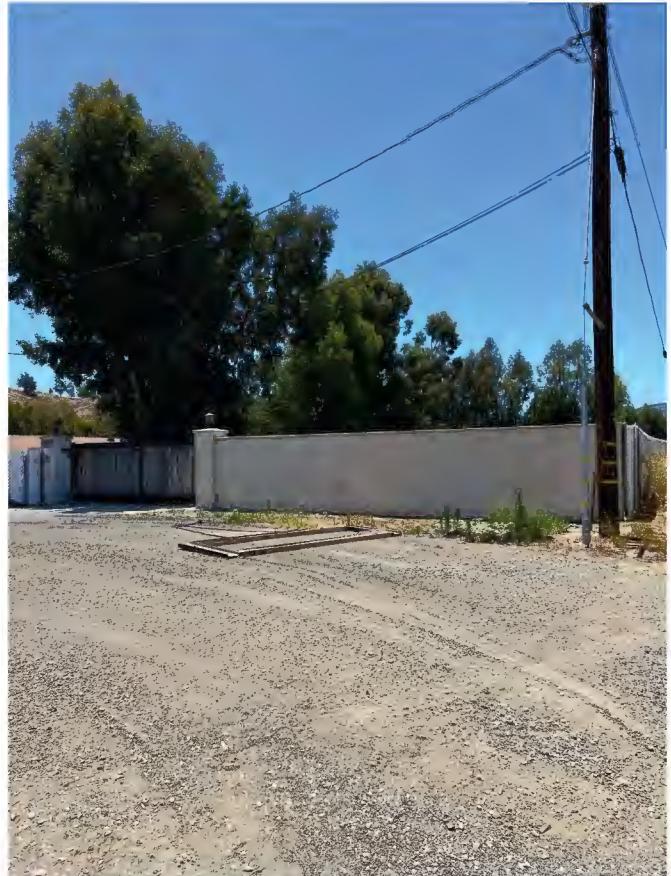

15852_L1_C 2.South
33, 42' 12.060000", 117, 22' 2.040000"



15852_L1_C 3.East
33, 42' 12.050000", 117, 22' 1.980000"



15852_L1_C 4.West
33, 42' 12.140000", 117, 22' 2.120000"




15852_L2_D 1.North
33, 42' 12.290000", 117, 22' 29.530000"



15852_L2_D 2.South
33, 42' 12.070000", 117, 22' 29.530000"



15852_L2_D 3.East
33, 42' 12.090000", 117, 22' 29.530000"

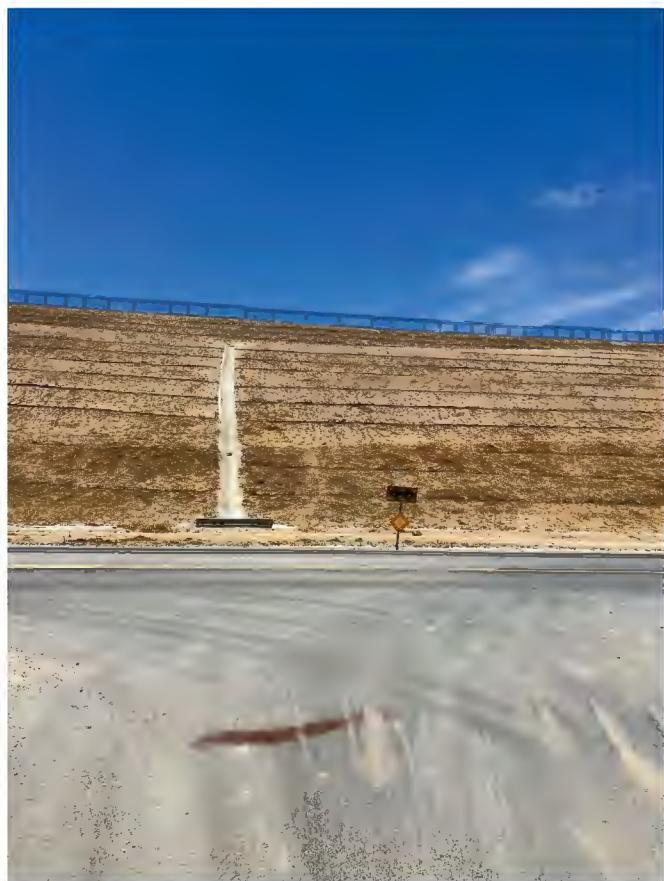

15852_L2_D 4.West
33, 42' 12.070000", 117, 22' 29.530000"

JN:15852



15852_L3_E 1.North
33, 41' 47.620000", 117, 21' 59.710000"



15852_L3_E 2.South
33, 41' 47.570000", 117, 21' 59.730000"



15852_L3_E 3.East
33, 41' 47.440000", 117, 21' 59.840000"



15852_L3_E 4.West
33, 41' 47.410000", 117, 21' 59.870000"




15852_L4_G 1.North
33, 41' 35.200000", 117, 21' 50.370000"



15852_L4_G 2.South
33, 41' 35.170000", 117, 21' 50.280000"



15852_L4_G 3.East
33, 41' 35.170000", 117, 21' 50.230000"

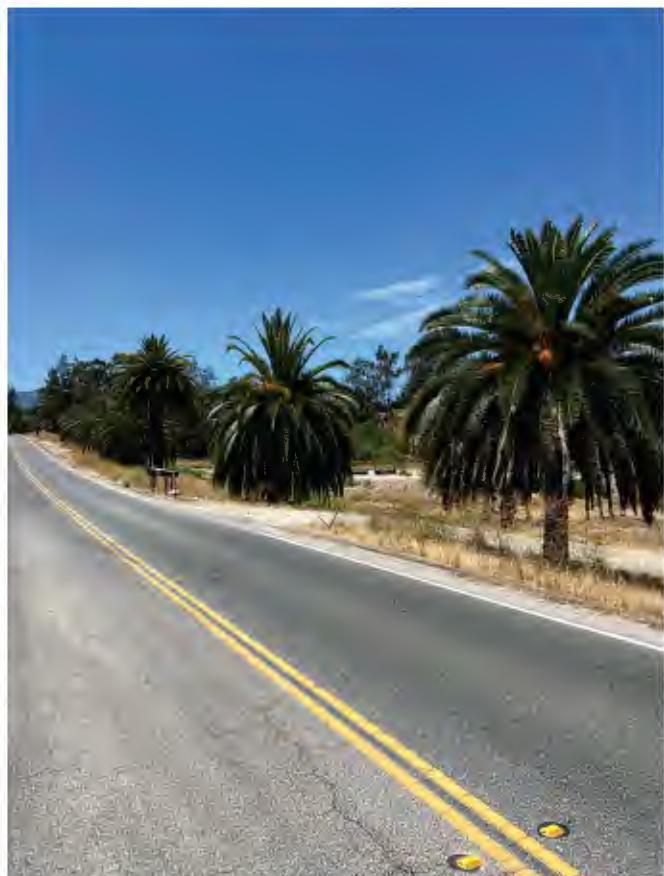

15852_L4_G 4.West
33, 41' 35.170000", 117, 21' 50.310000"

JN:15852



15852_L5_H 1.North
33, 41' 29.980000", 117, 21' 36.440000"



15852_L5_H 2.South
33, 41' 30.170000", 117, 21' 36.580000"




15852_L5_H 3.East
33, 41' 30.200000", 117, 21' 36.630000"



15852_L5_H 4.West
33, 41' 30.130000", 117, 21' 37.050000"



15852_L6_I 1.North
33, 41' 52.770000", 117, 21' 24.250000"

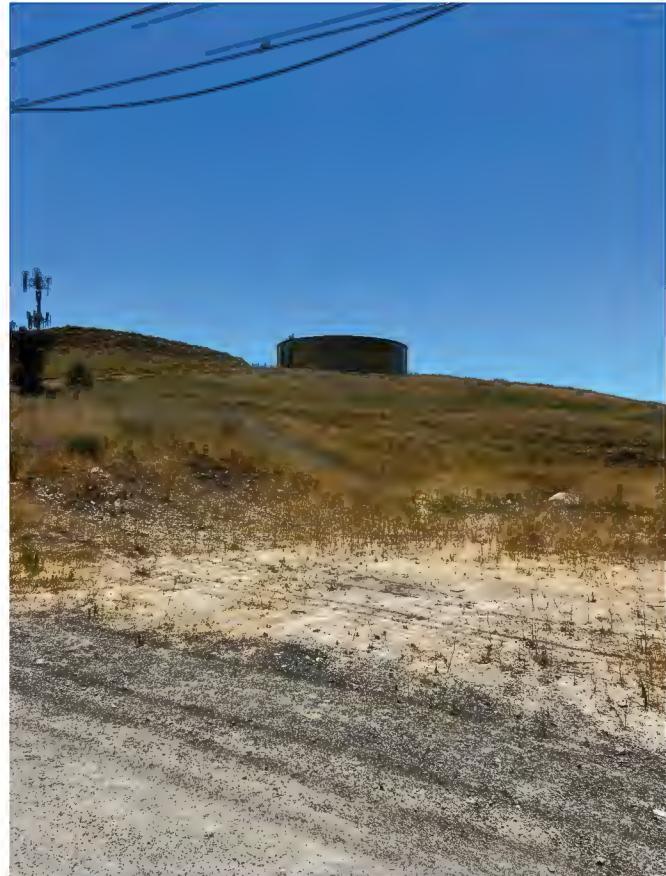

15852_L6_I 2.South
33, 41' 52.720000", 117, 21' 24.220000"



15852_L6_I 3.East
33, 41' 52.740000", 117, 21' 24.190000"



15852_L6_I 4.West
33, 41' 52.850000", 117, 21' 24.330000"

APPENDIX 5.2:

NOISE LEVEL MEASUREMENT WORKSHEETS

This page intentionally left blank


24-Hour Noise Level Measurement Summary

Date: Tuesday, June 25, 2024
 Project: Baker Lake Elsinore

Location: L1 - Located west of the site near the residence at 28750
 Source: Pierce St.

Meter: Piccolo II

J/N: 15852
 Analyst: Z. Ibrahim

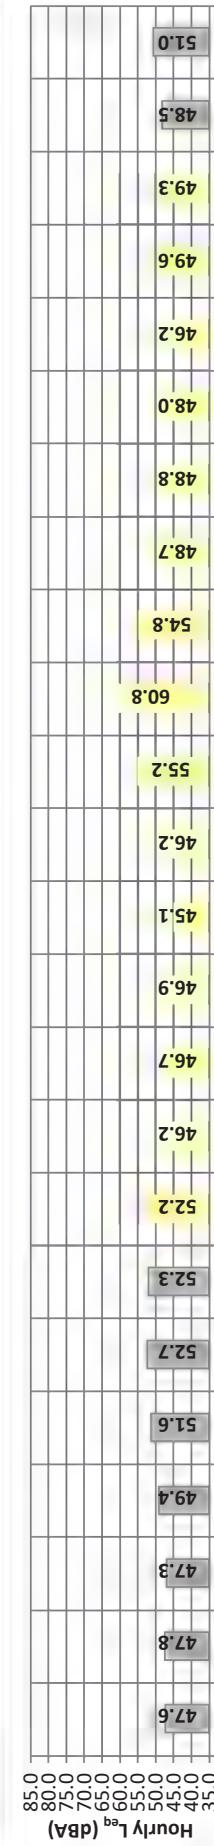

Timeframe	Hour	L_{eq}	L_{max}	L_{min}	L1%	L2%	L8%	L5%	L25%	L90%	L95%	L99%	L_{eq}	Adj. L_{eq}	Adj.	Adj. L_{eq}	24-Hour	Daytime CNEL	Nighttime CNEL	24-Hour	Daytime (7am-10pm)	Nighttime (10pm-7am)
Night	0	47.6	50.4	46.0	50.0	49.7	49.3	48.8	48.0	47.4	46.6	46.4	46.2	47.6	10.0	57.6	57.8	57.8	10.0	57.6	57.8	
	1	47.8	52.7	45.2	52.3	51.9	50.6	49.8	48.1	47.2	46.1	45.8	45.4	47.8	10.0	57.8	57.8	57.8	10.0	57.8	57.8	
	2	47.3	49.5	45.3	49.2	49.0	48.7	48.5	47.8	47.2	46.2	45.6	45.6	47.3	10.0	57.3	57.3	57.3	10.0	57.3	57.3	
	3	49.4	53.2	46.7	52.9	52.7	52.2	51.6	50.0	48.9	47.6	46.9	46.9	47.3	10.0	59.4	59.4	59.4	10.0	59.4	59.4	
	4	51.6	53.6	49.9	53.4	53.3	53.0	52.8	52.1	51.4	50.5	50.3	50.0	51.6	10.0	61.6	61.6	61.6	10.0	61.6	61.6	
	5	52.7	55.7	50.9	55.3	54.9	54.3	54.0	53.2	52.5	51.5	51.0	50.8	50.5	52.7	10.0	62.7	62.7	62.7	10.0	62.7	62.7
	6	52.3	54.8	50.4	54.6	54.4	54.0	53.7	52.9	52.2	51.0	50.8	50.5	52.3	10.0	62.3	62.3	62.3	10.0	62.3	62.3	
	7	52.2	63.8	38.1	63.3	62.3	59.3	57.3	50.8	44.9	39.3	38.8	38.3	38.3	52.2	0.0	52.2	52.2	0.0	52.2	52.2	
	8	46.2	54.1	42.0	53.6	53.1	51.2	49.8	46.1	44.4	42.7	42.4	42.1	42.1	46.2	0.0	46.2	46.2	0.0	46.2	46.2	
	9	46.7	56.4	41.5	55.8	54.9	52.2	50.4	46.4	44.2	42.2	41.9	41.6	41.6	46.7	0.0	46.7	46.7	0.0	46.7	46.7	
Day	10	46.9	54.6	41.0	53.9	53.6	52.2	51.1	47.2	44.4	41.7	41.4	41.4	41.4	46.9	0.0	46.9	46.9	0.0	46.9	46.9	
	11	45.1	53.9	41.1	53.3	52.6	50.5	48.3	44.8	43.2	41.6	41.4	41.4	41.4	45.1	0.0	45.1	45.1	0.0	45.1	45.1	
	12	46.2	54.5	40.9	54.1	53.5	51.6	49.9	46.1	44.1	41.8	41.5	41.5	41.5	46.2	0.0	46.2	46.2	0.0	46.2	46.2	
	13	55.2	66.6	41.8	66.0	64.9	62.5	60.8	53.9	48.6	43.6	43.0	42.1	42.1	55.2	0.0	55.2	55.2	0.0	55.2	55.2	
	14	60.8	74.9	42.7	73.8	72.7	68.9	66.0	58.1	51.5	45.1	44.1	42.9	42.9	60.8	0.0	60.8	60.8	0.0	60.8	60.8	
	15	54.8	63.8	48.6	63.2	62.3	59.9	58.5	55.1	52.5	50.0	49.5	48.8	48.8	54.8	0.0	54.8	54.8	0.0	54.8	54.8	
	16	48.7	55.2	43.4	54.7	54.2	53.0	52.2	49.4	47.3	44.6	44.1	43.6	43.6	48.7	0.0	48.7	48.7	0.0	48.7	48.7	
	17	48.8	57.0	44.0	56.5	55.9	53.8	51.8	48.9	47.1	45.0	44.7	44.2	44.2	48.8	0.0	48.8	48.8	0.0	48.8	48.8	
	18	48.0	52.3	44.5	51.9	51.6	50.7	50.3	48.7	47.3	45.6	45.2	44.7	44.7	48.0	0.0	48.0	48.0	0.0	48.0	48.0	
	19	46.2	50.7	42.5	50.3	49.8	48.9	48.4	46.9	45.7	43.6	43.2	42.7	42.7	46.2	5.0	51.2	51.2	5.0	51.2	51.2	
	20	49.6	51.4	48.1	51.2	51.1	50.7	50.5	50.0	49.5	48.7	48.5	48.3	48.3	49.6	5.0	54.6	54.6	5.0	54.6	54.6	
	21	49.3	50.6	48.0	50.4	50.3	50.1	50.1	49.6	49.3	48.6	48.4	48.1	48.1	49.3	5.0	54.3	54.3	5.0	54.3	54.3	
	22	48.5	51.9	46.7	51.7	51.5	51.0	50.5	48.6	48.0	47.3	47.1	46.9	46.9	48.5	10.0	58.5	58.5	10.0	58.5	58.5	
	23	51.0	58.0	47.3	57.5	57.0	55.3	54.0	50.9	49.7	48.1	47.8	47.5	47.5	51.0	10.0	61.0	61.0	10.0	61.0	61.0	


24-Hour Noise Level Measurement Summary

Date: Tuesday, June 25, 2024
Project: Baker Lake Elsinore

Location: L2 - Located west of the site near the future residence at
Source: Florence Dr.

Meter: Piccolo II

J/N: 15852
Analyst: Z. Ibrahim

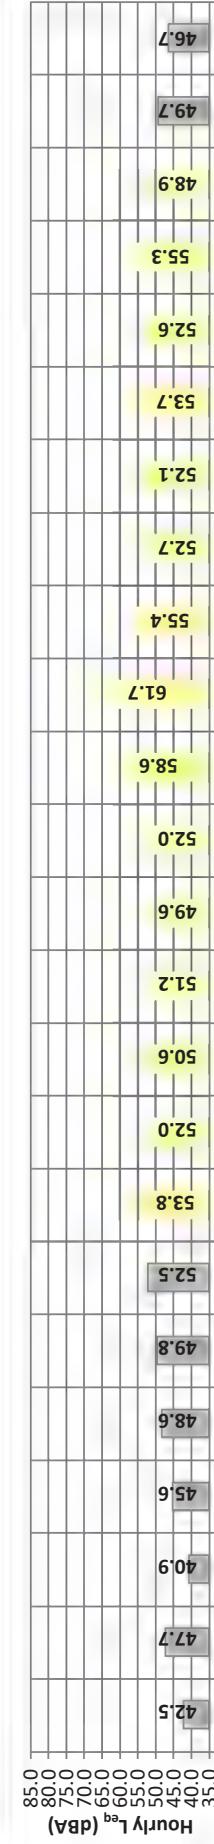

Timeframe	Hour	L_{eq}	L_{max}	L_{min}	11%	12%	15%	18%	25%	50%	90%	95%	99%	L_{eq}	Adj. L_{eq}
Night	0	42.5	51.9	38.6	51.3	50.4	47.2	45.3	42.2	40.4	39.1	38.9	38.7	42.5	10.0
	1	47.7	60.4	37.6	59.9	58.7	55.0	52.0	41.9	39.7	38.3	38.0	37.7	47.7	57.7
	2	40.9	50.7	36.7	50.3	49.3	45.9	43.6	40.0	39.0	37.5	37.1	36.8	40.9	10.0
	3	45.6	58.8	36.5	58.2	57.0	52.3	48.7	42.2	39.2	37.4	36.9	36.6	45.6	10.0
	4	48.6	60.9	38.0	60.5	59.6	56.1	53.0	45.1	41.0	38.7	38.4	38.1	48.6	10.0
	5	49.8	61.8	38.2	60.2	57.3	55.0	47.2	42.3	39.0	38.7	38.3	38.0	49.8	10.0
Day	6	52.5	63.3	40.4	62.8	62.1	59.7	57.9	51.4	45.9	41.4	41.0	40.6	52.5	10.0
	7	53.8	65.1	42.2	64.6	63.7	60.8	58.7	52.8	48.2	43.2	42.8	42.3	53.8	0.0
	8	52.0	63.5	38.6	63.1	62.3	59.2	57.0	50.3	45.2	40.2	39.5	38.9	52.0	0.0
	9	50.6	60.4	40.1	59.9	59.2	57.1	55.4	50.6	46.5	41.7	41.0	40.3	50.6	0.0
	10	51.2	62.6	37.9	62.2	61.3	58.1	55.8	49.9	45.2	40.0	39.1	38.2	51.2	0.0
	11	49.6	60.7	36.8	60.1	59.3	56.5	54.4	48.9	43.9	38.9	38.1	37.0	49.6	0.0
	12	52.0	63.1	39.1	62.5	61.4	58.8	57.0	51.2	46.2	40.9	40.0	39.2	52.0	0.0
	13	58.6	70.8	42.5	70.2	69.3	66.5	64.1	55.3	50.4	44.5	43.7	42.8	58.6	0.0
	14	61.7	75.2	42.7	74.3	73.2	69.6	67.0	59.4	53.0	45.2	44.2	43.0	61.7	0.0
	15	55.4	64.5	49.1	63.8	62.9	60.5	59.0	55.7	53.0	50.5	50.1	49.4	55.4	0.0
	16	52.7	63.7	37.7	63.3	62.4	59.6	57.6	52.4	47.0	40.0	38.9	37.9	52.7	0.0
	17	52.1	62.9	36.7	62.5	61.8	59.1	57.1	51.7	46.4	38.9	37.9	37.0	52.1	0.0
	18	53.7	66.3	36.3	65.8	64.6	60.6	57.8	51.7	46.1	38.2	37.3	36.5	53.7	0.0
	19	52.6	65.2	36.7	64.9	63.9	59.9	56.8	50.1	44.7	38.6	37.6	36.8	52.6	57.6
	20	55.3	71.0	39.4	68.3	65.9	56.2	49.2	44.8	40.4	39.9	39.5	39.5	55.3	5.0
	21	48.9	60.0	40.8	59.5	58.6	55.9	53.6	47.4	43.6	41.4	41.2	40.9	48.9	5.0
	22	49.7	63.8	39.0	63.1	61.5	56.2	52.4	45.3	41.7	39.6	39.4	39.1	49.7	10.0
	23	46.7	59.3	39.3	58.6	57.4	53.0	50.3	43.4	41.4	39.9	39.7	39.4	46.7	10.0

Timeframe	Hour	L_{eq}	L_{max}	L_{min}	11%	12%	15%	18%	25%	50%	90%	95%	99%	24-Hour CNEL	Daytime CNEL (7am-10pm)	Nighttime CNEL (10pm-7am)
Day	Min	48.9	60.0	36.3	59.5	58.6	53.6	47.4	43.6	38.2	37.3	36.5	36.7			
Day	Max	61.7	75.2	49.1	74.3	73.2	69.6	67.0	59.4	53.0	50.5	50.1	49.4			
Energy Average	Average:	54.9		Average:	64.4	63.5	60.1	57.8	51.8	46.9	41.5	40.8	40.0			
Night	Min	40.9	50.7	36.5	50.3	49.3	45.9	43.6	40.0	39.0	37.4	36.9	36.6	57.0	54.9	48.3
Night	Max	52.5	63.8	40.4	63.1	62.1	59.7	57.9	51.4	45.9	41.4	41.0	40.6	57.0	54.9	48.3
Energy Average	Average:	48.3		Average:	58.4	57.3	53.6	50.9	44.3	41.2	39.0	38.7	38.4			

24-Hour Noise Level Measurement Summary


Date: Tuesday, June 25, 2024
 Project: Baker Lake Elsinore

Location: L3 - Located southwest of the site near the residence at 29093
 Source: Gunder Av.

Meter: Piccolo II

J/N: 15852
 Analyst: Z. Ibrahim

Hourly L_{eq} dB Readings (unadjusted)

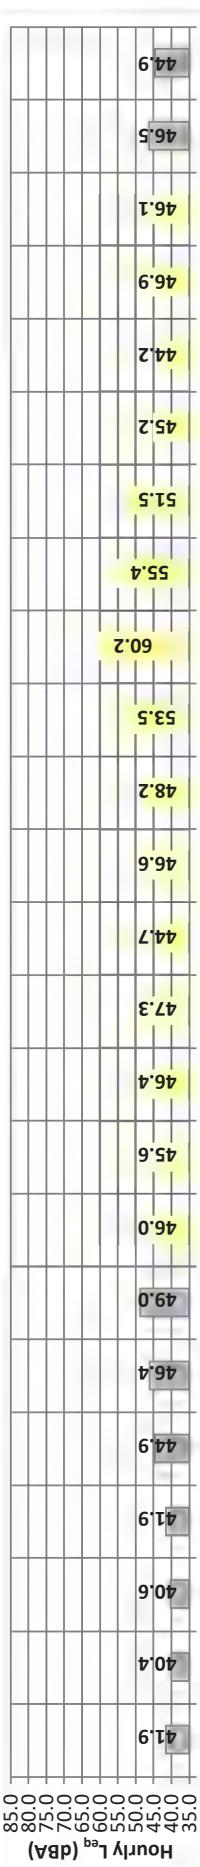

Hour Beginning

Timeframe	Hour	L_{eq}	L_{max}	L_{min}	L1%	L2%	L5%	L8%	L12%	L25%	L50%	L90%	L95%	L99%	L_{eq}	Adj. L_{eq}
Night	0	41.9	45.5	38.7	45.3	45.0	44.5	44.1	43.0	41.4	39.4	39.1	38.8	41.9	10.0	51.9
	1	40.4	44.0	37.1	43.7	43.5	43.0	42.5	41.3	39.8	37.9	37.6	37.2	40.4	10.0	50.4
	2	40.6	44.1	37.8	43.8	43.4	42.8	42.5	41.3	40.3	38.5	38.2	37.9	40.6	10.0	50.6
	3	41.9	44.3	39.5	44.1	44.0	43.6	43.4	42.7	41.8	40.1	39.9	39.6	41.9	10.0	51.9
	4	44.9	49.1	43.0	48.6	48.2	47.2	46.6	45.2	44.4	43.5	43.1	44.9	40.0	10.0	54.9
	5	46.4	50.0	44.6	49.7	49.4	48.7	48.0	46.7	46.0	45.1	44.9	44.7	46.4	10.0	56.4
Day	6	49.0	57.3	46.1	56.8	56.0	52.9	51.0	48.8	47.8	46.6	46.4	46.2	49.0	10.0	59.0
	7	46.0	51.7	43.2	51.2	50.7	49.2	48.4	46.3	45.2	43.8	43.6	43.3	46.0	0.0	46.0
	8	45.6	49.4	43.1	49.1	48.8	48.0	47.6	46.2	45.1	43.7	43.5	43.3	45.6	0.0	45.6
	9	46.4	51.7	43.3	51.3	51.0	49.9	49.4	46.9	45.4	43.8	43.6	43.4	46.4	0.0	46.4
	10	47.3	54.7	43.1	54.2	53.7	52.2	50.8	47.4	45.7	43.7	43.5	43.2	47.3	0.0	47.3
	11	44.7	50.4	41.4	50.0	49.4	48.5	47.7	45.0	43.6	42.1	41.8	41.5	44.7	0.0	44.7
	12	46.6	52.8	42.1	52.3	51.9	50.7	49.9	47.3	45.4	43.0	42.6	42.3	46.6	0.0	46.6
	13	48.2	57.6	41.8	57.1	56.4	54.4	52.5	47.8	45.1	42.7	42.3	41.9	48.2	0.0	48.2
	14	53.5	61.4	45.2	60.7	60.0	58.5	57.4	54.5	51.6	47.1	46.3	45.4	53.5	0.0	53.5
	15	60.2	68.5	51.6	67.5	66.5	64.9	64.1	61.0	58.4	54.0	53.1	51.8	60.2	0.0	60.2
	16	55.4	63.4	46.0	62.8	62.2	60.4	59.3	56.4	53.5	48.6	47.6	46.2	55.4	0.0	55.4
	17	51.5	58.3	44.3	57.7	57.0	55.9	55.1	52.5	50.1	46.1	45.4	44.7	51.5	0.0	51.5
	18	45.2	51.2	42.1	50.6	49.9	48.5	47.7	45.7	44.3	42.9	42.6	42.2	45.2	0.0	45.2
	19	44.2	49.4	41.7	49.0	48.6	47.3	46.3	44.5	43.6	42.3	42.1	41.8	44.2	5.0	49.2
	20	46.9	51.5	44.8	51.1	50.6	49.4	48.6	47.2	46.4	45.3	45.1	44.9	46.9	5.0	51.9
	21	46.1	48.9	44.6	48.6	48.4	47.7	47.2	46.5	46.0	45.1	44.9	44.7	46.1	5.0	51.1
	22	46.5	52.2	44.0	52.0	51.5	50.1	49.0	46.8	45.5	44.5	44.3	44.0	46.5	10.0	56.5
	23	44.9	48.9	43.0	48.6	48.3	47.4	46.8	45.3	44.4	43.4	43.3	43.1	44.9	10.0	54.9
Timeframe	Hour	L_{eq}	L_{max}	L_{min}	L1%	L2%	L5%	L8%	L12%	L25%	L50%	L90%	L95%	L99%	24-Hour CNEL	Daytime (7am-10pm) Nighttime (10pm-7am)
Day	Min	44.2	48.9	41.4	48.6	47.3	46.3	44.5	43.6	42.1	41.8	41.5	41.8	41.5	41.5	41.5
Day	Max	60.2	68.5	51.6	67.5	66.5	64.9	61.0	58.4	54.0	53.1	51.8	51.8	51.8	51.8	51.8
Energy Average	Average:	51.7	Average:	54.2	53.7	52.4	51.5	49.0	47.3	45.0	44.5	44.0	44.0	44.0	44.0	44.0
Night	Min	40.4	44.0	37.1	43.7	43.4	42.8	42.5	41.3	39.8	37.9	37.6	37.2	37.2	37.2	37.2
Night	Max	49.0	57.3	46.1	56.8	56.0	52.9	51.0	48.8	47.8	46.6	46.4	46.2	46.2	46.2	46.2
Energy Average	Average:	45.0	Average:	48.1	47.7	46.7	46.0	44.6	43.5	42.1	41.9	41.6	41.6	41.6	41.6	41.6

24-Hour Noise Level Measurement Summary


Date: Tuesday, June 25, 2024
 Project: Baker Lake Elsinore

Location: L4 - Located south of the site near the residence at 16950
 Source: Gunnerson St.

Meter: Piccolo II

J/N: 15852

Analyst: Z. Ibrahim

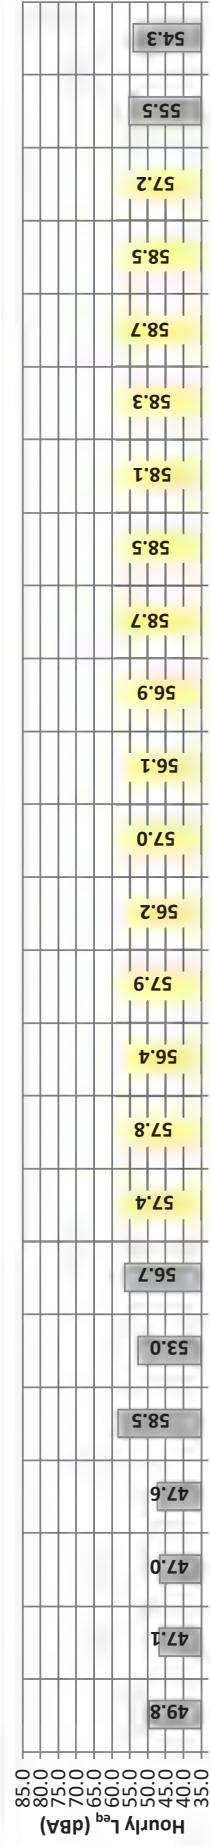

Timeframe	Hour	L_{eq}	L_{max}	L_{min}	L1%	L2%	L5%	L8%	L12%	L15%	L25%	L50%	L90%	L95%	L99%	L_{eq}	Adj. L_{eq}	Adj. L_{eq}
Night	0	49.8	62.2	37.0	61.9	61.5	58.7	54.9	40.8	39.2	37.7	37.5	37.2	49.8	10.0	59.8		
	1	47.1	58.4	39.1	58.1	57.8	55.5	52.0	41.8	41.0	40.0	39.7	39.4	47.1	10.0	57.1		
	2	47.0	59.5	38.9	59.0	58.4	55.0	50.7	41.1	40.5	39.6	39.4	39.1	47.0	10.0	57.0		
	3	47.6	60.7	39.8	60.2	59.3	54.3	50.1	42.3	41.4	40.4	40.2	40.0	47.6	10.0	57.6		
	4	58.5	71.6	40.9	71.3	70.5	67.7	62.7	47.6	42.3	41.4	41.2	41.0	58.5	10.0	68.5		
	5	53.0	65.8	42.1	65.5	64.9	61.5	57.2	45.2	43.9	42.7	42.5	42.2	53.0	10.0	63.0		
Day	6	56.7	69.0	41.7	68.1	65.0	62.4	50.4	45.0	42.4	42.4	41.9	41.7	56.7	10.0	66.7		
	7	57.4	69.2	37.8	69.0	68.4	65.6	63.3	52.6	44.0	39.2	38.7	38.1	57.4	0.0	57.4		
	8	57.8	70.6	39.2	70.2	69.4	66.3	62.9	51.4	44.8	40.3	39.8	39.3	57.8	0.0	57.8		
	9	56.4	68.5	40.3	68.2	67.5	64.8	62.7	50.7	44.7	41.4	41.0	40.5	56.4	0.0	56.4		
	10	57.9	69.9	38.8	69.5	68.9	66.7	63.7	53.6	45.2	39.8	39.3	38.9	57.9	0.0	57.9		
	11	56.2	66.7	37.5	66.4	65.9	64.0	62.6	54.5	44.2	38.9	38.1	37.7	56.2	0.0	56.2		
Night	12	57.0	68.2	38.3	68.0	67.5	65.2	63.2	53.9	45.3	39.9	39.3	38.4	57.0	0.0	57.0		
	13	56.1	67.5	38.7	67.2	66.7	64.1	61.9	53.1	45.1	39.8	39.4	38.8	56.1	0.0	56.1		
	14	56.9	68.3	38.5	68.0	67.4	64.8	62.8	53.9	44.7	39.4	39.0	38.6	56.9	0.0	56.9		
	15	58.7	69.9	40.4	69.6	68.9	66.2	64.5	57.2	49.3	42.1	41.3	40.6	58.7	0.0	58.7		
	16	58.5	71.1	37.7	70.7	70.0	66.2	63.6	54.8	44.7	38.8	38.2	37.8	58.5	0.0	58.5		
	17	58.1	70.8	37.9	69.9	68.7	65.5	63.7	55.6	44.6	39.0	38.5	38.1	58.1	0.0	58.1		
Day	18	58.3	69.3	38.7	69.0	68.4	66.0	64.0	57.1	46.8	40.1	39.4	38.8	58.3	0.0	58.3		
	19	58.7	70.2	37.2	69.9	69.2	66.4	64.5	56.8	47.2	38.4	37.8	37.4	58.7	5.0	63.7		
	20	58.5	70.6	41.3	70.2	69.5	66.6	64.1	54.8	45.7	42.4	42.1	41.7	58.5	5.0	63.5		
	21	57.2	69.5	42.5	69.1	68.4	65.3	62.6	52.3	44.8	43.0	42.8	42.6	57.2	5.0	62.2		
	22	55.5	68.0	39.4	67.6	67.0	63.9	60.9	49.6	41.5	39.9	39.7	39.5	55.5	10.0	65.5		
	23	54.3	66.2	39.3	65.9	65.4	62.9	60.1	49.5	41.6	39.8	39.6	39.4	54.3	10.0	64.3		
Timeframe	Hour	L_{eq}	L_{max}	L_{min}	L1%	L2%	L5%	L8%	L12%	L15%	L25%	L50%	L90%	L95%	L99%	24-Hour CNEL	Daytime (7am-10pm)	Nighttime (10pm-7am)
Day	Min	56.1	66.7	37.2	66.4	65.9	64.0	61.9	50.7	44.0	38.4	37.8	37.4	42.6				
Day	Max	58.7	71.1	42.5	70.7	66.7	64.5	57.2	49.3	43.0	45.4	40.2	39.7	39.2				
Energy Average	57.7	Average:	69.0	68.3	65.6	63.3	54.2	45.4	40.2	39.7	37.7	37.5	37.2	39.2				
Night	Min	47.0	58.4	37.0	58.1	57.8	54.3	50.1	40.8	39.2	37.7	37.5	37.2	39.2				
Night	Max	58.5	71.6	42.1	71.3	70.5	67.7	62.7	50.4	45.0	42.8	42.5	42.2	40.0				
Energy Average	54.0	Average:	64.3	63.7	60.5	56.8	45.4	41.8	40.5	40.3	39.5	39.2	37.2	39.2				

24-Hour Noise Level Measurement Summary


Date: Tuesday, June 25, 2024
 Project: Baker Lake Elsinore

Location: L5 - Located south of the site near the residence at 17250
 Source: Gunnerson St.

Meter: Piccolo II

J/N: 15852
 Analyst: Z. Ibrahim

Hourly L_{eq} (dB) (unadjusted)

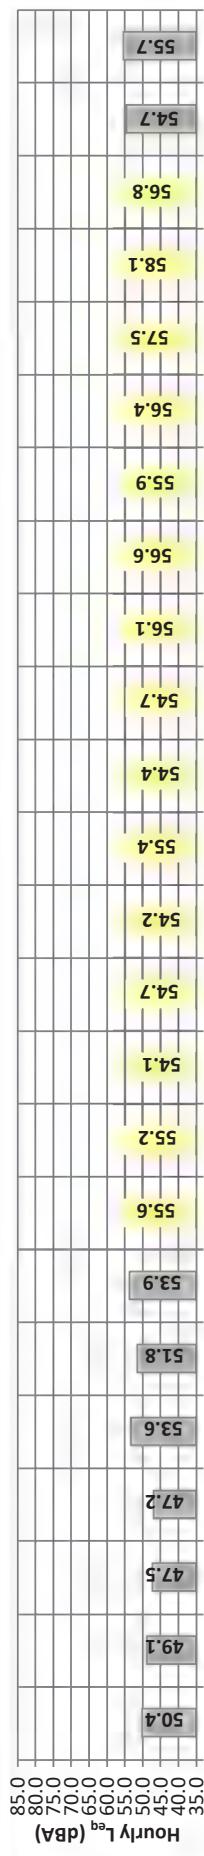

Timeframe	Hour	L_{eq}	L_{max}	L_{min}	L1%	L2%	L5%	L8%	L12%	L25%	L50%	L90%	L95%	L99%	L_{eq}	Adj. L_{eq}	
Night	0	50.4	60.7	43.6	59.9	57.3	55.3	48.1	46.7	44.9	44.6	44.0	50.4	10.0	60.4		
	1	49.1	56.8	43.8	56.5	54.1	52.7	49.2	47.4	45.2	44.8	44.2	49.1	10.0	59.1		
	2	47.5	54.8	43.6	54.5	54.1	52.0	50.5	47.5	46.1	44.5	44.2	43.8	10.0	57.5		
	3	47.2	56.4	42.8	56.1	55.6	52.9	50.9	46.2	44.6	43.4	43.2	42.9	10.0	57.2		
	4	53.6	66.0	45.6	66.4	60.9	57.5	49.8	47.2	46.0	45.9	45.7	53.6	10.0	63.6		
	5	51.8	61.7	46.1	61.4	61.0	58.6	56.2	50.3	48.1	46.7	46.2	51.8	10.0	61.8		
	6	53.9	64.8	45.2	64.4	63.8	61.1	58.9	52.5	48.1	45.9	45.6	45.3	10.0	63.9		
	7	55.6	66.5	44.6	66.3	65.6	63.1	61.1	53.7	48.7	45.7	45.2	44.8	0.0	55.2		
	8	55.2	66.2	43.1	65.9	65.4	63.3	61.2	52.2	47.0	44.0	43.6	43.2	0.0	54.1		
	9	54.1	64.9	43.8	64.6	63.9	61.2	59.3	52.2	48.1	45.0	44.5	44.0	0.0	54.7		
	10	54.7	65.5	42.7	65.3	64.8	62.7	60.4	52.5	47.0	43.7	43.3	42.8	0.0	54.2		
Day	11	54.2	65.0	43.6	64.6	63.9	61.6	59.8	52.2	47.4	44.6	44.2	43.8	0.0	55.4		
	12	55.4	67.1	43.4	66.4	65.5	63.3	61.8	53.8	48.2	44.6	44.2	43.6	0.0	54.4		
	13	54.4	65.0	43.6	64.7	64.2	61.8	59.9	52.3	47.9	44.7	44.3	43.7	0.0	54.4		
	14	54.7	64.7	39.8	64.5	64.1	62.6	61.2	53.5	45.3	40.7	40.3	40.0	0.0	54.7		
	15	56.1	66.0	40.3	65.7	65.3	63.4	62.0	55.8	49.3	41.9	41.1	40.5	0.0	56.1		
	16	56.6	68.3	42.3	67.9	67.0	64.1	62.3	54.2	47.4	43.5	42.9	42.4	0.0	56.6		
	17	55.9	66.1	42.5	65.8	65.2	63.4	62.0	54.9	48.2	43.6	43.1	42.6	0.0	55.9		
	18	56.4	67.0	39.2	66.7	66.0	63.8	62.1	55.6	48.0	40.8	40.2	39.4	0.0	56.4		
	19	57.5	68.0	43.9	67.6	67.2	65.1	63.5	56.0	49.7	45.0	44.5	44.0	5.0	62.5		
	20	58.1	69.6	46.8	69.1	68.3	66.1	64.0	55.3	49.8	47.5	47.2	46.9	5.0	63.1		
	21	56.8	67.9	46.7	67.5	66.9	65.2	62.4	53.6	49.3	47.4	47.2	46.9	5.0	61.8		
	22	54.7	65.6	46.4	65.2	64.8	62.0	59.9	52.8	49.1	47.2	46.9	46.6	10.0	64.7		
	23	55.7	67.0	47.6	66.7	66.3	63.3	60.1	51.9	49.7	48.6	48.4	47.9	10.0	65.7		
Timeframe	Hour	L_{eq}	L_{max}	L_{min}	L1%	L2%	L5%	L8%	L12%	L25%	L50%	L90%	L95%	L99%	24-Hour CNEL	Daytime CNEL (7am-10pm)	Nighttime CNEL (10pm-7am)
Day	Min	54.1	64.7	39.2	64.5	63.9	61.2	59.3	52.2	45.3	40.7	40.2	39.4	10.0			
Day	Max	58.1	69.6	46.8	69.1	68.3	66.1	64.0	56.0	49.8	47.5	47.2	46.9	10.0			
Energy Average		55.9	Average:	66.2	65.5	63.4	61.5	53.8	48.1	44.2	43.7	43.2	43.2				
Night	Min	47.2	54.8	42.8	54.5	54.1	52.0	50.5	46.2	44.6	43.4	43.2	42.9	47.9	47.9	47.9	
Night	Max	55.7	67.0	47.6	66.7	66.3	63.3	60.1	52.8	49.7	48.6	48.4	47.9	45.2	45.2	45.2	
Energy Average		52.5	Average:	61.2	60.7	58.0	55.8	49.8	47.4	45.6	45.6	45.6	45.6				

24-Hour Noise Level Measurement Summary


Date: Tuesday, June 25, 2024
 Project: Baker Lake Elsinore

Location: L6 - Located east of the site near the residence at 17401 Baker
 Source: St.

Meter: Piccolo II

J/N: 15852
 Analyst: Z. Ibrahim

Hourly L_{eq} dB Readings (unadjusted)

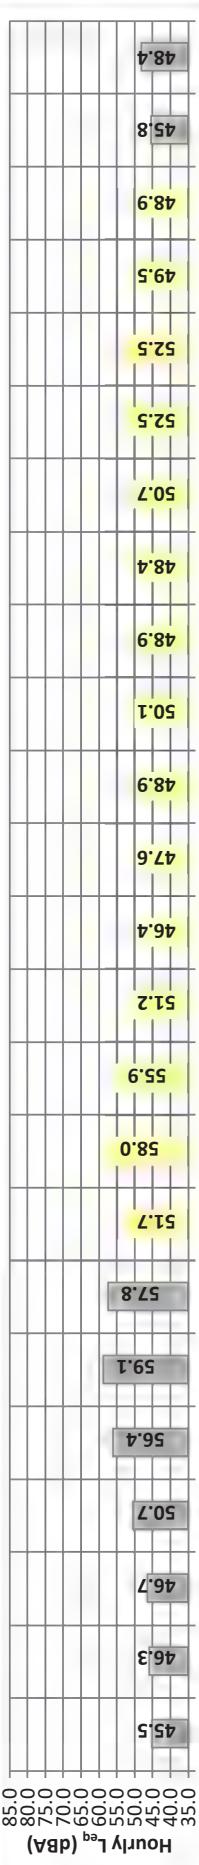

Timeframe	Hour	L_{eq}	L_{max}	L_{min}	L1%	L2%	L5%	L8%	L12%	L15%	L25%	L50%	L90%	L95%	L99%	L_{eq}	Adj. L_{eq}
Night	0	45.5	48.4	43.3	48.2	48.0	47.5	47.3	46.2	45.2	43.8	43.6	43.3	45.5	10.0	55.5	
	1	46.3	49.5	43.6	49.3	49.1	48.5	48.1	47.0	46.0	44.4	44.0	43.7	46.3	10.0	56.3	
	2	46.7	50.5	43.4	50.2	49.9	49.3	48.9	47.5	46.3	44.4	44.0	43.6	46.7	10.0	56.7	
	3	50.7	53.0	48.3	52.8	52.7	52.4	52.2	51.4	50.6	49.1	48.8	48.4	50.7	10.0	60.7	
	4	56.4	58.2	54.7	58.0	57.9	57.6	57.4	56.9	56.3	55.3	55.1	54.8	56.4	10.0	66.4	
	5	59.1	61.1	57.5	60.8	60.7	60.3	60.1	59.5	59.0	58.0	57.9	57.6	59.1	10.0	69.1	
Day	6	57.8	59.8	56.2	59.5	59.3	59.0	58.8	58.1	57.7	56.7	56.6	56.3	57.8	10.0	67.8	
	7	51.7	53.3	50.2	53.1	53.0	52.8	52.6	52.1	51.6	50.8	50.6	50.3	51.7	0.0	51.7	
	8	58.0	59.6	56.5	59.4	59.3	59.0	58.9	58.4	57.9	57.0	56.8	56.6	58.0	0.0	58.0	
	9	55.9	57.9	54.4	57.7	57.6	57.2	57.0	56.4	55.8	54.9	54.7	54.5	55.9	0.0	55.9	
	10	51.2	56.8	48.3	56.4	56.0	54.6	54.1	51.5	50.0	48.8	48.6	48.4	51.2	0.0	51.2	
	11	46.4	50.8	44.0	50.4	49.9	49.0	48.5	46.8	45.8	44.5	44.3	44.0	46.4	0.0	46.4	
Night	12	47.6	51.9	44.7	51.5	51.1	50.4	50.0	48.5	46.9	45.2	45.0	44.7	47.6	0.0	47.6	
	13	48.9	54.8	46.0	54.5	54.1	52.6	51.3	49.2	48.0	46.6	46.3	46.1	48.9	0.0	48.9	
	14	50.1	53.0	48.0	52.7	52.4	51.8	51.5	50.6	49.9	48.6	48.4	48.1	50.1	0.0	50.1	
	15	48.9	52.2	46.7	51.9	51.5	50.9	50.5	49.4	48.6	47.4	47.1	46.8	48.9	0.0	48.9	
	16	48.4	52.1	45.8	51.8	51.6	50.9	50.5	49.1	47.9	46.5	46.2	45.9	48.4	0.0	48.4	
	17	50.7	54.5	48.4	54.2	53.8	52.9	52.4	51.1	50.3	49.2	48.9	48.6	50.7	0.0	50.7	
Day	18	52.5	56.0	50.4	55.5	55.1	54.5	54.0	52.8	52.2	51.1	50.9	50.5	52.5	0.0	52.5	
	19	52.5	64.2	46.3	63.9	63.2	59.2	55.5	49.5	48.2	46.9	46.7	46.4	52.5	5.0	57.5	
	20	49.5	56.7	46.6	56.3	55.7	53.7	51.9	49.2	48.4	47.2	46.9	46.7	49.5	5.0	54.5	
	21	48.9	51.0	47.0	50.8	50.7	50.3	50.1	49.4	48.8	47.6	47.4	47.1	48.9	5.0	53.9	
	22	45.8	48.6	44.1	48.4	48.1	47.5	47.2	46.3	45.5	44.6	44.4	44.2	45.8	10.0	55.8	
	23	48.4	52.3	45.3	51.9	51.6	51.0	50.6	49.2	48.0	46.1	45.8	45.4	48.4	10.0	58.4	
Timeframe	Hour	L_{eq}	L_{max}	L_{min}	L1%	L2%	L5%	L8%	L12%	L15%	L25%	L50%	L90%	L95%	L99%	24-Hour CNEL	Daytime (7am-10pm) Nighttime (10pm-7am)
Day	Min	46.4	50.8	44.0	50.4	49.9	49.0	48.5	46.8	45.8	44.5	44.3	44.0	44.0	44.0	44.0	
Day	Max	58.0	64.2	56.5	63.9	63.2	59.2	58.9	58.4	57.9	56.8	56.6	56.6	56.6	56.6	56.6	
Energy Average	52.0	Average:	54.7	54.3	53.3	52.6	50.9	50.0	48.8	48.6	48.3	48.3	48.3	48.3	48.3	48.3	
Night	Min	45.5	48.4	43.3	48.2	48.0	47.5	47.2	46.2	45.2	43.8	43.6	43.3	43.3	43.3	43.3	
Night	Max	59.1	61.1	57.5	60.8	60.7	60.3	60.1	59.5	59.0	58.0	57.9	57.6	57.6	57.6	57.6	
Energy Average	53.9	Average:	53.2	53.0	52.6	52.3	51.4	50.5	49.2	48.9	48.6	48.6	48.6	48.6	48.6	48.6	

APPENDIX 7.1:
OFF-SITE TRAFFIC NOISE CALCULATIONS

This page intentionally left blank

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: E
Road Name: Nichols Rd.
Road Segment: between Terra Cotta and Baker St.

Project Name: Baker Lake Elsinore
Job Number: 15852

SITE SPECIFIC INPUT DATA		NOISE MODEL INPUTS					
Highway Data		Site Conditions (Hard = 10, Soft = 15)					
Average Daily Traffic (Adt):	10,709 vehicles		Autos:	15			
Peak Hour Percentage:	8.10%		Medium Trucks (2 Axles):	15			
Peak Hour Volume:	867 vehicles		Heavy Trucks (3+ Axles):	15			
Vehicle Speed:	40 mph						
Near/Far Lane Distance:	53 feet						
Site Data		Vehicle Mix					
Barrier Height:	0.0 feet	VehicleType	Day	Evening	Night	Daily	
Barrier Type (0-Wall, 1-Berm):	0.0	Autos:	78.2%	11.1%	10.7%	96.02%	
Centerline Dist. to Barrier:	50.0 feet	Medium Trucks:	87.5%	6.3%	6.3%	0.15%	
Centerline Dist. to Observer:	50.0 feet	Heavy Trucks:	74.9%	0.2%	24.9%	3.83%	
Barrier Distance to Observer:	0.0 feet						
Observer Height (Above Pad):	5.0 feet						
Pad Elevation:	0.0 feet						
Road Elevation:	0.0 feet						
Road Grade:	0.0%						
Left View:	-90.0 degrees						
Right View:	90.0 degrees						

FHWA Noise Model Calculations

VehicleType	REMET	Traffic Flow	Distance	Finite Road	Fresnel	Barrier Atten	Berm Atten
Autos:	66.51	-2.12	0.93	-1.20	-4.65	0.000	0.000
Medium Trucks:	77.72	-30.21	0.96	-1.20	-4.87	0.000	0.000
Heavy Trucks:	82.99	-16.11	0.95	-1.20	-5.43	0.000	0.000
Unmitigated Noise Levels (without Topo and barrier attenuation)							
VehicleType	Leq Peak Hour	Leq Day	Leq Evening	Leq Night	Ldn	CNEL	
Autos:	64.1	63.2	60.7	55.8	64.2	64.7	
Medium Trucks:	47.3	46.8	41.4	36.6	46.3	46.7	
Heavy Trucks:	66.6	65.5	46.7	62.0	68.9	68.9	
Vehicle Noise:	68.6	67.5	60.9	62.9	70.1	70.3	
Centerline Distance to Noise Contour (in feet)							
		70 dBA	65 dBA	60 dBA	55 dBA		
Ldn:		51	110	237	511		
CNEL:		52	112	242	522		

Thursday, March 13, 2025

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: OYC
Road Name: Nichols Rd.
Road Segment: between Terra Cotta and Baker St.

Project Name: Baker Lake Elsinore
Job Number: 15852

SITE SPECIFIC INPUT DATA		NOISE MODEL INPUTS					
Highway Data		Site Conditions (Hard = 10, Soft = 15)					
Average Daily Traffic (Adt):	12,583 vehicles		Autos:	15			
Peak Hour Percentage:	8.10%		Medium Trucks (2 Axles):	15			
Peak Hour Volume:	1,019 vehicles		Heavy Trucks (3+ Axles):	15			
Vehicle Speed:	40 mph						
Near/Far Lane Distance:	53 feet						
Site Data		Vehicle Mix					
Barrier Height:	0.0 feet	VehicleType	Day	Evening	Night	Daily	
Barrier Type (0-Wall, 1-Berm):	0.0	Autos:	78.2%	11.1%	10.7%	96.02%	
Centerline Dist. to Barrier:	50.0 feet	Medium Trucks:	87.5%	6.3%	6.3%	0.15%	
Centerline Dist. to Observer:	50.0 feet	Heavy Trucks:	74.9%	0.2%	24.9%	3.83%	
Barrier Distance to Observer:	0.0 feet						
Observer Height (Above Pad):	5.0 feet						
Pad Elevation:	0.0 feet						
Road Elevation:	0.0 feet						
Road Grade:	0.0%						
Left View:	-90.0 degrees						
Right View:	90.0 degrees						

FHWA Noise Model Calculations

VehicleType	REMET	Traffic Flow	Distance	Finite Road	Fresnel	Barrier Atten	Berm Atten
Autos:	66.51	-1.42	0.93	-1.20	-4.65	0.000	0.000
Medium Trucks:	77.72	-29.51	0.96	-1.20	-4.87	0.000	0.000
Heavy Trucks:	82.99	-15.41	0.95	-1.20	-5.43	0.000	0.000
Unmitigated Noise Levels (without Topo and barrier attenuation)							
VehicleType	Leq Peak Hour	Leq Day	Leq Evening	Leq Night	Ldn	CNEL	
Autos:	64.8	63.9	61.4	56.5	64.9	65.4	
Medium Trucks:	48.0	47.5	42.1	37.3	47.0	47.4	
Heavy Trucks:	67.3	66.2	47.4	62.7	69.6	69.6	
Vehicle Noise:	69.3	68.2	61.6	63.6	70.8	71.0	
Centerline Distance to Noise Contour (in feet)							
		70 dBA	65 dBA	60 dBA	55 dBA		
Ldn:		57	123	264	569		
CNEL:		58	125	270	581		

Thursday, March 13, 2025

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: EP
Road Name: Nichols Rd.
Road Segment: between Terra Cotta and Baker St.

Project Name: Baker Lake Elsinore
Job Number: 15852

SITE SPECIFIC INPUT DATA		NOISE MODEL INPUTS					
Highway Data		Site Conditions (Hard = 10, Soft = 15)					
Average Daily Traffic (Adt):	11,067 vehicles		Autos:	15			
Peak Hour Percentage:	8.10%		Medium Trucks (2 Axles):	15			
Peak Hour Volume:	896 vehicles		Heavy Trucks (3+ Axles):	15			
Vehicle Speed:	40 mph						
Near/Far Lane Distance:	53 feet						
Site Data		Vehicle Mix					
Barrier Height:	0.0 feet	VehicleType	Day	Evening	Night	Daily	
Barrier Type (0-Wall, 1-Berm):	0.0	Autos:	78.2%	11.1%	10.7%	94.82%	
Centerline Dist. to Barrier:	50.0 feet	Medium Trucks:	87.5%	6.3%	6.3%	0.58%	
Centerline Dist. to Observer:	50.0 feet	Heavy Trucks:	74.9%	0.2%	24.9%	4.61%	
Barrier Distance to Observer:	0.0 feet						
Observer Height (Above Pad):	5.0 feet						
Pad Elevation:	0.0 feet						
Road Elevation:	0.0 feet						
Road Grade:	0.0%						
Left View:	-90.0 degrees						
Right View:	90.0 degrees						

Thursday, March 13, 2025

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: EP
Road Name: Nichols Rd.
Road Segment: between Terra Cotta and Baker St.

Project Name: Baker Lake Elsinore
Job Number: 15852

SITE SPECIFIC INPUT DATA		NOISE MODEL INPUTS					
Highway Data		Site Conditions (Hard = 10, Soft = 15)					
Average Daily Traffic (Adt):	11,067 vehicles		Autos:	15			
Peak Hour Percentage:	8.10%		Medium Trucks (2 Axles):	15			
Peak Hour Volume:	896 vehicles		Heavy Trucks (3+ Axles):	15			
Vehicle Speed:	40 mph						
Near/Far Lane Distance:	53 feet						
Site Data		Vehicle Mix					
Barrier Height:	0.0 feet	VehicleType	Day	Evening	Night	Daily	
Barrier Type (0-Wall, 1-Berm):	0.0	Autos:	0.000				
Centerline Dist. to Barrier:	50.0 feet	Medium Trucks:	2.297				
Centerline Dist. to Observer:	50.0 feet	Heavy Trucks:	8.004	Grade Adjustment:	0.0		
Barrier Distance to Observer:	0.0 feet						
Observer Height (Above Pad):	5.0 feet						
Pad Elevation:	0.0 feet						
Road Elevation:	0.0 feet						
Road Grade:	0.0%						
Left View:	-90.0 degrees						
Right View:	90.0 degrees						

Thursday, March 13, 2025

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: EP
Road Name: Nichols Rd.
Road Segment: between Terra Cotta and Baker St.

Project Name: Baker Lake Elsinore
Job Number: 15852

SITE SPECIFIC INPUT DATA		NOISE MODEL INPUTS					
Highway Data		Site Conditions (Hard = 10, Soft = 15)					
Average Daily Traffic (Adt):	11,067 vehicles		Autos:	15			
Peak Hour Percentage:	8.10%		Medium Trucks (2 Axles):	15			
Peak Hour Volume:	896 vehicles		Heavy Trucks (3+ Axles):	15			
Vehicle Speed:	40 mph						
Near/Far Lane Distance:	53 feet						
Site Data		Vehicle Mix					
Barrier Height:	0.0 feet	VehicleType	Day	Evening	Night	Daily	
Barrier Type (0-Wall, 1-Berm):	0.0	Autos:	0.000				
Centerline Dist. to Barrier:	50.0 feet	Medium Trucks:	2.297				
Centerline Dist. to Observer:	50.0 feet	Heavy Trucks:	8.004	Grade Adjustment:	0.0		
Barrier Distance to Observer:	0.0 feet						
Observer Height (Above Pad):	5.0 feet						
Pad Elevation:	0.0 feet						
Road Elevation:	0.0 feet						
Road Grade:	0.0%						
Left View:	-90.0 degrees						
Right View:	90.0 degrees						

Thursday, March 13, 2025

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: EP
Road Name: Nichols Rd.
Road Segment: between Terra Cotta and Baker St.

Project Name: Baker Lake Elsinore
Job Number: 15852

SITE SPECIFIC INPUT DATA		NOISE MODEL INPUTS					
Highway Data		Site Conditions (Hard = 10, Soft = 15)					
Average Daily Traffic (Adt):	11,067 vehicles		Autos:	15			

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: E	Project Name: Baker Lake Elsinore							
Road Name: Nichols Rd.	Job Number: 15852							
Road Segment: between Baker St. and Collier Av.								
SITE SPECIFIC INPUT DATA	NOISE MODEL INPUTS							
Highway Data	Site Conditions (Hard = 10, Soft = 15)							
Average Daily Traffic (Adt): 10,539 vehicles	Autos: 15							
Peak Hour Percentage: 8.10%	Medium Trucks (2 Axles): 15							
Peak Hour Volume: 854 vehicles	Heavy Trucks (3+ Axles): 15							
Vehicle Speed: 40 mph								
Near/Far Lane Distance: 53 feet								
Site Data	Vehicle Mix							
Barrier Height: 0.0 feet	VehicleType Day Evening Night Daily							
Barrier Type (0-Wall, 1-Berm): 0.0	Autos: 78.2% 11.1% 10.7% 96.02%							
Centerline Dist. to Barrier: 50.0 feet	Medium Trucks: 87.5% 6.3% 6.3% 0.15%							
Centerline Dist. to Observer: 50.0 feet	Heavy Trucks: 74.9% 0.2% 24.9% 3.83%							
Barrier Distance to Observer: 0.0 feet								
Observer Height (Above Pad): 5.0 feet	Noise Source Elevations (in feet)							
Pad Elevation: 0.0 feet	Autos: 0.000							
Road Elevation: 0.0 feet	Medium Trucks: 2.297							
Road Grade: 0.0%	Heavy Trucks: 8.004 Grade Adjustment: 0.0							
Left View: -90.0 degrees								
Right View: 90.0 degrees	Lane Equivalent Distance (in feet)							
FHWA Noise Model Calculations								
VehicleType REMEL Traffic Flow Distance Finite Road Fresnel Barrier Atten Berm Atten								
Autos: 66.51 -2.19 0.93 -1.20 -4.65 0.000 0.000								
Medium Trucks: 77.72 -30.28 0.96 -1.20 -4.87 0.000 0.000								
Heavy Trucks: 82.99 -16.18 0.95 -1.20 -5.43 0.000 0.000								
Unmitigated Noise Levels (without Topo and barrier attenuation)								
VehicleType Leq Peak Hour Leq Day Leq Evening Leq Night Ldn CNEL								
Autos: 64.0 63.1 60.6 55.7 64.1 64.6								
Medium Trucks: 47.2 46.7 41.3 36.5 46.2 46.6								
Heavy Trucks: 66.6 65.4 46.6 61.9 68.8 68.8								
Vehicle Noise: 68.5 67.5 60.9 62.8 70.1 70.2								
Centerline Distance to Noise Contour (in feet)								
	70 dBA 65 dBA 60 dBA 55 dBA							
Ldn: 51 109 235 505								
CNEL: 52 111 240 516								

Thursday, March 13, 2025

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: EP	Project Name: Baker Lake Elsinore							
Road Name: Nichols Rd.	Job Number: 15852							
Road Segment: between Baker St. and Collier Av.								
SITE SPECIFIC INPUT DATA	NOISE MODEL INPUTS							
Highway Data	Site Conditions (Hard = 10, Soft = 15)							
Average Daily Traffic (Adt): 12,447 vehicles	Autos: 15							
Peak Hour Percentage: 8.10%	Medium Trucks (2 Axles): 15							
Peak Hour Volume: 1,008 vehicles	Heavy Trucks (3+ Axles): 15							
Vehicle Speed: 40 mph								
Near/Far Lane Distance: 53 feet								
Site Data	Vehicle Mix							
Barrier Height: 0.0 feet	VehicleType Day Evening Night Daily							
Barrier Type (0-Wall, 1-Berm): 0.0	Autos: 78.2% 11.1% 10.7% 90.30%							
Centerline Dist. to Barrier: 50.0 feet	Medium Trucks: 87.5% 6.3% 6.3% 2.17%							
Centerline Dist. to Observer: 50.0 feet	Heavy Trucks: 74.9% 0.2% 24.9% 7.53%							
Barrier Distance to Observer: 0.0 feet								
Observer Height (Above Pad): 5.0 feet	Noise Source Elevations (in feet)							
Pad Elevation: 0.0 feet	Autos: 0.000							
Road Elevation: 0.0 feet	Medium Trucks: 2.297							
Road Grade: 0.0%	Heavy Trucks: 8.004 Grade Adjustment: 0.0							
Left View: -90.0 degrees								
Right View: 90.0 degrees	Lane Equivalent Distance (in feet)							
FHWA Noise Model Calculations								
VehicleType REMEL Traffic Flow Distance Finite Road Fresnel Barrier Atten Berm Atten								
Autos: 66.51 -1.73 0.93 -1.20 -4.65 0.000 0.000								
Medium Trucks: 77.72 -17.93 0.96 -1.20 -4.87 0.000 0.000								
Heavy Trucks: 82.99 -12.52 0.95 -1.20 -5.43 0.000 0.000								
Unmitigated Noise Levels (without Topo and barrier attenuation)								
VehicleType Leq Peak Hour Leq Day Leq Evening Leq Night Ldn CNEL								
Autos: 64.5 63.6 61.1 56.2 64.5 65.0								
Medium Trucks: 59.5 59.1 53.6 48.9 58.6 59.0								
Heavy Trucks: 70.2 69.1 50.2 65.6 72.4 72.4								
Vehicle Noise: 71.5 70.5 62.1 66.1 73.2 73.3								
Centerline Distance to Noise Contour (in feet)								
	70 dBA 65 dBA 60 dBA 55 dBA							
Ldn: 82 177 382 823								
CNEL: 83 180 387 835								

Scenario: OYCP	Project Name: Baker Lake Elsinore							
Road Name: Nichols Rd.	Job Number: 15852							
Road Segment: between Baker St. and Collier Av.								
SITE SPECIFIC INPUT DATA	NOISE MODEL INPUTS							
Highway Data	Site Conditions (Hard = 10, Soft = 15)							
Average Daily Traffic (Adt): 14,310 vehicles	Autos: 15							
Peak Hour Percentage: 8.10%	Medium Trucks (2 Axles): 15							
Peak Hour Volume: 1,159 vehicles	Heavy Trucks (3+ Axles): 15							
Vehicle Speed: 40 mph								
Near/Far Lane Distance: 53 feet								
Site Data	Vehicle Mix							
Barrier Height: 0.0 feet	VehicleType Day Evening Night Daily							
Barrier Type (0-Wall, 1-Berm): 0.0	Autos: 78.2% 11.1% 10.7% 91.05%							
Centerline Dist. to Barrier: 50.0 feet	Medium Trucks: 87.5% 6.3% 6.3% 1.91%							
Centerline Dist. to Observer: 50.0 feet	Heavy Trucks: 74.9% 0.2% 24.9% 7.05%							
Barrier Distance to Observer: 0.0 feet								
Observer Height (Above Pad): 5.0 feet	Noise Source Elevations (in feet)							
Pad Elevation: 0.0 feet	Autos: 0.000							
Road Elevation: 0.0 feet	Medium Trucks: 2.297							
Road Grade: 0.0%	Heavy Trucks: 8.004 Grade Adjustment: 0.0							
Left View: -90.0 degrees								
Right View: 90.0 degrees	Lane Equivalent Distance (in feet)							
FHWA Noise Model Calculations								
VehicleType REMEL Traffic Flow Distance Finite Road Fresnel Barrier Atten Berm Atten								
Autos: 66.51 -1.09 0.93 -1.20 -4.65 0.000 0.000								
Medium Trucks: 77.72 -17.88 0.96 -1.20 -4.87 0.000 0.000								
Heavy Trucks: 82.99 -12.20 0.95 -1.20 -5.43 0.000 0.000								
Unmitigated Noise Levels (without Topo and barrier attenuation)								
VehicleType Leq Peak Hour Leq Day Leq Evening Leq Night Ldn CNEL								
Autos: 65.1 64.2 61.7 56.8 65.2 65.7								
Medium Trucks: 59.6 59.1 53.7 48.9 58.6 59.0								
Heavy Trucks: 70.5 69.4 50.6 65.9 72.8 72.8								
Vehicle Noise: 71.9 70.9 62.7 66.5 73.6 73.7								
Centerline Distance to Noise Contour (in feet)								
	70 dBA 65 dBA 60 dBA 55 dBA							
Ldn: 87 187 403 869								
CNEL: 88 190 409 882								

Thursday, March 13, 2025

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: E	Project Name: Baker Lake Elsinore						
Road Name: Nichols Rd.	Job Number: 15852						
Road Segment: between Collier Avenue and 1-15 SB Ramps							
SITE SPECIFIC INPUT DATA	NOISE MODEL INPUTS						
Highway Data	Site Conditions (Hard = 10, Soft = 15)						
Average Daily Traffic (Adt): 10,545 vehicles	Autos: 15						
Peak Hour Percentage: 8.10%	Medium Trucks (2 Axles): 15						
Peak Hour Volume: 854 vehicles	Heavy Trucks (3+ Axles): 15						
Vehicle Speed: 40 mph							
Near/Far Lane Distance: 53 feet							
Site Data	Vehicle Mix						
Barrier Height: 0.0 feet	VehicleType Day Evening Night Daily						
Barrier Type (0-Wall, 1-Berm): 0.0	Autos: 78.2% 11.1% 10.7% 96.02%						
Centerline Dist. to Barrier: 50.0 feet	Medium Trucks: 87.5% 6.3% 6.3% 0.15%						
Centerline Dist. to Observer: 50.0 feet	Heavy Trucks: 74.9% 0.2% 24.9% 3.83%						
Barrier Distance to Observer: 0.0 feet							
Observer Height (Above Pad): 5.0 feet							
Pad Elevation: 0.0 feet							
Road Elevation: 0.0 feet							
Road Grade: 0.0%							
Left View: -90.0 degrees							
Right View: 90.0 degrees							
FHWA Noise Model Calculations							
VehicleType REMEL Traffic Flow Distance Finite Road Fresnel Barrier Atten Berm Atten							
Autos: 66.51 -2.19 0.93 -1.20 -4.65 0.000 0.000							
Medium Trucks: 77.72 -30.28 0.96 -1.20 -4.87 0.000 0.000							
Heavy Trucks: 82.99 -16.18 0.95 -1.20 -5.43 0.000 0.000							
Unmitigated Noise Levels (without Topo and barrier attenuation)							
VehicleType Leq Peak Hour Leq Day Leq Evening Leq Night Ldn CNEL							
Autos: 64.1 63.1 60.6 55.7 64.1 64.6							
Medium Trucks: 47.2 46.7 41.3 36.5 46.2 46.6							
Heavy Trucks: 66.6 65.4 46.6 61.9 68.8 68.8							
Vehicle Noise: 68.5 67.5 60.9 62.8 70.1 70.2							
Centerline Distance to Noise Contour (in feet)							
	70 dBA	65 dBA	60 dBA	55 dBA			
Ldn:	51	109	235	506			
CNEL:	52	111	240	517			

Thursday, March 13, 2025

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: EP	Project Name: Baker Lake Elsinore						
Road Name: Nichols Rd.	Job Number: 15852						
Road Segment: between Collier Avenue and 1-15 SB Ramps							
SITE SPECIFIC INPUT DATA	NOISE MODEL INPUTS						
Highway Data	Site Conditions (Hard = 10, Soft = 15)						
Average Daily Traffic (Adt): 12,215 vehicles	Autos: 15						
Peak Hour Percentage: 8.10%	Medium Trucks (2 Axles): 15						
Peak Hour Volume: 989 vehicles	Heavy Trucks (3+ Axles): 15						
Vehicle Speed: 40 mph							
Near/Far Lane Distance: 53 feet							
Site Data	Vehicle Mix						
Barrier Height: 0.0 feet	VehicleType Day Evening Night Daily						
Barrier Type (0-Wall, 1-Berm): 0.0	Autos: 78.2% 11.1% 10.7% 90.92%						
Centerline Dist. to Barrier: 50.0 feet	Medium Trucks: 87.5% 6.3% 6.3% 1.95%						
Centerline Dist. to Observer: 50.0 feet	Heavy Trucks: 74.9% 0.2% 24.9% 7.13%						
Barrier Distance to Observer: 0.0 feet							
Observer Height (Above Pad): 5.0 feet							
Pad Elevation: 0.0 feet							
Road Elevation: 0.0 feet							
Road Grade: 0.0%							
Left View: -90.0 degrees							
Right View: 90.0 degrees							
FHWA Noise Model Calculations							
VehicleType REMEL Traffic Flow Distance Finite Road Fresnel Barrier Atten Berm Atten							
Autos: 66.51 -1.79 0.93 -1.20 -4.65 0.000 0.000							
Medium Trucks: 77.72 -18.47 0.96 -1.20 -4.87 0.000 0.000							
Heavy Trucks: 82.99 -12.84 0.95 -1.20 -5.43 0.000 0.000							
Unmitigated Noise Levels (without Topo and barrier attenuation)							
VehicleType Leq Peak Hour Leq Day Leq Evening Leq Night Ldn CNEL							
Autos: 64.5 63.5 61.0 56.1 64.5 65.0							
Medium Trucks: 59.0 58.5 53.1 48.3 58.1 58.4							
Heavy Trucks: 69.9 68.8 49.9 65.2 72.1 72.1							
Vehicle Noise: 71.3 70.2 62.0 65.8 73.0 73.1							
Centerline Distance to Noise Contour (in feet)							
	70 dBA	65 dBA	60 dBA	55 dBA			
Ldn:	79	170	365	787			
CNEL:	80	172	371	799			

Thursday, March 13, 2025

Scenario: OYCP	Project Name: Baker Lake Elsinore						
Road Name: Nichols Rd.	Job Number: 15852						
Road Segment: between Collier Avenue and 1-15 SB Ramps							
SITE SPECIFIC INPUT DATA	NOISE MODEL INPUTS						
Highway Data	Site Conditions (Hard = 10, Soft = 15)						
Average Daily Traffic (Adt): 13,988 vehicles	Autos: 15						
Peak Hour Percentage: 8.10%	Medium Trucks (2 Axles): 15						
Peak Hour Volume: 1,133 vehicles	Heavy Trucks (3+ Axles): 15						
Vehicle Speed: 40 mph							
Near/Far Lane Distance: 53 feet							
Site Data	Vehicle Mix						
Barrier Height: 0.0 feet	VehicleType Day Evening Night Daily						
Barrier Type (0-Wall, 1-Berm): 0.0	Autos: 78.2% 11.1% 10.7% 91.57%						
Centerline Dist. to Barrier: 50.0 feet	Medium Trucks: 87.5% 6.3% 6.3% 1.72%						
Centerline Dist. to Observer: 50.0 feet	Heavy Trucks: 74.9% 0.2% 24.9% 6.71%						
Barrier Distance to Observer: 0.0 feet							
Observer Height (Above Pad): 5.0 feet							
Pad Elevation: 0.0 feet							
Road Elevation: 0.0 feet							
Road Grade: 0.0%							
Left View: -90.0 degrees							
Right View: 90.0 degrees							
FHWA Noise Model Calculations							
VehicleType REMEL Traffic Flow Distance Finite Road Fresnel Barrier Atten Berm Atten							
Autos: 66.51 -1.17 0.93 -1.20 -4.65 0.000 0.000							
Medium Trucks: 77.72 -18.42 0.96 -1.20 -4.87 0.000 0.000							
Heavy Trucks: 82.99 -12.52 0.95 -1.20 -5.43 0.000 0.000							
Unmitigated Noise Levels (without Topo and barrier attenuation)							
VehicleType Leq Peak Hour Leq Day Leq Evening Leq Night Ldn CNEL							
Autos: 65.1 64.1 61.7 56.7 65.1 65.6							
Medium Trucks: 59.1 58.6 53.2 48.4 58.1 58.5							
Heavy Trucks: 70.2 69.1 50.2 65.6 72.4 72.5							
Vehicle Noise: 71.6 70.6 62.5 66.2 73.3 73.4							
Centerline Distance to Noise Contour (in feet)							
	70 dBA	65 dBA	60 dBA	55 dBA			
Ldn:	83	179	386	832			
CNEL:	84	182	392	844			

Thursday, March 13, 2025

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: E	Project Name: Baker Lake Elsinore						
Road Name: Nichols Rd.	Job Number: 15852						
Road Segment: between 1-15 SB Ramps and I-15 NB Ramps							
SITE SPECIFIC INPUT DATA							
Highway Data							
Average Daily Traffic (Adt): 10,056 vehicles							
Peak Hour Percentage: 8.10%	Autos: 15						
Peak Hour Volume: 815 vehicles	Medium Trucks (2 Axles): 15						
Vehicle Speed: 40 mph	Heavy Trucks (3+ Axles): 15						
Near/Far Lane Distance: 53 feet							
Site Data							
Barrier Height: 0.0 feet							
Barrier Type (0-Wall, 1-Berm): 0.0							
Centerline Dist. to Barrier: 50.0 feet							
Centerline Dist. to Observer: 50.0 feet							
Barrier Distance to Observer: 0.0 feet							
Observer Height (Above Pad): 5.0 feet							
Pad Elevation: 0.0 feet							
Road Elevation: 0.0 feet							
Road Grade: 0.0%							
Left View: -90.0 degrees							
Right View: 90.0 degrees							
FHWA Noise Model Calculations							
VehicleType	REMET	Traffic Flow	Distance	Finite Road	Fresnel	Barrier Atten	Berm Atten
Autos:	66.51	-2.39	0.93	-1.20	-4.65	0.000	0.000
Medium Trucks:	77.72	-30.49	0.96	-1.20	-4.87	0.000	0.000
Heavy Trucks:	82.99	-16.39	0.95	-1.20	-5.43	0.000	0.000
Unmitigated Noise Levels (without Topo and barrier attenuation)							
VehicleType	Leq Peak Hour	Leq Day	Leq Evening	Leq Night	Ldn	CNEL	
Autos:	63.8	62.9	60.4	55.5	63.9	64.4	
Medium Trucks:	47.0	46.5	41.1	36.3	46.0	46.4	
Heavy Trucks:	66.4	65.2	46.4	61.7	68.6	68.6	
Vehicle Noise:	68.3	67.3	60.7	62.6	69.9	70.0	
Centerline Distance to Noise Contour (in feet)							
	70 dBA	65 dBA	60 dBA	55 dBA			
Ldn:	49	106	227	490			
CNEL:	50	108	232	500			

Thursday, March 13, 2025

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: EP	Project Name: Baker Lake Elsinore						
Road Name: Nichols Rd.	Job Number: 15852						
Road Segment: between 1-15 SB Ramps and I-15 NB Ramps							
SITE SPECIFIC INPUT DATA							
Highway Data							
Average Daily Traffic (Adt): 11,010 vehicles							
Peak Hour Percentage: 8.10%	Autos: 15						
Peak Hour Volume: 892 vehicles	Medium Trucks (2 Axles): 15						
Vehicle Speed: 40 mph	Heavy Trucks (3+ Axles): 15						
Near/Far Lane Distance: 53 feet							
Site Data							
Barrier Height: 0.0 feet							
Barrier Type (0-Wall, 1-Berm): 0.0							
Centerline Dist. to Barrier: 50.0 feet							
Centerline Dist. to Observer: 50.0 feet							
Barrier Distance to Observer: 0.0 feet							
Observer Height (Above Pad): 5.0 feet							
Pad Elevation: 0.0 feet							
Road Elevation: 0.0 feet							
Road Grade: 0.0%							
Left View: -90.0 degrees							
Right View: 90.0 degrees							
FHWA Noise Model Calculations							
VehicleType	REMET	Traffic Flow	Distance	Finite Road	Fresnel	Barrier Atten	Berm Atten
Autos:	66.51	-2.15	0.93	-1.20	-4.65	0.000	0.000
Medium Trucks:	77.72	-20.71	0.96	-1.20	-4.87	0.000	0.000
Heavy Trucks:	82.99	-14.10	0.95	-1.20	-5.43	0.000	0.000
Unmitigated Noise Levels (without Topo and barrier attenuation)							
VehicleType	Leq Peak Hour	Leq Day	Leq Evening	Leq Night	Ldn	CNEL	
Autos:	64.1	63.1	60.7	55.8	64.1	64.6	
Medium Trucks:	56.8	56.3	50.9	46.1	55.8	56.2	
Heavy Trucks:	68.6	67.5	48.7	64.0	70.9	70.9	
Vehicle Noise:	70.2	69.1	61.4	64.7	71.8	71.9	
Centerline Distance to Noise Contour (in feet)							
	70 dBA	65 dBA	60 dBA	55 dBA			
Ldn:	66	142	307	660			
CNEL:	67	145	311	671			

Thursday, March 13, 2025

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: OYC	Project Name: Baker Lake Elsinore						
Road Name: Nichols Rd.	Job Number: 15852						
Road Segment: between 1-15 SB Ramps and I-15 NB Ramps							
SITE SPECIFIC INPUT DATA							
Highway Data							
Average Daily Traffic (Adt): 11,799 vehicles							
Peak Hour Percentage: 8.10%	Autos: 15						
Peak Hour Volume: 956 vehicles	Medium Trucks (2 Axles): 15						
Vehicle Speed: 40 mph	Heavy Trucks (3+ Axles): 15						
Near/Far Lane Distance: 53 feet							
Site Data							
Barrier Height: 0.0 feet							
Barrier Type (0-Wall, 1-Berm): 0.0							
Centerline Dist. to Barrier: 50.0 feet							
Centerline Dist. to Observer: 50.0 feet							
Barrier Distance to Observer: 0.0 feet							
Observer Height (Above Pad): 5.0 feet							
Pad Elevation: 0.0 feet							
Road Elevation: 0.0 feet							
Road Grade: 0.0%							
Left View: -90.0 degrees							
Right View: 90.0 degrees							
FHWA Noise Model Calculations							
VehicleType	REMET	Traffic Flow	Distance	Finite Road	Fresnel	Barrier Atten	Berm Atten
Autos:	66.51	-1.70	0.93	-1.20	-4.65	0.000	0.000
Medium Trucks:	77.72	-29.79	0.96	-1.20	-4.87	0.000	0.000
Heavy Trucks:	82.99	-15.69	0.95	-1.20	-5.43	0.000	0.000
Unmitigated Noise Levels (without Topo and barrier attenuation)							
VehicleType	Leq Peak Hour	Leq Day	Leq Evening	Leq Night	Ldn	CNEL	
Autos:	64.5	63.6	61.1	56.2	64.6	65.1	
Medium Trucks:	47.7	47.2	41.8	37.0	46.7	47.1	
Heavy Trucks:	67.1	65.9	47.1	62.4	69.3	69.3	
Vehicle Noise:	69.0	68.0	61.3	63.3	70.6	70.7	
Centerline Distance to Noise Contour (in feet)							
	70 dBA	65 dBA	60 dBA	55 dBA			
Ldn:	54	117	253	545			
CNEL:	56	120	258	557			

Thursday, March 13, 2025

FHWA-RD-77-108 HIGHWAY NOISE PREDICTION MODEL (9/12/2021)

Scenario: OYCP	Project Name: Baker Lake Elsinore						
Road Name: Nichols Rd.	Job Number: 15852						
Road Segment: between 1-15 SB Ramps and I-15 NB Ramps							
SITE SPECIFIC INPUT DATA							
Highway Data							
Average Daily Traffic (Adt): 12,753 vehicles							
Peak Hour Percentage: 8.10%	Autos: 15						
Peak Hour Volume: 1,033 vehicles	Medium Trucks (2 Axles): 15						
Vehicle Speed: 40 mph	Heavy Trucks (3+ Axles): 15						
Near/Far Lane Distance: 53 feet							
Site Data							
Barrier Height: 0.0 feet							
Barrier Type (0-Wall, 1-Berm): 0.0							
Centerline Dist. to Barrier: 50.0 feet							
Centerline Dist. to Observer: 50.0 feet							
Barrier Distance to Observer: 0.0 feet							
Observer Height (Above Pad): 5.0 feet							
Pad Elevation: 0.0 feet							
Road Elevation: 0.0 feet							
Road Grade: 0.0%							
Left View: -90.0 degrees							
Right View: 90.0 degrees							
FHWA Noise Model Calculations							
VehicleType	REMET	Traffic Flow	Distance	Finite Road	Fresnel	Barrier Atten	Berm Atten
Autos:	66.51	-1.49	0.93	-1.20	-4.65	0.000	0.000
Medium Trucks:	77.72	-20.63	0.96	-1.20	-4.87	0.000	0.000
Heavy Trucks:	82.99	-13.68	0.95	-1.20	-5.43	0.000	0.000
Unmitigated Noise Levels (without Topo and barrier attenuation)							
VehicleType	Leq Peak Hour	Leq Day	Leq Evening	Leq Night	Ldn	CNEL	
Autos:	64.7	63.8	61.3	56.4	64.8	65.3	
Medium Trucks:	56.8	56.4	50.9	46.2	55.9	56.3	
Heavy Trucks:	69.1	67.9	49.1	64.4	71.3	71.3	
Vehicle Noise:	70.6	69.6	62.0	65.1	72.3	72.4	
Centerline Distance to Noise Contour (in feet)							
	70 dBA	65 dBA	60 dBA	55 dBA			
Ldn:	71	153	329	708			
CNEL:	72	155	334	720			

Thursday, March 13, 2025

APPENDIX 9.1:
OPERATIONAL NOISE MODEL CALCULATIONS

This page intentionally left blank

15382 - Baker Lake Elsinore

CadnaA Noise Prediction Model: 15852-04.cna

Date: 06.02.25

Analyst: B. Lawson

Calculation Configuration

Configuration	
Parameter	Value
General	
Max. Error (dB)	0.00
Max. Search Radius (ft)	6561.70
Min. Dist Src to Rcvr	0.00
Partition	
Raster Factor	0.50
Max. Length of Section (ft)	3280.80
Min. Length of Section (ft)	3.30
Min. Length of Section (%)	0.00
Proj. Line Sources	On
Proj. Area Sources	On
Ref. Time	
Daytime Penalty (dB)	0.00
Recr. Time Penalty (dB)	5.00
Night-time Penalty (dB)	10.00
DTM	
Standard Height (m)	0.00
Model of Terrain	Triangulation
Reflection	
max. Order of Reflection	2
Search Radius Src	328.08
Search Radius Rcvr	328.08
Max. Distance Source - Rcvr	3280.84 3280.84
Min. Distance Rcvr - Reflector	3.28 3.28
Min. Distance Source - Reflector	0.33
Industrial (ISO 9613 (1996))	
Lateral Diffraction	some Obj
Obst. within Area Src do not shield	On
Screening	Incl. Ground Att. over Barrier
	Dz with limit (20/25)
Barrier Coefficients C1,2,3	3.0 20.0 0.0
Temperature (°F)	50
rel. Humidity (%)	70
Ground Absorption G	0.50
Wind Speed for Dir. (mph)	6.7
Roads (TNM)	
Railways (FTA/FRA)	
Aircraft (???)	
Strictly acc. to AzB	

Receiver Noise Levels

Name	M.	ID	Level Lr			Limit. Value			Land Use			Height	Coordinates				
			Day		Night	CNEL	Day	Night	CNEL	Type	Auto	Noise Type	(ft)	(ft)	(ft)		
			(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)								
RECEIVERS		R1	42.6	42.1	48.8	50.0	45.0	0.0					5.00	a	6221928.14	2201190.54	5.00
RECEIVERS		R2	42.8	42.8	49.4	55.0	45.0	0.0					5.00	a	6221185.06	2200344.68	5.00
RECEIVERS		R3	45.0	45.0	51.6	55.0	50.0	0.0					5.00	a	6222056.93	2199030.35	5.00
RECEIVERS		R4	44.3	44.3	51.0	65.0	55.0	0.0					5.00	a	6223020.13	2198332.96	5.00
RECEIVERS		R5	42.1	42.1	48.8	60.0	50.0	0.0					5.00	a	6224109.43	2197342.90	5.00
RECEIVERS		R6	54.3	54.3	60.9	65.0	65.0	0.0					5.00	a	6224709.28	2199602.30	5.00

Point Source(s)

Name	M.	ID	Result. PWL			Lw / Li			Operating Time			Height	Coordinates			
			Day		Evening	Night	Type	Value	norm.	Day	Special	Night	(ft)	(ft)	(ft)	
			(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)				
POINTSOURCE		AC01	88.9	88.9	88.9	Lw	88.9		585.00	0.00	252.00	5.00	g	6224333.85	2199737.86	50.00
POINTSOURCE		AC02	88.9	88.9	88.9	Lw	88.9		585.00	0.00	252.00	5.00	g	6224417.18	2199737.86	50.00
POINTSOURCE		AC03	88.9	88.9	88.9	Lw	88.9		585.00	0.00	252.00	5.00	g	6223073.43	2200960.08	50.00
POINTSOURCE		AC04	88.9	88.9	88.9	Lw	88.9		585.00	0.00	252.00	5.00	g	6223073.43	2201039.94	50.00
POINTSOURCE		AC05	88.9	88.9	88.9	Lw	88.9		585.00	0.00	252.00	5.00	g	6222672.65	2201481.24	50.00
POINTSOURCE		AC06	88.9	88.9	88.9	Lw	88.9		585.00	0.00	252.00	5.00	g	6222737.21	2201486.62	50.00
POINTSOURCE		AC07	88.9	88.9	88.9	Lw	88.9		585.00	0.00	252.00	5.00	g	6222188.43	2201312.30	50.00
POINTSOURCE		AC08	88.9	88.9	88.9	Lw	88.9		585.00	0.00	252.00	5.00	g	6222115.26	2201316.60	50.00
POINTSOURCE		TRASH01	89.0	89.0	89.0	Lw	89		900.00	0.00	540.00	5.00	a	6222770.22	2201305.06	5.00
POINTSOURCE		TRASH02	89.0	89.0	89.0	Lw	89		900.00	0.00	540.00	5.00	a	6222780.29	2201313.12	5.00
POINTSOURCE		TRASH03	89.0	89.0	89.0	Lw	89		900.00	0.00	540.00	5.00	a	6223247.04	2201071.19	5.00
POINTSOURCE		TRASH04	89.0	89.0	89.0	Lw	89		900.00	0.00	540.00	5.00	a	6224444.96	2199906.26	5.00

Line Source(s)

Name	M.	ID	Result. PWL			Result. PWL'			Lw / Li		Operating Time			Moving Pt. Src			Height
			Day	Evening	Night	Day	Evening	Night	Type	Value	norm.	Day	Special	Night	Number	Speed	
			(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)			dB(A)	(min)	(min)	(min)	Day	Evening	Night
LINESOURCE	TRUCK01	93.2	93.2	93.2	93.2	70.8	70.8	70.8	Lw	93.2							8 a
LINESOURCE	TRUCK02	93.2	93.2	93.2	93.2	70.6	70.6	70.6	Lw	93.2							8 a
LINESOURCE	TRUCK03	93.2	93.2	93.2	64.8	64.8	64.8	64.8	Lw	93.2							8 a
LINESOURCE	TRUCK04	93.2	93.2	93.2	66.8	66.8	66.8	66.8	Lw	93.2							8 a
LINESOURCE	TRUCK05	93.2	93.2	93.2	68.8	68.8	68.8	68.8	Lw	93.2							8 a

Name	ID	Height		Coordinates												
		Begin	End	x	y	z	Ground									
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)									
LINESOURCE	TRUCK01	8.00	a	6222859.86	2201506.82	8.00	0.00									
LINESOURCE	TRUCK02	8.00	a	6222452.54	2201105.42	8.00	0.00									
LINESOURCE	TRUCK03	8.00	a	6222630.72	2200890.63	8.00	0.00									
LINESOURCE	TRUCK04	8.00	a	6223058.67	2201313.55	8.00	0.00									
LINESOURCE	TRUCK05	8.00	a	6222980.05	2201235.85	8.00	0.00									
				6224510.93	2199737.86	8.00	0.00									
				6224600.39	2199817.27	8.00	0.00									
				6224510.93	2199737.86	8.00	0.00									
				6224416.59	2199612.61	8.00	0.00									
				6224838.33	2199170.94	8.00	0.00									
				6224705.19	2199037.79	8.00	0.00									
				6224364.77	2199374.23	8.00	0.00									
				6224506.60	2199518.35	8.00	0.00									
				6224364.77	2199374.23	8.00	0.00									
				6224241.99	2199253.85	8.00	0.00									
				6224501.10	2198996.34	8.00	0.00									
				6224615.90	2199113.53	8.00	0.00									

Area Source(s)

Name	M.	ID	Result. PWL			Result. PWL'			Lw / Li		Operating Time			Height	
			Day	Evening	Night	Day	Evening	Night	Type	Value	norm.	Day	Special	Night	(ft)
			(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)			dB(A)	(min)	(min)	(min)	
AREASOURCE	CAR01	81.1	81.1	81.1	56.2	56.2	56.2	56.2	Lw	81.1					5 a
AREASOURCE	CAR02	81.1	81.1	81.1	53.8	53.8	53.8	53.8	Lw	81.1					5 a
AREASOURCE	CAR03	81.1	81.1	81.1	54.5	54.5	54.5	54.5	Lw	81.1					5 a
AREASOURCE	CAR04	81.1	81.1	81.1	60.6	60.6	60.6	60.6	Lw	81.1					5 a
AREASOURCE	CAR05	81.1	81.1	81.1	59.8	59.8	59.8	59.8	Lw	81.1					5 a
AREASOURCE	CAR06	81.1	81.1	81.1	51.7	51.7	51.7	51.7	Lw	81.1					5 a
AREASOURCE	CAR07	81.1	81.1	81.1	58.4	58.4	58.4	58.4	Lw	81.1					5 a
AREASOURCE	CAR08	81.1	81.1	81.1	52.3	52.3	52.3	52.3	Lw	81.1					5 a
AREASOURCE	CAR09	81.1	81.1	81.1	53.4	53.4	53.4	53.4	Lw	81.1					5 a
AREASOURCE	CAR10	81.1	81.1	81.1	58.2	58.2	58.2	58.2	Lw	81.1					5 a
AREASOURCE	CAR11	81.1	81.1	81.1	53.9	53.9	53.9	53.9	Lw	81.1					5 a
AREASOURCE	CAR12	81.1	81.1	81.1	54.3	54.3	54.3	54.3	Lw	81.1					5 a
AREASOURCE	CAR13	81.1	81.1	81.1	53.6	53.6	53.6	53.6	Lw	81.1					5 a
AREASOURCE	CAR14	81.1	81.1	81.1	53.6	53.6	53.6	53.6	Lw	81.1					5 a
AREASOURCE	CAR15	81.1	81.1	81.1	60.0	60.0	60.0	60.0	Lw	81.1					5 a
AREASOURCE	CAR16	81.1	81.1	81.1	58.5	58.5	58.5	58.5	Lw	81.1					5 a
AREASOURCE	COLD01	111.5	111.5	111.5	78.0	78.0	78.0	78.0	Lw	111.5					8 a
AREASOURCE	COLD02	111.5	111.5	111.5	71.5	71.5	71.5	71.5	Lw	111.5					8 a
AREASOURCE	DRY01	103.4	103.4	103.4	68.3	68.3	68.3	68.3	Lw	103.4					8 a
AREASOURCE	DRY02	103.4	103.4	103.4	75.6	75.6	75.6	75.6	Lw	103.4					8 a
AREASOURCE	DRY03	103.4	103.4	103.4	67.0	67.0	67.0	67.0	Lw	103.4					8 a
AREASOURCE	DRY04	103.4	103.4	103.4	70.1	70.1	70.1	70.1	Lw	103.4					8 a
AREASOURCE	DRY05	103.4	103.4	103.4	70.2	70.2	70.2	70.2	Lw	103.4					8 a
AREASOURCE	DRY06	103.4	103.4	103.4	64.5	64.5	64.5	64.5	Lw	103.4					8 a
AREASOURCE	DRY07	103.4	103.4	103.4	71.0	71.0	71.0	71.0	Lw	103.4					8 a

Name	ID	Height		Coordinates											
		Begin	End	x	y	z	Ground								
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)								
AREASOURCE	CAR01	5.00	a	6222092.01	2201401.48	5.00	0.00								
				6222226.17	2201534.15	5.00	0.00								
				6222237.42	2201521.41	5.00	0.00								
				6222105.50	2201388.74	5.00	0.00								
AREASOURCE	CAR02	5.00	a	6222266.65	2201576.13	5.00	0.00								
				6222502.01	2201806.99	5.00	0.00								
				6222515.50	2201797.24	5.00	0.00								
				6222279.39	2201562.64	5.00	0.00								
AREASOURCE	CAR03	5.00	a	6222527.49	2201807.73	5.00	0.00								
				6222736.61	2201605.36	5.00	0.00								
				6222724.62	2201591.87	5.00	0.00								
				6222515.50	2201797.24	5.00	0.00								
AREASOURCE	CAR04	5.00	a	6222744.86	2201598.61	5.00	0.00								
				6222795.08	2201546.89	5.00	0.00								
				6222783.08	2201536.40	5.00	0.00								

Name	ID	Height		Coordinates			
		Begin (ft)	End (ft)	x (ft)	y (ft)	z (ft)	Ground (ft)
				6222732.86	2201585.12	5.00	0.00
AREASOURCE	CAR05	5.00	a	6222076.27	2201388.74	5.00	0.00
				6222088.26	2201377.50	5.00	0.00
				6222026.05	2201315.29	5.00	0.00
				6222014.80	2201328.03	5.00	0.00
AREASOURCE	CAR06	5.00	a	6222014.80	2201301.05	5.00	0.00
				6222026.05	2201315.29	5.00	0.00
				6222407.56	2200942.02	5.00	0.00
				6222393.32	2200931.52	5.00	0.00
AREASOURCE	CAR07	5.00	a	6222885.77	2201459.20	5.00	0.00
				6222970.47	2201378.25	5.00	0.00
				6222958.61	2201365.98	5.00	0.00
				6222875.54	2201444.92	5.00	0.00
AREASOURCE	CAR08	5.00	a	6223022.89	2201135.33	5.00	0.00
				6223034.67	2201122.90	5.00	0.00
				6222723.26	2200812.79	5.00	0.00
				6222709.52	2200827.84	5.00	0.00
AREASOURCE	CAR09	5.00	a	6222754.66	2200784.01	5.00	0.00
				6222744.19	2200795.13	5.00	0.00
				6223021.59	2201071.21	5.00	0.00
				6223034.67	2201060.09	5.00	0.00
AREASOURCE	CAR10	5.00	a	6222978.41	2201364.96	5.00	0.00
				6222990.64	2201352.91	5.00	0.00
				6222909.48	2201271.38	5.00	0.00
				6222895.32	2201283.84	5.00	0.00
AREASOURCE	CAR11	5.00	a	6224432.53	2199690.74	5.00	0.00
				6224443.69	2199678.79	5.00	0.00
				6224183.79	2199422.07	5.00	0.00
				6224173.43	2199432.43	5.00	0.00
AREASOURCE	CAR12	5.00	a	6224400.64	2199582.32	5.00	0.00
				6224411.80	2199569.56	5.00	0.00
				6224201.33	2199361.48	5.00	0.00
				6224187.78	2199373.44	5.00	0.00
AREASOURCE	CAR13	5.00	a	6224416.15	2199565.21	5.00	0.00
				6224428.55	2199552.82	5.00	0.00
				6224218.07	2199344.74	5.00	0.00
				6224201.33	2199361.48	5.00	0.00
AREASOURCE	CAR14	5.00	a	6224447.37	2199533.64	5.00	0.00
				6224460.31	2199521.88	5.00	0.00
				6224226.19	2199289.23	5.00	0.00
				6224211.48	2199301.87	5.00	0.00
AREASOURCE	CAR15	5.00	a	6223009.99	2201334.76	5.00	0.00
				6223023.11	2201322.11	5.00	0.00
				6222965.47	2201266.34	5.00	0.00
				6222953.28	2201277.59	5.00	0.00
AREASOURCE	CAR16	5.00	a	6222847.38	2201410.21	5.00	0.00
				6222860.50	2201423.80	5.00	0.00
				6222938.76	2201347.41	5.00	0.00
				6222925.64	2201335.70	5.00	0.00
AREASOURCE	COLD01	8.00	a	6222658.66	2201448.95	8.00	0.00
				6222701.70	2201403.76	8.00	0.00
				6222421.93	2201131.52	8.00	0.00
				6222378.89	2201173.49	8.00	0.00
AREASOURCE	COLD02	8.00	a	6223161.97	2201008.69	8.00	0.00
				6224377.25	2199821.19	8.00	0.00
				6224337.32	2199774.31	8.00	0.00
				6223115.10	2200963.55	8.00	0.00
AREASOURCE	DRY01	8.00	a	6224281.85	2199266.61	8.00	0.00
				6224357.59	2199340.75	8.00	0.00
				6224589.59	2199114.33	8.00	0.00
				6224512.26	2199040.19	8.00	0.00
AREASOURCE	DRY02	8.00	a	6224621.48	2199084.04	8.00	0.00
				6224709.18	2198997.93	8.00	0.00
				6224670.91	2198962.06	8.00	0.00
				6224582.42	2199047.36	8.00	0.00
AREASOURCE	DRY03	8.00	a	6224484.35	2199467.51	8.00	0.00
				6224804.05	2199155.79	8.00	0.00
				6224728.31	2199081.64	8.00	0.00
				6224409.41	2199392.57	8.00	0.00
AREASOURCE	DRY04	8.00	a	6222965.98	2201169.35	8.00	0.00
				6223005.23	2201133.37	8.00	0.00
				6222704.29	2200833.73	8.00	0.00
				6222664.38	2200872.33	8.00	0.00
AREASOURCE	DRY05	8.00	a	6222873.08	2201260.29	8.00	0.00
				6222911.68	2201223.65	8.00	0.00
				6222610.08	2200925.98	8.00	0.00
				6222571.48	2200961.30	8.00	0.00

Name	ID	Height		Coordinates				
		Begin		End		x	y	z
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
AREASOURCE	DRY06	8.00	a		6223240.10	2201032.99	8.00	0.00
				6223276.55	2201067.72	8.00	0.00	
				6224444.96	2199928.83	8.00	0.00	
				6224405.03	2199895.84	8.00	0.00	
AREASOURCE	DRY07	8.00	a		6222731.83	2201331.67	8.00	0.00
				6222769.49	2201295.08	8.00	0.00	
				6222515.55	2201043.29	8.00	0.00	
				6222477.51	2201080.45	8.00	0.00	

Building(s)

Name	Sel.	M.	ID	RB	Residents	Absorption	Height	Coordinates				
								Begin	x	y	z	Ground
								(ft)	(ft)	(ft)	(ft)	(ft)
BUILDING			BUILDING00001	x	0		45.00	a	6222513.40	2201741.64	45.00	0.00
									6222774.87	2201489.84	45.00	0.00
									6222701.70	2201403.76	45.00	0.00
									6222658.66	2201448.95	45.00	0.00
									6222378.89	2201173.49	45.00	0.00
									6222421.93	2201131.52	45.00	0.00
									6222341.23	2201049.74	45.00	0.00
									6222074.37	2201312.30	45.00	0.00
BUILDING			BUILDING00002	x	0		45.00	a	6223068.22	2201078.13	45.00	0.00
									6223161.97	2201008.69	45.00	0.00
									6223115.10	2200963.55	45.00	0.00
									6224337.32	2199774.31	45.00	0.00
									6224377.25	2199821.19	45.00	0.00
									6224453.64	2199734.38	45.00	0.00
									6224139.40	2199411.47	45.00	0.00
									6222750.51	2200770.84	45.00	0.00
BUILDING			BUILDING00003	x	0		15.00	a	6224705.80	2199592.50	15.00	0.00
									6224749.86	2199633.37	15.00	0.00
									6224844.81	2199536.62	15.00	0.00
									6224802.32	2199497.65	15.00	0.00

APPENDIX 10.1:
MOBILE CONSTRUCTION NOISE MODEL CALCULATIONS

This page intentionally left blank

15382 - Baker Lake Elsinore

CadnaA Noise Prediction Model: 15852-06_Mobile.cna

Date: 24.03.25

Analyst: B. Lawson

Calculation Configuration

Configuration	
Parameter	Value
General	
Max. Error (dB)	0.00
Max. Search Radius (ft)	6561.70
Min. Dist Src to Rcvr	0.00
Partition	
Raster Factor	0.50
Max. Length of Section (ft)	3280.80
Min. Length of Section (ft)	3.30
Min. Length of Section (%)	0.00
Proj. Line Sources	On
Proj. Area Sources	On
Ref. Time	
Daytime Penalty (dB)	0.00
Recr. Time Penalty (dB)	5.00
Night-time Penalty (dB)	10.00
DTM	
Standard Height (m)	0.00
Model of Terrain	Triangulation
Reflection	
max. Order of Reflection	2
Search Radius Src	328.08
Search Radius Rcvr	328.08
Max. Distance Source - Rcvr	3280.84 3280.84
Min. Distance Rcvr - Reflector	3.28 3.28
Min. Distance Source - Reflector	0.33
Industrial (ISO 9613 (1996))	
Lateral Diffraction	some Obj
Obst. within Area Src do not shield	On
Screening	Incl. Ground Att. over Barrier
	Dz with limit (20/25)
Barrier Coefficients C1,2,3	3.0 20.0 0.0
Temperature (°F)	50
rel. Humidity (%)	70
Ground Absorption G	0.50
Wind Speed for Dir. (mph)	6.7
Roads (TNM)	
Railways (FTA/FRA)	
Aircraft (???)	
Strictly acc. to AzB	

Receiver Noise Levels

Name	M.	ID	Level Lr			Limit. Value			Land Use			Height	Coordinates			
			Day	Night	CNEL	Day	Night	CNEL	Type	Auto	Noise Type		(ft)	(ft)	(ft)	
(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)				(ft)				
RECEIVERS	R1	61.3	-45.7	58.3	50.0	45.0	0.0					5.00	a	6221928.14	2201190.54	5.00
RECEIVERS	R2	54.1	-52.8	51.1	55.0	45.0	0.0					5.00	a	6221185.06	2200344.68	5.00
RECEIVERS	R3	52.3	-54.7	49.3	55.0	50.0	0.0					5.00	a	6222056.93	2199030.35	5.00
RECEIVERS	R4	52.3	-54.7	49.3	65.0	55.0	0.0					5.00	a	6223020.13	2198332.96	5.00
RECEIVERS	R5	50.0	-57.0	47.0	60.0	50.0	0.0					5.00	a	6224109.43	2197342.90	5.00
RECEIVERS	R6	60.9	-46.1	57.9	65.0	65.0	0.0					5.00	a	6224709.28	2199602.30	5.00

Area Source(s)

Name	M.	ID	Result. PWL			Result. PWL"			Lw / Li			Operating Time			Height
			Day	Evening	Night	Day	Evening	Night	Type	Value	norm.	Day	Special	Night	(ft)
(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)	(dBA)				DB(A)	(min)	(min)	
CONSDISS	CONSTRUCTION	122.6	15.6	15.6	65.0	-42.0	-42.0	PWL-Pt	115.6						8 a

Name	ID	Height		Coordinates			
		Begin	End	x	y	z	Ground
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
CONSDISS	CONSTRUCTION	8.00	a	6223713.37	2202767.16	8.00	0.00
				6224113.96	2202640.54	8.00	0.00
				6224142.81	2202630.95	8.00	0.00
				6224172.28	2202623.51	8.00	0.00
				6224202.22	2202618.25	8.00	0.00
				6224232.47	2202615.20	8.00	0.00
				6224262.85	2202614.39	8.00	0.00
				6224257.64	2202489.39	8.00	0.00
				6224182.12	2202498.93	8.00	0.00

Name	ID	Height		Coordinates			
		Begin	End	x	y	z	Ground
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
		6224159.55	2202461.61	8.00	0.00		
		6224175.18	2202417.34	8.00	0.00		
		6224185.22	2202388.50	8.00	0.00		
		6224196.88	2202360.28	8.00	0.00		
		6224210.12	2202332.76	8.00	0.00		
		6224224.89	2202306.03	8.00	0.00		
		6224241.15	2202280.18	8.00	0.00		
		6224260.15	2202250.88	8.00	0.00		
		6224280.55	2202222.54	8.00	0.00		
		6224302.31	2202195.22	8.00	0.00		
		6224325.36	2202168.98	8.00	0.00		
		6224349.66	2202143.90	8.00	0.00		
		6228370.51	2198230.56	8.00	0.00		
		6228304.45	2198164.50	8.00	0.00		
		6228173.13	2198292.13	8.00	0.00		
		6228172.55	2198291.59	8.00	0.00		
		6228156.60	2198308.19	8.00	0.00		
		6226101.91	2200305.03	8.00	0.00		
		6225530.71	2200848.88	8.00	0.00		
		6224726.89	2201616.24	8.00	0.00		
		6224389.39	2201940.89	8.00	0.00		
		6224196.68	2202126.66	8.00	0.00		
		6224125.50	2202208.25	8.00	0.00		
		6224056.06	2202319.36	8.00	0.00		
		6224002.24	2202458.25	8.00	0.00		
		6223963.45	2202624.72	8.00	0.00		
		6223900.47	2202645.59	8.00	0.00		
		6223637.97	2202729.62	8.00	0.00		
		6223605.36	2202736.52	8.00	0.00		
		6223572.37	2202741.24	8.00	0.00		
		6223539.13	2202743.78	8.00	0.00		
		6223505.80	2202744.10	8.00	0.00		
		6223472.53	2202742.22	8.00	0.00		
		6223439.45	2202738.15	8.00	0.00		
		6223406.71	2202731.89	8.00	0.00		
		6223374.46	2202723.48	8.00	0.00		
		6223342.83	2202712.95	8.00	0.00		
		6223313.35	2202700.06	8.00	0.00		
		6223284.82	2202685.18	8.00	0.00		
		6223257.37	2202668.40	8.00	0.00		
		6223231.13	2202649.77	8.00	0.00		
		6223206.23	2202629.39	8.00	0.00		
		6223182.78	2202607.36	8.00	0.00		
		6223160.89	2202583.78	8.00	0.00		
		6223141.34	2202561.60	8.00	0.00		
		6223123.31	2202538.16	8.00	0.00		
		6223106.89	2202513.57	8.00	0.00		
		6223092.14	2202487.95	8.00	0.00		
		6223055.85	2202435.25	8.00	0.00		
		6223017.83	2202383.78	8.00	0.00		
		6222986.71	2202347.03	8.00	0.00		
		6222954.48	2202311.25	8.00	0.00		
		6222921.15	2202276.49	8.00	0.00		
		6223223.37	2202329.82	8.00	0.00		
		6223583.67	2202354.71	8.00	0.00		
		6223711.67	2202358.26	8.00	0.00		
		6223802.93	2202370.12	8.00	0.00		
		6223806.49	2202261.08	8.00	0.00		
		6223917.89	2202109.37	8.00	0.00		
		6224086.19	2202229.08	8.00	0.00		
		6224329.15	2201992.04	8.00	0.00		
		6223446.19	2201365.08	8.00	0.00		
		6224495.08	2200345.81	8.00	0.00		
		6224857.28	2199990.83	8.00	0.00		
		6224725.00	2199861.32	8.00	0.00		
		6224779.64	2199749.76	8.00	0.00		
		6224799.34	2199733.39	8.00	0.00		
		6224818.53	2199716.42	8.00	0.00		
		6224856.02	2199684.79	8.00	0.00		
		6224891.96	2199651.39	8.00	0.00		
		6224926.24	2199616.31	8.00	0.00		
		6224958.80	2199579.62	8.00	0.00		
		6225005.30	2199523.75	8.00	0.00		
		6225053.23	2199469.11	8.00	0.00		
		6225102.55	2199415.73	8.00	0.00		
		6225497.00	2199028.92	8.00	0.00		
		6225456.03	2198986.56	8.00	0.00		

Name	ID	Height		Coordinates			
		Begin	End	x	y	z	Ground
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
		6225266.36	2199171.63	8.00	0.00		
		6225126.86	2199308.09	8.00	0.00		
		6225086.20	2199346.83	8.00	0.00		
		6225046.61	2199386.65	8.00	0.00		
		6225008.11	2199427.53	8.00	0.00		
		6224892.83	2199561.56	8.00	0.00		
		6224858.61	2199598.42	8.00	0.00		
		6224822.71	2199633.63	8.00	0.00		
		6224785.19	2199667.12	8.00	0.00		
		6224713.94	2199723.41	8.00	0.00		
		6224641.29	2199777.89	8.00	0.00		
		6224469.93	2199608.62	8.00	0.00		
		6225043.89	2199048.72	8.00	0.00		
		6225203.78	2198892.73	8.00	0.00		
		6225058.94	2198744.98	8.00	0.00		
		6224979.83	2198827.89	8.00	0.00		
		6224737.18	2198586.70	8.00	0.00		
		6221936.58	2201310.25	8.00	0.00		
		6221914.36	2201328.23	8.00	0.00		
		6221390.75	2200812.26	8.00	0.00		
		6221212.28	2200640.03	8.00	0.00		
		6221199.47	2200627.26	8.00	0.00		
		6221187.65	2200613.58	8.00	0.00		
		6221176.86	2200599.06	8.00	0.00		
		6221171.37	2200587.80	8.00	0.00		
		6221164.22	2200577.52	8.00	0.00		
		6221155.56	2200568.47	8.00	0.00		
		6221145.61	2200560.87	8.00	0.00		
		6221131.02	2200555.98	8.00	0.00		
		6221115.94	2200552.93	8.00	0.00		
		6221100.60	2200551.74	8.00	0.00		
		6221085.23	2200552.45	8.00	0.00		
		6221070.07	2200555.04	8.00	0.00		
		6221055.33	2200559.48	8.00	0.00		
		6221031.03	2200560.87	8.00	0.00		
		6221033.80	2200621.28	8.00	0.00		
		6221093.53	2200619.20	8.00	0.00		
		6221192.14	2200716.42	8.00	0.00		
		6221783.80	2201301.84	8.00	0.00		
		6221933.80	2201450.45	8.00	0.00		
		6221991.44	2201448.37	8.00	0.00		
		6222394.92	2201846.98	8.00	0.00		
		6222548.39	2201999.76	8.00	0.00		
		6222495.61	2202202.53	8.00	0.00		
		6222466.44	2202219.89	8.00	0.00		
		6222250.47	2202169.20	8.00	0.00		
		6222186.88	2202156.45	8.00	0.00		
		6222122.88	2202145.97	8.00	0.00		
		6222058.54	2202137.75	8.00	0.00		
		6221993.96	2202131.82	8.00	0.00		
		6221929.20	2202128.18	8.00	0.00		
		6221864.36	2202126.84	8.00	0.00		
		6221547.00	2202125.45	8.00	0.00		
		6220987.28	2202123.37	8.00	0.00		
		6220303.94	2202121.28	8.00	0.00		
		6220238.85	2202124.21	8.00	0.00		
		6220173.91	2202129.49	8.00	0.00		
		6220109.20	2202137.13	8.00	0.00		
		6220044.81	2202147.11	8.00	0.00		
		6219980.82	2202159.43	8.00	0.00		
		6219917.33	2202174.05	8.00	0.00		
		6219854.40	2202190.98	8.00	0.00		
		6219792.14	2202210.17	8.00	0.00		
		6219758.11	2202194.20	8.00	0.00		
		6219640.75	2201869.20	8.00	0.00		
		6219626.27	2201826.70	8.00	0.00		
		6219613.90	2201783.55	8.00	0.00		
		6219603.66	2201739.84	8.00	0.00		
		6219595.59	2201695.68	8.00	0.00		
		6219589.69	2201651.17	8.00	0.00		
		6219585.99	2201606.43	8.00	0.00		
		6219584.50	2201561.56	8.00	0.00		
		6219581.03	2201342.12	8.00	0.00		
		6219575.47	2201131.70	8.00	0.00		
		6219558.11	2201051.84	8.00	0.00		
		6219527.55	2201053.23	8.00	0.00		
		6219530.33	2201133.09	8.00	0.00		

Name	ID	Height		Coordinates			
		Begin	End	x	y	z	Ground
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
		6219537.28	2201562.26	8.00	0.00		
		6219539.24	2201609.24	8.00	0.00		
		6219543.42	2201656.08	8.00	0.00		
		6219549.80	2201702.67	8.00	0.00		
		6219558.37	2201748.90	8.00	0.00		
		6219569.11	2201794.69	8.00	0.00		
		6219582.00	2201839.91	8.00	0.00		
		6219597.00	2201884.48	8.00	0.00		
		6219722.69	2202234.48	8.00	0.00		
		6219655.33	2202257.39	8.00	0.00		
		6221879.17	2202246.33	8.00	0.00		
		6221946.67	2202249.01	8.00	0.00		
		6222014.03	2202254.16	8.00	0.00		
		6222081.15	2202261.78	8.00	0.00		
		6222147.95	2202271.84	8.00	0.00		
		6222214.33	2202284.35	8.00	0.00		
		6222280.21	2202299.28	8.00	0.00		
		6222775.01	2202413.00	8.00	0.00		
		6222931.90	2202441.52	8.00	0.00		
		6222935.14	2202443.50	8.00	0.00		
		6223031.49	2202571.97	8.00	0.00		
		6223070.56	2202625.79	8.00	0.00		
		6223153.02	2202703.91	8.00	0.00		
		6223239.83	2202754.26	8.00	0.00		
		6223312.31	2202784.64	8.00	0.00		
		6223406.93	2202803.74	8.00	0.00		
		6223485.92	2202807.21	8.00	0.00		
		6223502.65	2202804.28	8.00	0.00		
		6223531.71	2202804.23	8.00	0.00		
		6223568.87	2202801.68	8.00	0.00		
		6223605.78	2202796.68	8.00	0.00		
		6223642.27	2202789.23	8.00	0.00		
		6223678.19	2202779.38	8.00	0.00		

Building(s)

Name	Sel.	M.	ID	RB	Residents	Absorption	Height		Coordinates			
							Begin		x	y	z	Ground
							(ft)		(ft)	(ft)	(ft)	(ft)
BUILDING			BUILDING00003	x	0		15.00	a	6224705.80	2199592.50	15.00	0.00
									6224749.86	2199633.37	15.00	0.00
									6224844.81	2199536.62	15.00	0.00
									6224802.32	2199497.65	15.00	0.00

APPENDIX 10.2:

STATIONARY CONSTRUCTION NOISE MODEL CALCULATIONS

This page intentionally left blank

15382 - Baker Lake Elsinore

CadnaA Noise Prediction Model: 15852-04_Stationary.cna

Date: 06.02.25

Analyst: B. Lawson

Calculation Configuration

Configuration	
Parameter	Value
General	
Max. Error (dB)	0.00
Max. Search Radius (ft)	6561.70
Min. Dist Src to Rcvr	0.00
Partition	
Raster Factor	0.50
Max. Length of Section (ft)	3280.80
Min. Length of Section (ft)	3.30
Min. Length of Section (%)	0.00
Proj. Line Sources	On
Proj. Area Sources	On
Ref. Time	
Daytime Penalty (dB)	0.00
Recr. Time Penalty (dB)	5.00
Night-time Penalty (dB)	10.00
DTM	
Standard Height (m)	0.00
Model of Terrain	Triangulation
Reflection	
max. Order of Reflection	2
Search Radius Src	328.08
Search Radius Rcvr	328.08
Max. Distance Source - Rcvr	3280.84 3280.84
Min. Distance Rcvr - Reflector	3.28 3.28
Min. Distance Source - Reflector	0.33
Industrial (ISO 9613 (1996))	
Lateral Diffraction	some Obj
Obst. within Area Src do not shield	On
Screening	Incl. Ground Att. over Barrier
	Dz with limit (20/25)
Barrier Coefficients C1,2,3	3.0 20.0 0.0
Temperature (°F)	50
rel. Humidity (%)	70
Ground Absorption G	0.50
Wind Speed for Dir. (mph)	6.7
Roads (TNM)	
Railways (FTA/FRA)	
Aircraft (???)	
Strictly acc. to AzB	

Receiver Noise Levels

Name	M.	ID	Level Lr			Limit. Value			Land Use			Height	Coordinates			
			Day	Night	CNEL	Day	Night	CNEL	Type	Auto	Noise Type		(ft)	(ft)	(ft)	(ft)
RECEIVERS	R1	57.5	57.5	64.2	50.0	45.0	0.0					5.00	a	6221928.14	2201190.54	5.00
RECEIVERS	R2	47.8	47.8	54.5	55.0	45.0	0.0					5.00	a	6221185.06	2200344.68	5.00
RECEIVERS	R3	46.4	46.4	53.0	55.0	50.0	0.0					5.00	a	6222056.93	2199030.35	5.00
RECEIVERS	R4	45.5	45.5	52.2	65.0	55.0	0.0					5.00	a	6223020.13	2198332.96	5.00
RECEIVERS	R5	41.9	41.9	48.6	60.0	50.0	0.0					5.00	a	6224109.43	2197342.90	5.00
RECEIVERS	R6	51.5	51.5	58.1	65.0	65.0	0.0					5.00	a	6224709.28	2199602.30	5.00

Area Source(s)

Name	M.	ID	Result. PWL			Result. PWL"			Lw / Li			Operating Time			Height
			Day	Evening	Night	Day	Evening	Night	Type	Value	norm.	Day	Special	Night	(ft)
BUILDING	BUILDING00002	112.2	112.2	112.2	63.6	63.6	63.6	63.6	Lw	112.2					8 a
BUILDING	BUILDING00001	112.2	112.2	112.2	69.4	69.4	69.4	69.4	Lw	112.2					8 a

Name	ID	Height		Coordinates			
		Begin	End	x	y	z	Ground
BUILDING	BUILDING00002	8.00	a		6223068.22	2201078.13	8.00 0.00
					6223161.97	2201008.69	8.00 0.00
					6223115.10	2200963.55	8.00 0.00
					6224337.32	2199774.31	8.00 0.00
					6224377.25	2199821.19	8.00 0.00
					6224453.64	2199734.38	8.00 0.00
					6224139.40	2199411.47	8.00 0.00
					6222750.51	2200770.84	8.00 0.00

Name	ID	Height		Coordinates			
		Begin (ft)	End (ft)	x (ft)	y (ft)	z (ft)	Ground (ft)
BUILDING	BUILDING00001	8.00	a	6222513.40	2201741.64	8.00	0.00
				6222774.87	2201489.84	8.00	0.00
				6222701.70	2201403.76	8.00	0.00
				6222658.66	2201448.95	8.00	0.00
				6222378.89	2201173.49	8.00	0.00
				6222421.93	2201131.52	8.00	0.00
				6222341.23	2201049.74	8.00	0.00
				6222074.37	2201312.30	8.00	0.00

APPENDIX 10.3:
OFF-SITE CONSTRUCTION NOISE MODEL CALCULATIONS

This page intentionally left blank

15382 - Baker Lake Elsinore

CadnaA Noise Prediction Model: 15852-06_OffSite.cna

Date: 24.03.25

Analyst: B. Lawson

Calculation Configuration

Configuration	
Parameter	Value
General	
Max. Error (dB)	0.00
Max. Search Radius (ft)	6561.70
Min. Dist Src to Rcvr	0.00
Partition	
Raster Factor	0.50
Max. Length of Section (ft)	3280.80
Min. Length of Section (ft)	3.30
Min. Length of Section (%)	0.00
Proj. Line Sources	On
Proj. Area Sources	On
Ref. Time	
Daytime Penalty (dB)	0.00
Recr. Time Penalty (dB)	5.00
Night-time Penalty (dB)	10.00
DTM	
Standard Height (m)	0.00
Model of Terrain	Triangulation
Reflection	
max. Order of Reflection	2
Search Radius Src	328.08
Search Radius Rcvr	328.08
Max. Distance Source - Rcvr	3280.84 3280.84
Min. Distance Rcvr - Reflector	3.28 3.28
Min. Distance Source - Reflector	0.33
Industrial (ISO 9613 (1996))	
Lateral Diffraction	some Obj
Obst. within Area Src do not shield	On
Screening	Incl. Ground Att. over Barrier
	Dz with limit (20/25)
Barrier Coefficients C1,2,3	3.0 20.0 0.0
Temperature (°F)	50
rel. Humidity (%)	70
Ground Absorption G	0.50
Wind Speed for Dir. (mph)	6.7
Roads (TNM)	
Railways (FTA/FRA)	
Aircraft (???)	
Strictly acc. to AzB	

Receiver Noise Levels

Name	M.	ID	Level Lr			Limit. Value			Land Use		Height		Coordinates			
			Day	Night	CNEL	Day	Night	CNEL	Type	Auto	Noise Type	(ft)	(ft)	(ft)	X	Y
(dB(A))	(dB(A))	(dB(A))	(dB(A))	(dB(A))	(dB(A))	(dB(A))	(dB(A))	(dB(A))								
RECEIVERS	R_10	65.7	-41.3	62.7	65.0	65.0	0.0					5.00	a	6221682.41	2201215.59	5.00
RECEIVERS	R_20	64.3	-42.7	61.3	65.0	65.0	0.0					5.00	a	6221676.10	2201223.31	5.00
RECEIVERS	R_50	61.8	-45.1	58.8	65.0	65.0	0.0					5.00	a	6221655.65	2201245.63	5.00
RECEIVERS	R_100	59.8	-47.2	56.8	65.0	65.0	0.0					5.00	a	6221624.79	2201285.48	5.00

Area Source(s)

Name	M.	ID	Result. PWL			Result. PWL"			Lw / Li		Operating Time			Height	
			Day	Evening	Night	Day	Evening	Night	Type	Value	norm.	Day	Special	Night	
OFFSITE2	OFFSITE	122.6	15.6	15.6	67.7	-39.3	-39.3	PWL-Pt	115.6					8	a

Name	ID	Height		Coordinates			
		Begin	End	x	y	z	Ground
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
OFFSITE2	OFFSITE	8.00	a	6223713.37	2202767.16	8.00	0.00
				6224113.96	2202640.54	8.00	0.00
				6224142.81	2202630.95	8.00	0.00
				6224172.28	2202623.51	8.00	0.00
				6224202.22	2202618.25	8.00	0.00
				6224232.47	2202615.20	8.00	0.00
				6224262.85	2202614.39	8.00	0.00
				6224257.64	2202489.39	8.00	0.00
				6224182.12	2202498.93	8.00	0.00
				6224159.55	2202461.61	8.00	0.00
				6224175.18	2202417.34	8.00	0.00

Name	ID	Height		Coordinates				
		Begin		End		x	y	z
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
				6224185.22	2202388.50	8.00	0.00	
				6224196.88	2202360.28	8.00	0.00	
				6224210.12	2202332.76	8.00	0.00	
				6224224.89	2202306.03	8.00	0.00	
				6224241.15	2202280.18	8.00	0.00	
				6224260.15	2202250.88	8.00	0.00	
				6224280.55	2202222.54	8.00	0.00	
				6224302.31	2202195.22	8.00	0.00	
				6224325.36	2202168.98	8.00	0.00	
				6224349.66	2202143.90	8.00	0.00	
				6228370.51	2198230.56	8.00	0.00	
				6228304.45	2198164.50	8.00	0.00	
				6228173.13	2198292.13	8.00	0.00	
				6228172.55	2198291.59	8.00	0.00	
				6228156.60	2198308.19	8.00	0.00	
				6226101.91	2200305.03	8.00	0.00	
				6225530.71	2200848.88	8.00	0.00	
				6224726.89	2201616.24	8.00	0.00	
				6224389.39	2201940.89	8.00	0.00	
				6224196.68	2202126.66	8.00	0.00	
				6224125.50	2202208.25	8.00	0.00	
				6224056.06	2202319.36	8.00	0.00	
				6224002.24	2202458.25	8.00	0.00	
				6223963.45	2202624.72	8.00	0.00	
				6223900.47	2202645.59	8.00	0.00	
				6223637.97	2202729.62	8.00	0.00	
				6223605.36	2202736.52	8.00	0.00	
				6223572.37	2202741.24	8.00	0.00	
				6223539.13	2202743.78	8.00	0.00	
				6223505.80	2202744.10	8.00	0.00	
				6223472.53	2202742.22	8.00	0.00	
				6223439.45	2202738.15	8.00	0.00	
				6223406.71	2202731.89	8.00	0.00	
				6223374.46	2202723.48	8.00	0.00	
				6223342.83	2202712.95	8.00	0.00	
				6223313.35	2202700.06	8.00	0.00	
				6223284.82	2202685.19	8.00	0.00	
				6223257.37	2202668.40	8.00	0.00	
				6223231.13	2202649.77	8.00	0.00	
				6223206.23	2202629.39	8.00	0.00	
				6223182.78	2202607.36	8.00	0.00	
				6223160.89	2202583.78	8.00	0.00	
				6223141.34	2202561.60	8.00	0.00	
				6223123.31	2202538.16	8.00	0.00	
				6223106.89	2202513.57	8.00	0.00	
				6223092.14	2202487.95	8.00	0.00	
				6223055.85	2202435.25	8.00	0.00	
				6223017.83	2202383.78	8.00	0.00	
				6222986.71	2202347.03	8.00	0.00	
				6222954.48	2202311.25	8.00	0.00	
				6222921.15	2202276.49	8.00	0.00	
				6223223.37	2202329.82	8.00	0.00	
				6223583.67	2202354.71	8.00	0.00	
				6223711.67	2202358.26	8.00	0.00	
				6223802.93	2202370.12	8.00	0.00	
				6223806.49	2202261.08	8.00	0.00	
				6223917.89	2202109.37	8.00	0.00	
				6224086.19	2202229.08	8.00	0.00	
				6224329.15	2201992.04	8.00	0.00	
				6223446.19	2201365.08	8.00	0.00	
				6224495.08	2200345.81	8.00	0.00	
				6224857.28	2199990.83	8.00	0.00	
				6224725.00	2199861.32	8.00	0.00	
				6224779.64	2199749.76	8.00	0.00	
				6224799.34	2199733.39	8.00	0.00	
				6224818.53	2199716.42	8.00	0.00	
				6224856.02	2199684.79	8.00	0.00	
				6224891.96	2199651.39	8.00	0.00	
				6224926.24	2199616.31	8.00	0.00	
				6224958.80	2199579.62	8.00	0.00	
				6225005.30	2199523.75	8.00	0.00	
				6225053.23	2199469.11	8.00	0.00	
				6225102.55	2199415.73	8.00	0.00	
				6225497.00	2199028.92	8.00	0.00	
				6225456.03	2198986.56	8.00	0.00	
				6225266.36	2199171.63	8.00	0.00	
				6225126.86	2199308.09	8.00	0.00	

Name	ID	Height		Coordinates			
		Begin		End		x	y
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
				6225086.20	2199346.83	8.00	0.00
				6225046.61	2199386.65	8.00	0.00
				6225008.11	2199427.53	8.00	0.00
				6224892.83	2199561.56	8.00	0.00
				6224858.61	2199598.42	8.00	0.00
				6224822.71	2199633.63	8.00	0.00
				6224785.19	2199667.12	8.00	0.00
				6224713.94	2199723.41	8.00	0.00
				6224641.29	2199777.89	8.00	0.00
				6224414.44	2199996.31	8.00	0.00
				6223754.03	2200636.63	8.00	0.00
				6223497.31	2200886.84	8.00	0.00
				6223211.58	2201164.34	8.00	0.00
				6222789.01	2201575.26	8.00	0.00
				6222769.59	2201594.41	8.00	0.00
				6222751.04	2201614.40	8.00	0.00
				6222733.41	2201635.21	8.00	0.00
				6222706.56	2201669.74	8.00	0.00
				6222681.30	2201705.45	8.00	0.00
				6222657.69	2201742.27	8.00	0.00
				6222635.77	2201780.13	8.00	0.00
				6222615.59	2201818.94	8.00	0.00
				6222597.19	2201858.62	8.00	0.00
				6222565.07	2201873.38	8.00	0.00
				6222539.15	2201865.84	8.00	0.00
				6222514.07	2201855.85	8.00	0.00
				6222490.06	2201843.49	8.00	0.00
				6222467.35	2201828.89	8.00	0.00
				6222446.15	2201812.18	8.00	0.00
				6221936.58	2201310.25	8.00	0.00
				6221914.36	2201328.23	8.00	0.00
				6221390.75	2200812.26	8.00	0.00
				6221212.28	2200640.03	8.00	0.00
				6221199.47	2200627.26	8.00	0.00
				6221187.65	2200613.58	8.00	0.00
				6221176.86	2200599.06	8.00	0.00
				6221171.37	2200587.80	8.00	0.00
				6221164.22	2200577.52	8.00	0.00
				6221155.56	2200568.47	8.00	0.00
				6221145.61	2200560.87	8.00	0.00
				6221131.02	2200555.98	8.00	0.00
				6221115.94	2200552.93	8.00	0.00
				6221100.60	2200551.74	8.00	0.00
				6221085.23	2200552.45	8.00	0.00
				6221070.07	2200555.04	8.00	0.00
				6221055.33	2200559.48	8.00	0.00
				6221031.03	2200560.87	8.00	0.00
				6221033.80	2200621.28	8.00	0.00
				6221093.53	2200619.20	8.00	0.00
				6221192.14	2200716.42	8.00	0.00
				6221783.80	2201301.84	8.00	0.00
				6221933.80	2201450.45	8.00	0.00
				6221991.44	2201448.37	8.00	0.00
				6222394.92	2201846.98	8.00	0.00
				6222548.39	2201999.76	8.00	0.00
				6222495.61	2202202.53	8.00	0.00
				6222466.44	2202219.89	8.00	0.00
				6222250.47	2202169.20	8.00	0.00
				6222186.88	2202156.45	8.00	0.00
				6222122.88	2202145.97	8.00	0.00
				6222058.54	2202137.75	8.00	0.00
				6221993.96	2202131.82	8.00	0.00
				6221929.20	2202128.18	8.00	0.00
				6221864.36	2202126.84	8.00	0.00
				6221547.00	2202125.45	8.00	0.00
				6220987.28	2202123.37	8.00	0.00
				6220303.94	2202121.28	8.00	0.00
				6220238.85	2202124.21	8.00	0.00
				6220173.91	2202129.49	8.00	0.00
				6220109.20	2202137.13	8.00	0.00
				6220044.81	2202147.11	8.00	0.00
				6219980.82	2202159.43	8.00	0.00
				6219917.33	2202174.05	8.00	0.00
				6219854.40	2202190.98	8.00	0.00
				6219792.14	2202210.17	8.00	0.00
				6219758.11	2202194.20	8.00	0.00
				6219640.75	2201869.20	8.00	0.00

Name	ID	Height		Coordinates				
		Begin		End		x	y	z
		(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
				6219626.27	2201826.71	8.00	0.00	
				6219613.90	2201783.55	8.00	0.00	
				6219603.66	2201739.84	8.00	0.00	
				6219595.59	2201695.68	8.00	0.00	
				6219589.69	2201651.17	8.00	0.00	
				6219585.99	2201606.43	8.00	0.00	
				6219584.50	2201561.56	8.00	0.00	
				6219581.03	2201342.12	8.00	0.00	
				6219575.47	2201131.70	8.00	0.00	
				6219558.11	2201051.84	8.00	0.00	
				6219527.55	2201053.23	8.00	0.00	
				6219530.33	2201133.09	8.00	0.00	
				6219537.28	2201562.26	8.00	0.00	
				6219539.24	2201609.24	8.00	0.00	
				6219543.42	2201656.08	8.00	0.00	
				6219549.80	2201702.67	8.00	0.00	
				6219558.37	2201748.90	8.00	0.00	
				6219569.11	2201794.69	8.00	0.00	
				6219582.00	2201839.91	8.00	0.00	
				6219597.00	2201884.48	8.00	0.00	
				6219722.69	2202234.48	8.00	0.00	
				6219655.33	2202257.39	8.00	0.00	
				6221879.17	2202246.33	8.00	0.00	
				6221946.67	2202249.01	8.00	0.00	
				6222014.03	2202254.16	8.00	0.00	
				6222081.15	2202261.78	8.00	0.00	
				6222147.95	2202271.84	8.00	0.00	
				6222214.33	2202284.35	8.00	0.00	
				6222280.21	2202299.28	8.00	0.00	
				6222775.01	2202413.00	8.00	0.00	
				6222931.90	2202441.52	8.00	0.00	
				6222935.14	2202443.50	8.00	0.00	
				6223031.49	2202571.97	8.00	0.00	
				6223070.56	2202625.79	8.00	0.00	
				6223153.02	2202703.91	8.00	0.00	
				6223239.83	2202754.26	8.00	0.00	
				6223312.31	2202784.64	8.00	0.00	
				6223406.93	2202803.74	8.00	0.00	
				6223485.92	2202807.21	8.00	0.00	
				6223502.65	2202804.28	8.00	0.00	
				6223531.71	2202804.23	8.00	0.00	
				6223568.87	2202801.68	8.00	0.00	
				6223605.78	2202796.68	8.00	0.00	
				6223642.27	2202789.23	8.00	0.00	
				6223678.19	2202779.38	8.00	0.00	

APPENDIX 10.4:
NIGHTTIME CONCRETE POUR NOISE MODEL CALCULATIONS

This page intentionally left blank

15382 - Baker Lake Elsinore

CadnaA Noise Prediction Model: 15852-04_Pour.cna

Date: 06.02.25

Analyst: B. Lawson

Calculation Configuration

Configuration	
Parameter	Value
General	
Max. Error (dB)	0.00
Max. Search Radius (ft)	6561.70
Min. Dist Src to Rcvr	0.00
Partition	
Raster Factor	0.50
Max. Length of Section (ft)	3280.80
Min. Length of Section (ft)	3.30
Min. Length of Section (%)	0.00
Proj. Line Sources	On
Proj. Area Sources	On
Ref. Time	
Daytime Penalty (dB)	0.00
Recr. Time Penalty (dB)	5.00
Night-time Penalty (dB)	10.00
DTM	
Standard Height (m)	0.00
Model of Terrain	Triangulation
Reflection	
max. Order of Reflection	2
Search Radius Src	328.08
Search Radius Rcvr	328.08
Max. Distance Source - Rcvr	3280.84 3280.84
Min. Distance Rcvr - Reflector	3.28 3.28
Min. Distance Source - Reflector	0.33
Industrial (ISO 9613 (1996))	
Lateral Diffraction	some Obj
Obst. within Area Src do not shield	On
Screening	Incl. Ground Att. over Barrier
	Dz with limit (20/25)
Barrier Coefficients C1,2,3	3.0 20.0 0.0
Temperature (°F)	50
rel. Humidity (%)	70
Ground Absorption G	0.50
Wind Speed for Dir. (mph)	6.7
Roads (TNM)	
Railways (FTA/FRA)	
Aircraft (???)	
Strictly acc. to AzB	

Receiver Noise Levels

Name	M.	ID	Level Lr			Limit. Value			Land Use			Height	Coordinates			
			Day	Night	CNEL	Day	Night	CNEL	Type	Auto	Noise Type		(ft)	(ft)	(ft)	
(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)				(ft)				
RECEIVERS	R1	52.6	-54.4	49.6	50.0	45.0	0.0					5.00	a	6221928.14	2201190.54	5.00
RECEIVERS	R2	42.9	-64.0	39.9	55.0	45.0	0.0					5.00	a	6221185.06	2200344.68	5.00
RECEIVERS	R3	41.5	-65.4	38.4	55.0	50.0	0.0					5.00	a	6222056.93	2199030.35	5.00
RECEIVERS	R4	40.6	-66.2	37.6	65.0	55.0	0.0					5.00	a	6223020.13	2198332.96	5.00
RECEIVERS	R5	37.0	-69.6	34.0	60.0	50.0	0.0					5.00	a	6224109.43	2197342.90	5.00
RECEIVERS	R6	46.6	-60.4	43.6	65.0	65.0	0.0					5.00	a	6224709.28	2199602.30	5.00

Area Source(s)

Name	M.	ID	Result. PWL			Result. PWL'			Lw / Li			Operating Time			Height
			Day	Evening	Night	Day	Evening	Night	Type	Value	norm.	Day	Special	Night	(ft)
(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)	(dB)				(dB(A))	(min)	(min)	
BUILDING	BUILDING00002	107.3	0.3	0.3	58.7	-48.3	-48.3	PWL-Pt	100.3						8 a
BUILDING	BUILDING00001	107.3	0.3	0.3	64.5	-42.5	-42.5	PWL-Pt	100.3						8 a

Name	ID	Height		Coordinates			
		Begin	End	x	y	z	Ground
(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)
BUILDING	BUILDING00002	8.00	a	6223068.22	2201078.13	8.00	0.00
				6223161.97	2201008.69	8.00	0.00
				6223115.10	2200963.55	8.00	0.00
				6224337.32	2199774.31	8.00	0.00
				6224377.25	2199821.19	8.00	0.00
				6224453.64	2199734.38	8.00	0.00
				6224139.40	2199411.47	8.00	0.00
				6222750.51	2200770.84	8.00	0.00

Name	ID	Height		Coordinates			
		Begin (ft)	End (ft)	x (ft)	y (ft)	z (ft)	Ground (ft)
BUILDING	BUILDING00001	8.00	a	6222513.40	2201741.64	8.00	0.00
				6222774.87	2201489.84	8.00	0.00
				6222701.70	2201403.76	8.00	0.00
				6222658.66	2201448.95	8.00	0.00
				6222378.89	2201173.49	8.00	0.00
				6222421.93	2201131.52	8.00	0.00
				6222341.23	2201049.74	8.00	0.00
				6222074.37	2201312.30	8.00	0.00